
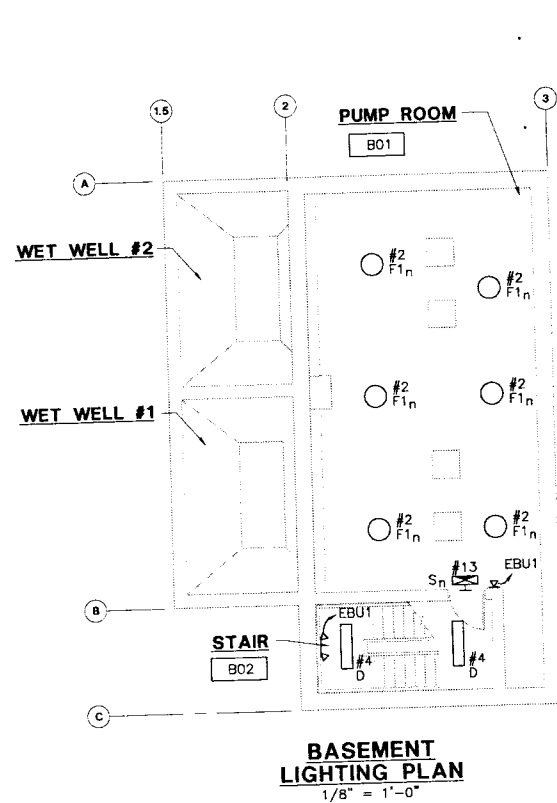


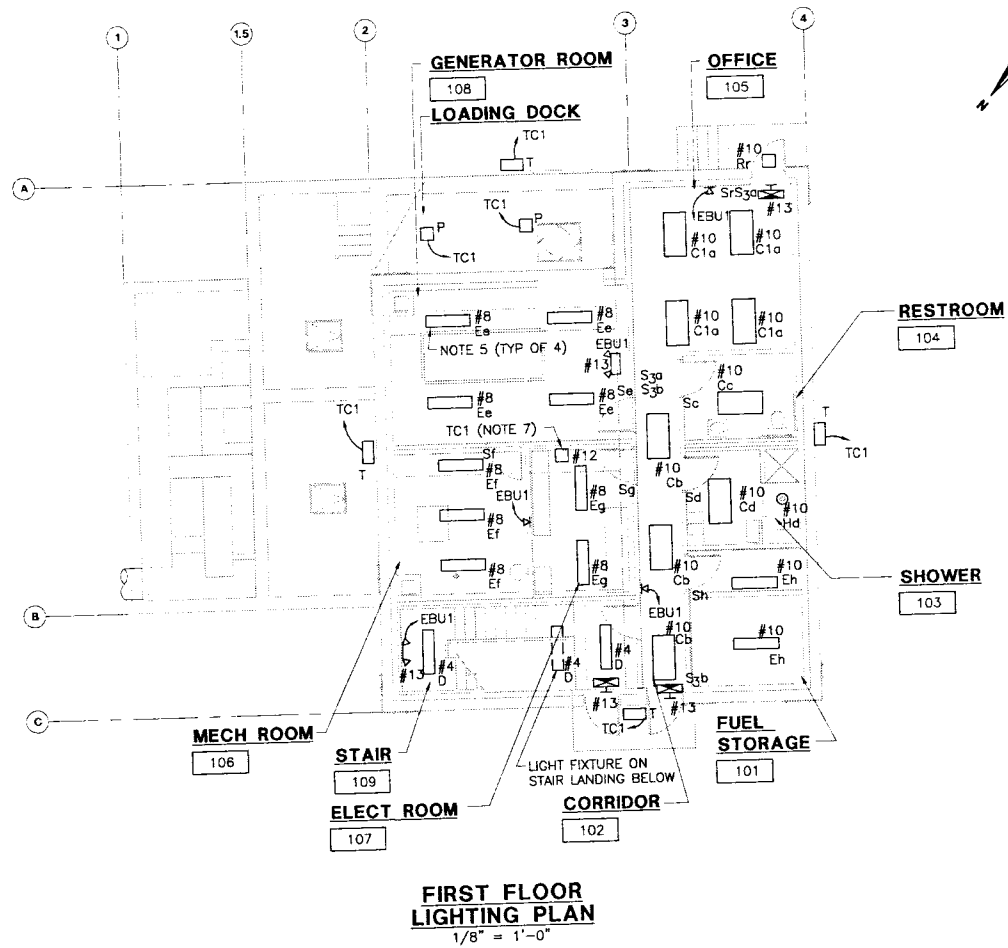

LIGHTING FIXTURE SCHEDULE:						
CODE	LIGHT SOURCE	LAMPING	MOUNTING	MANUFACTURER	CATALOG NO.	VOLTS
	TYPE					
C	FLUORESCENT	(2)F32T8	CEILING RECESSED	COOPER-METALUX	2GS-232A-120-EB81	120
C1	FLUORESCENT	(3)F32T8	CEILING RECESSED	COOPER-METALUX	2GS-332A-120-EB81	120
D	FLUORESCENT	(2)F32T8	CEILING SURFACE	COOPER-METALUX	VT2-232DR-120-EB81-WL	120
E	FLUORESCENT	(2)F32T8	PENDANT, 8FT. AFF OR AS NOTED ON DRAWINGS	COOPER-METALUX	DIM-232-120-EB81	120
F1	METAL HALIDE	175W MH	PENDANT, 14FT. AFF	COOPER-LUMARK	MHBE-5A-175-120-F1-WLB-EM	120
H	INCAND.	40W A19	CEILING RECESSED	COOPER-HALO	H51CAT-5050-PS	120
P	METAL HALIDE	175W MH	CEILING SURFACE	COOPER-LUMARK	MHPR-175W-120V-F1	120
R	METAL HALIDE	50W MH	WALL *	COOPER-LUMARK	MHMN-50-120-LL-F1-PE	120
T	METAL HALIDE	175W MH	WALL *	COOPER-LUMARK	MHWL-175-120-F1-VS/WL	120
⏏	INCAND.	(2) 9W, 12V	WALL, 7'AFF	COOPER-SURE-LITES	XR-21-SD	120
▽	INCAND.	8W, 12V	WALL, 7'AFF	COOPER-SURE-LITES	12X-8-WHU	12VDC
▽▽	INCAND.	(2) 8W, 12V	WALL, 7'AFF	COOPER-SURE-LITES	12X-8-WHU	12VDC
⏏	LED		WALL, 7'AFF	COOPER-SURE-LITES	CCX-7070-RWH	120
* REFER TO ARCHITECTURAL BUILDING ELEVATIONS FOR FIXTURE MOUNTING HEIGHTS						
DESCRIPTION						
2x 4 FLUOR. STATIC TROFFER, ACRYLIC LENS, ELECTRONIC BALLAST						
SAME AS TYPE C, EXCEPT 3 LAMP						
4 FT. ENCL. & GASKETED FLUOR., WET LOCATION, ELECTRONIC BALLAST						
4 FT. FLUOR., INDUSTRIAL REFLECTOR, 20% UPLIGHT, ELECTRONIC BALLAST						
METAL HALIDE LOW-BAY INDUSTRIAL, UL WET LOCATION, SINGLE FUSING, WITH QUARTZ RESTRIKE WITH DELAY RELAY						
UL WET LOCATION SHOWER LIGHT, IC HOUSING						
METAL HALIDE LOADING DOCK FIXTURE, UL WET LOCATION, SINGLE FUSING						
METAL HALIDE COMPACT WALLPACK, UL WET LOCATION, SHARP CUT-OFF, LAMP INCLUDED, SINGLE FUSING, WITH PHOTOCONTROL						
METAL HALIDE WALLPACK, UL WET LOCATION, WITH BOROSILICATE GLASS REFRACTOR, SINGLE FUSING, AND VISOR CUT-OFF SHIELD						
EMERG. BATTERY UNIT W/2 LAMPS, NI-CAD BATTERY						
SINGLE REMOTE EMERG. LIGHT						
DOUBLE REMOTE EMERG. LIGHT						
SELF-POWERED EXIT, NI-CAD BATTERY						

- NOTES:**
- FOR LEGEND AND GENERAL NOTES, REFER TO DRAWING E-1.
 - CIRCUIT NUMBERS ON THIS DRAWING REFER TO PANELBOARD LP-1, UNLESS OTHERWISE NOTED.
 - FOR PANELBOARD SCHEDULE, REFER TO DRAWING E-3.
 - 120 VOLT CIRCUITS EXCEEDING 100 FEET IN LENGTH SHALL BE NO. 10 AWG WIRING.
 - LIGHT FIXTURES IN GENERATOR ROOM SHALL BE PENDANT MOUNTED 10 FEET ABOVE FINISHED FLOOR.
 - STAIRWELL LIGHT FIXTURES SHALL BE CONNECTED TO DESIGNATED CIRCUIT WITHOUT SWITCHING, TO BE IN CONTINUOUS OPERATION.
 - EXTERIOR WALLPACK AND LOADING DOCK LIGHT FIXTURES SHALL BE CIRCUITED TO, AND CONTROLLED BY, TIME CLOCK TC1.

THESE RECORD DRAWINGS HAVE BEEN PREPARED IN PART ON THE BASIS OF THE INFORMATION FURNISHED BY OTHERS. THE ENGINEER WILL NOT BE RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

DEPARTMENT OF PUBLIC WORKS
TOWN OF EAST LONGMEADOW, MA
VINELAND AVENUE PUMP STATION
CONTRACTS NO. 1 AND NO. 2

DWG E-4
46 OF 49

Wright-Pierce
169 Main Street, 700 Plaza Middlesex
Middletown, Connecticut USA 06457
TEL (860) 343-8297 FAX (860) 343-9504

NO.	REVISIONS	DATE	BY	REASON
1	ISSUED FOR REVIEW	12-02		
2	ISSUED FOR BIDDING	2-03		
3	AS NOTED			
4	AS NOTED			
5	AS NOTED			
6	AS NOTED			
7	AS NOTED			
8	AS NOTED			
9	AS NOTED			
10	AS NOTED			
11	AS NOTED			
12	AS NOTED			
13	AS NOTED			
14	AS NOTED			
15	AS NOTED			
16	AS NOTED			
17	AS NOTED			
18	AS NOTED			
19	AS NOTED			
20	AS NOTED			
21	AS NOTED			
22	AS NOTED			
23	AS NOTED			
24	AS NOTED			
25	AS NOTED			
26	AS NOTED			
27	AS NOTED			
28	AS NOTED			
29	AS NOTED			
30	AS NOTED			
31	AS NOTED			
32	AS NOTED			
33	AS NOTED			
34	AS NOTED			
35	AS NOTED			
36	AS NOTED			
37	AS NOTED			
38	AS NOTED			
39	AS NOTED			
40	AS NOTED			
41	AS NOTED			
42	AS NOTED			
43	AS NOTED			
44	AS NOTED			
45	AS NOTED			
46	AS NOTED			
47	AS NOTED			
48	AS NOTED			
49	AS NOTED			
50	AS NOTED			
51	AS NOTED			
52	AS NOTED			
53	AS NOTED			
54	AS NOTED			
55	AS NOTED			
56	AS NOTED			
57	AS NOTED			
58	AS NOTED			
59	AS NOTED			
60	AS NOTED			
61	AS NOTED			
62	AS NOTED			
63	AS NOTED			
64	AS NOTED			
65	AS NOTED			
66	AS NOTED			
67	AS NOTED			
68	AS NOTED			
69	AS NOTED			
70	AS NOTED			
71	AS NOTED			
72	AS NOTED			
73	AS NOTED			
74	AS NOTED			
75	AS NOTED			
76	AS NOTED			
77	AS NOTED			
78	AS NOTED			
79	AS NOTED			
80	AS NOTED			
81	AS NOTED			
82	AS NOTED			
83	AS NOTED			
84	AS NOTED			
85	AS NOTED			
86	AS NOTED			
87	AS NOTED			
88	AS NOTED			
89	AS NOTED			
90	AS NOTED			
91	AS NOTED			
92	AS NOTED			
93	AS NOTED			
94	AS NOTED			
95	AS NOTED			
96	AS NOTED			
97	AS NOTED			
98	AS NOTED			
99	AS NOTED			
100	AS NOTED			