

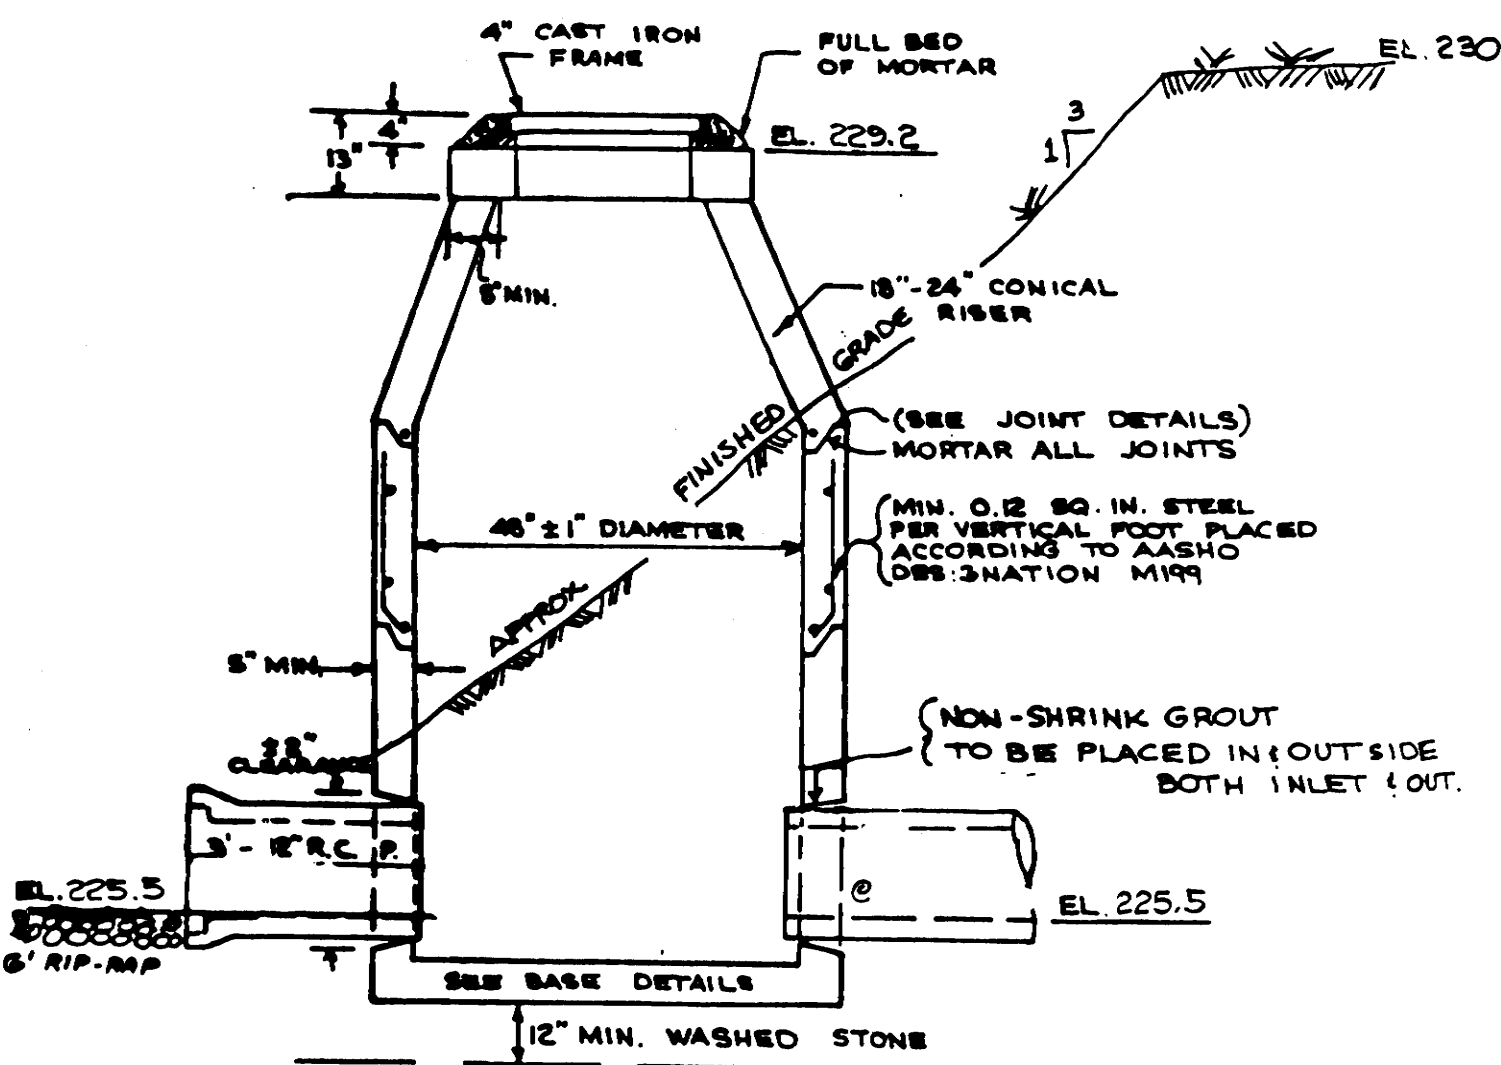
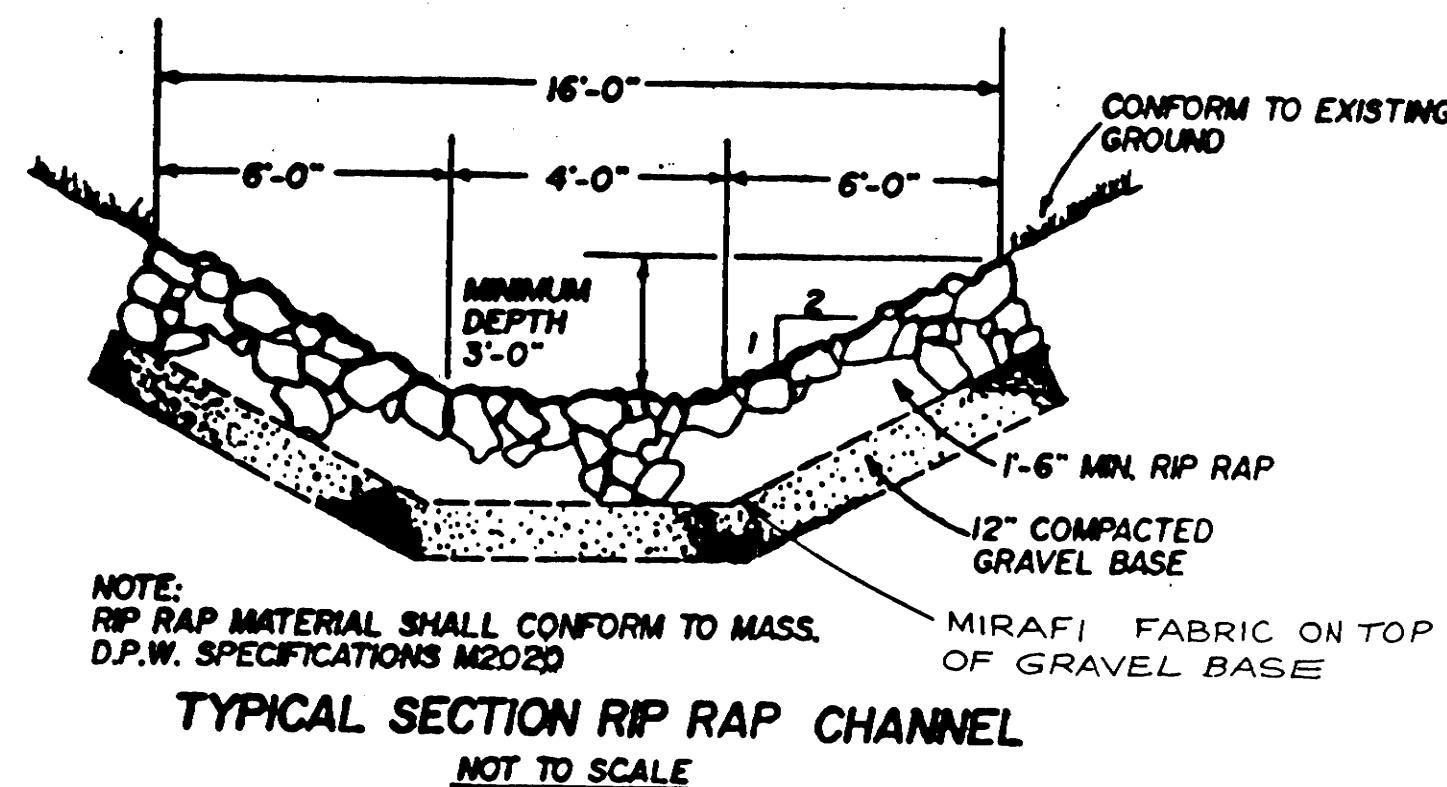
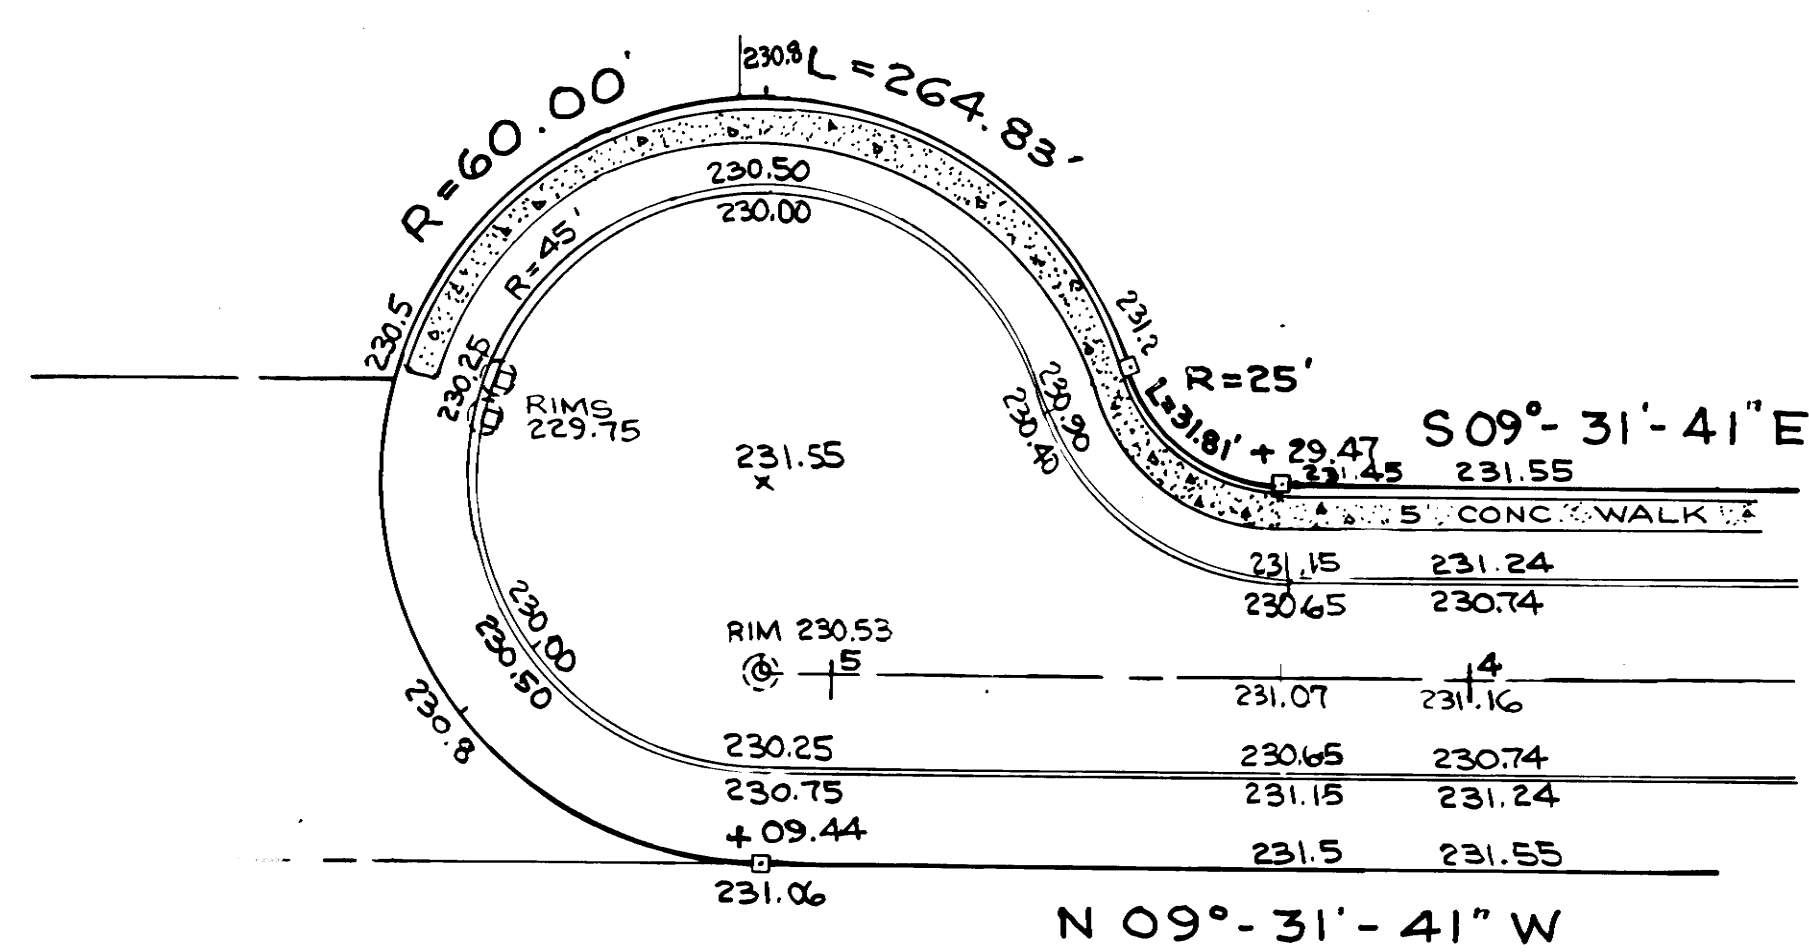
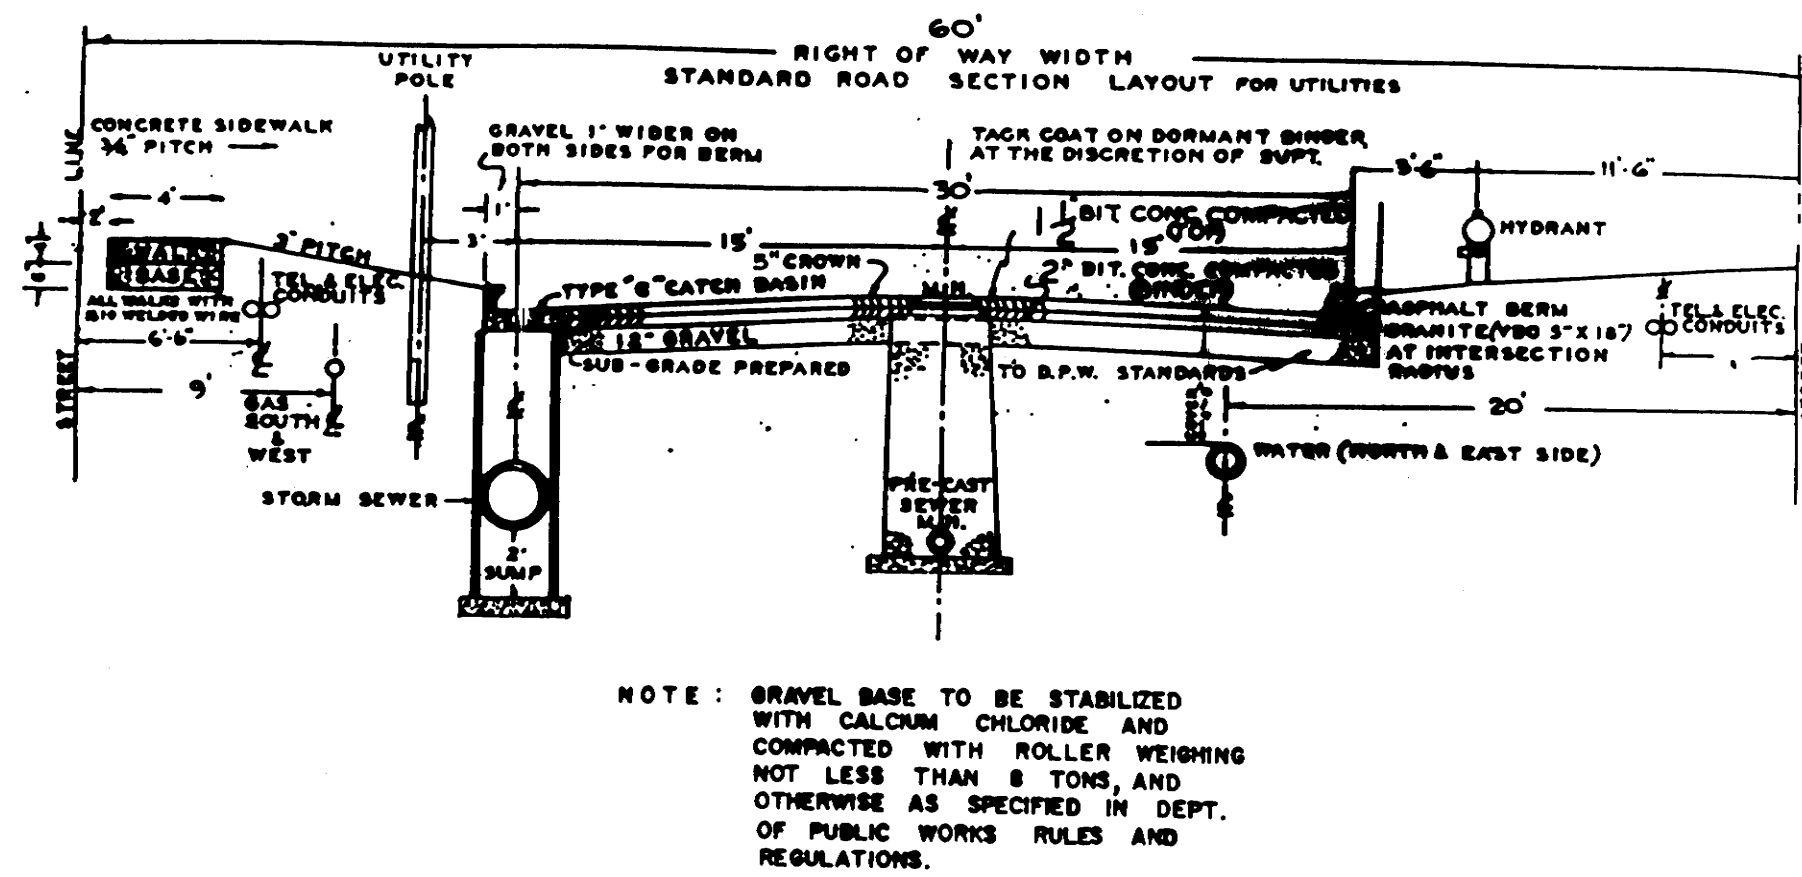
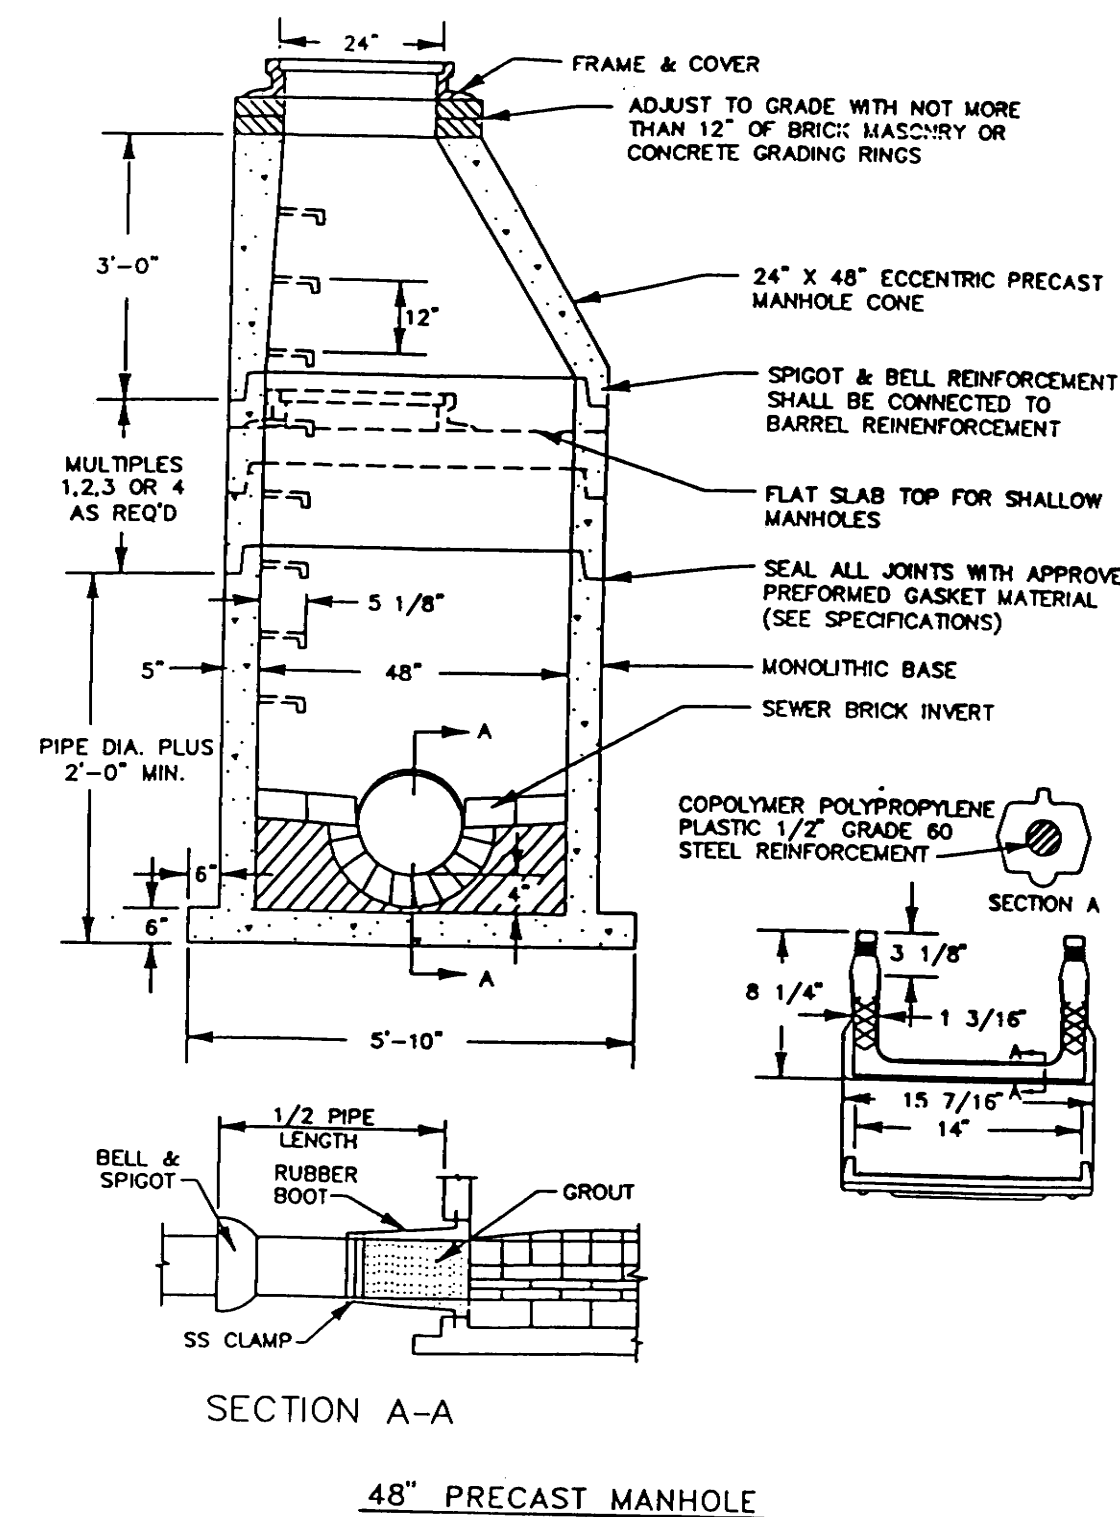


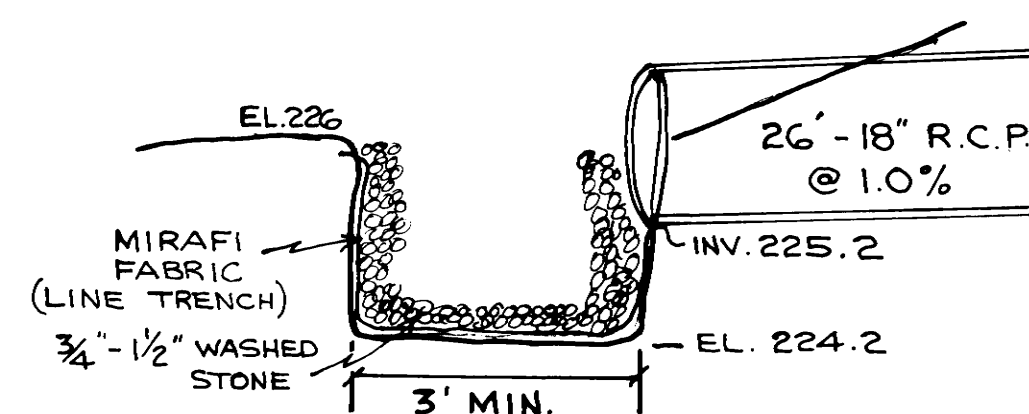


NOTE
ALL MATERIALS AND CONSTRUCTION METHODS TO COMPLY WITH THE STANDARD OF THE BOARD OF PUBLIC WORKS OF EAST LONGMEADOW.

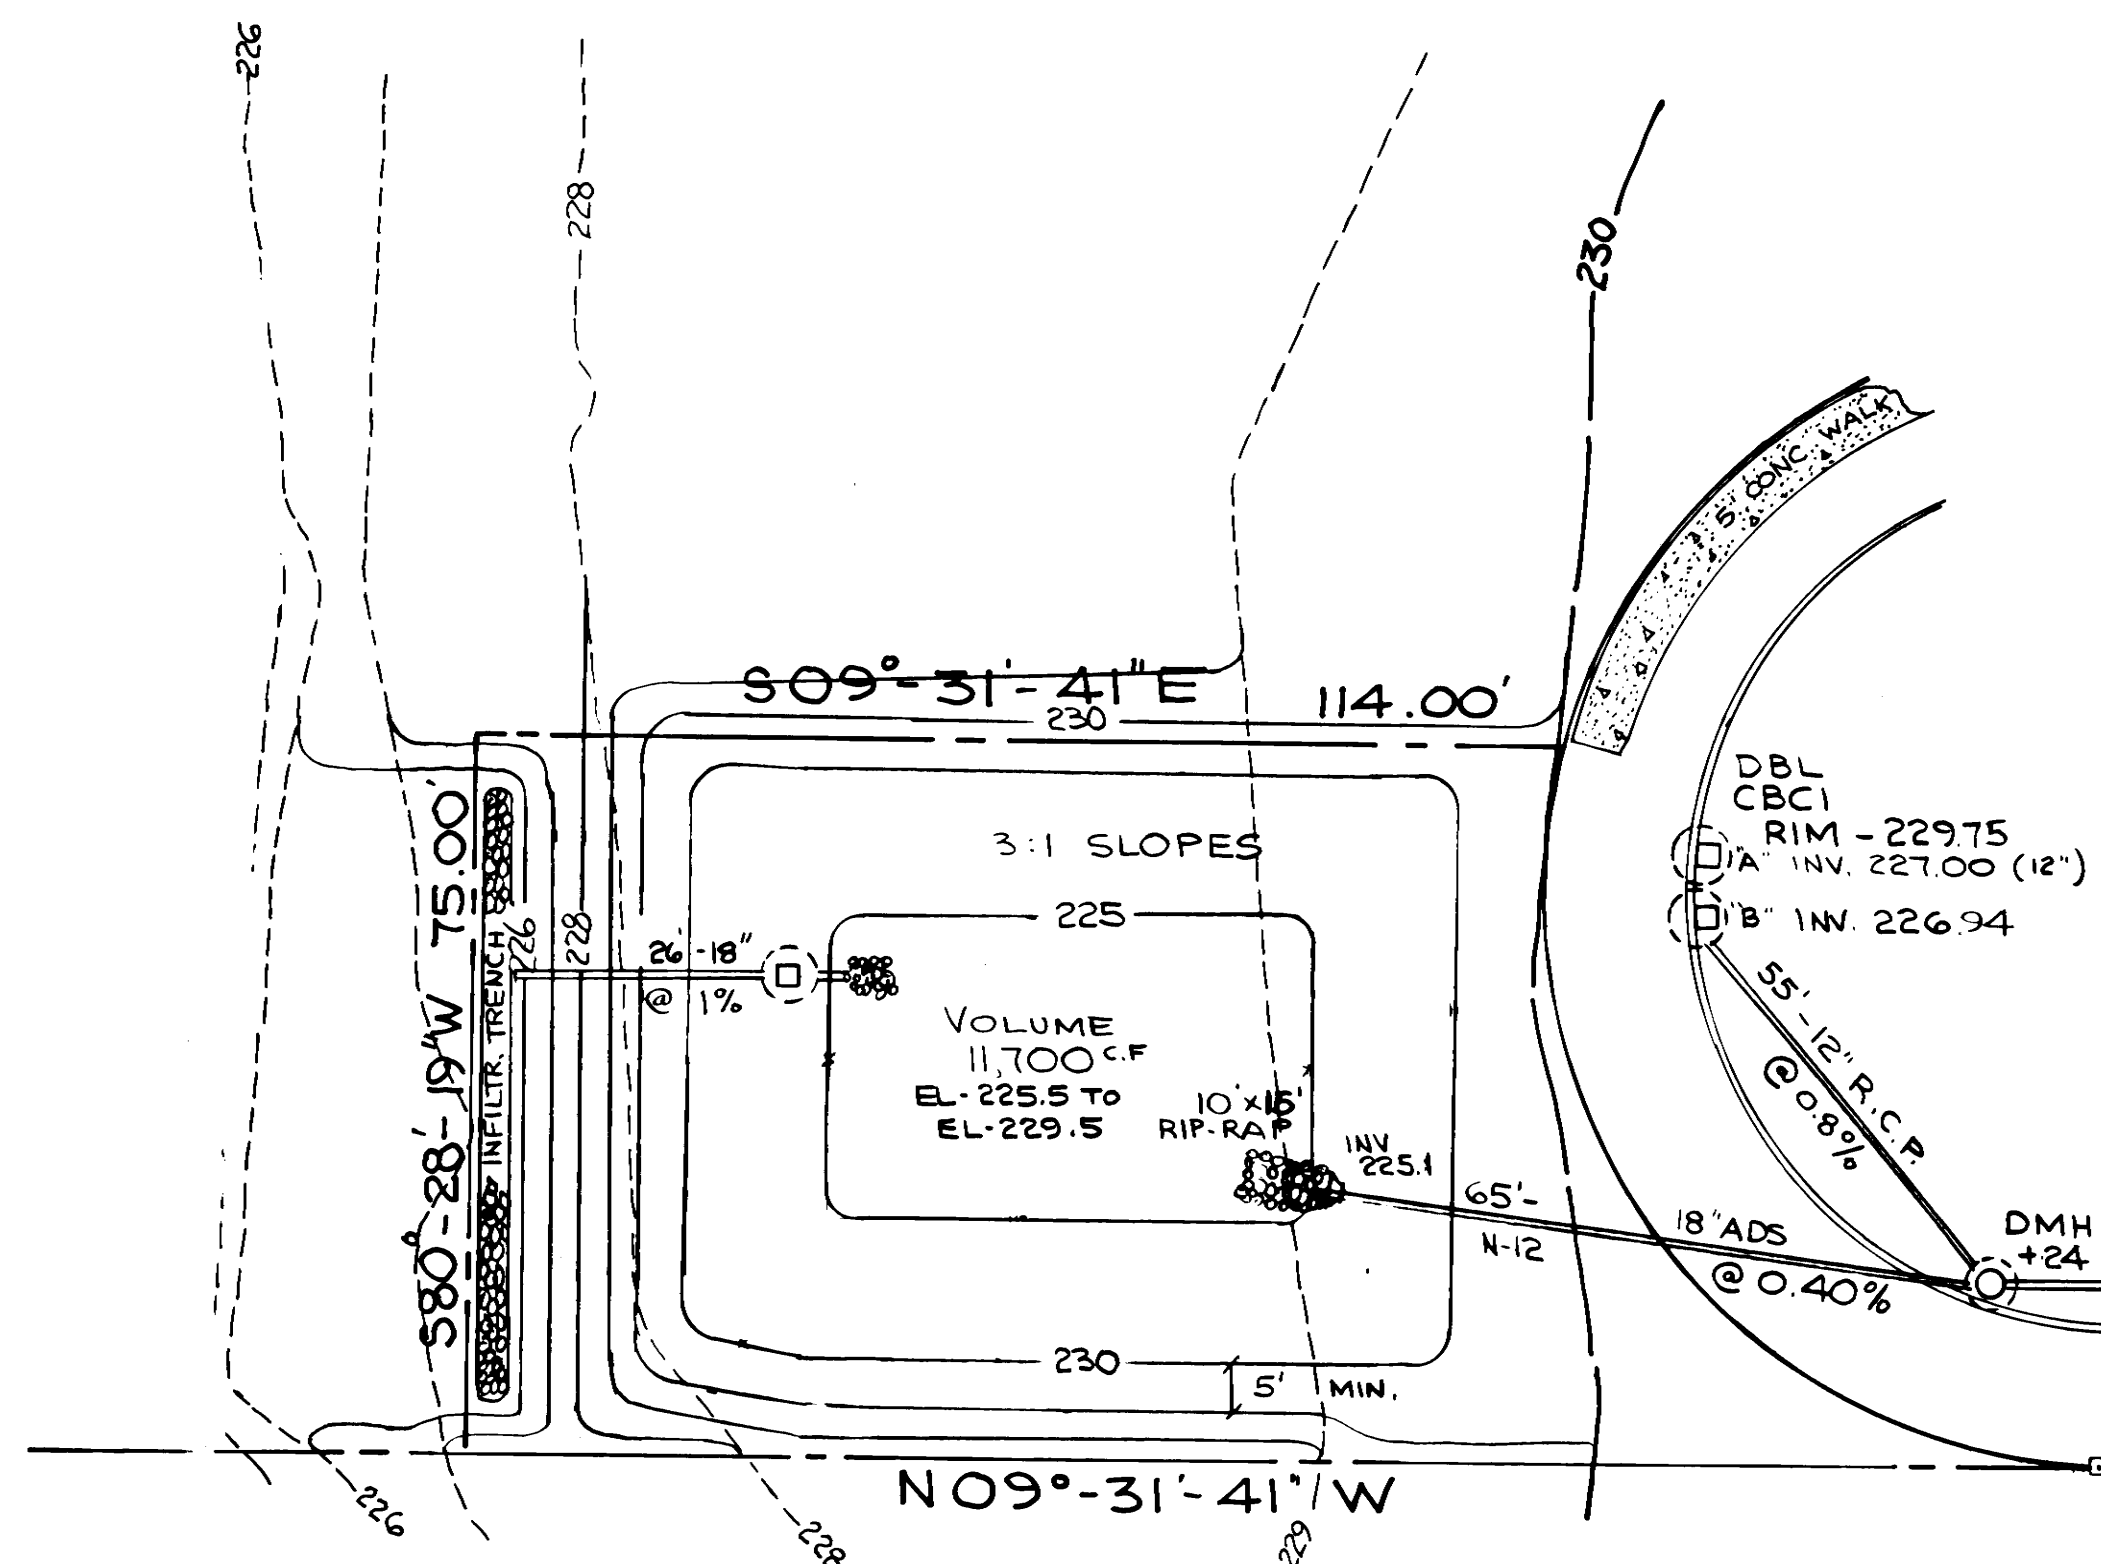

EROSION CONTROL SPECIFICATIONS

- All work in the buffer zone shall be performed under the supervision of an environmental professional and/or project engineer.
 - All hay-bale and/or silt fence erosion and sedimentation checks shall be placed prior to beginning work as per the plan.
 - All soils disturbed during construction shall be restored to grade, seeded and mulched with hay or straw until growth is established.
 - No station shall be allowed in the site wetlands and no erosion of the bank edge shall be allowed under any circumstances.
 - Whenever hay-bale or silt fence filters are used, they shall be maintained in good working condition until ground cover is reestablished.
 - The downhill toe-of-slope of all the stockpiled soils shall be protected by staked hay bales or silt fence.
 - No stockpiling of soils shall be in wetland areas or within 100' of wetlands shown.
 - Soil stockpiles shall be shaped and seeded with temporary cover as per seeding specifications or mulched if grading is to be delayed over winter.
- If any questions arise regarding erosion and sedimentation control measures, the environmental professional and/or project engineer shall be consulted immediately.

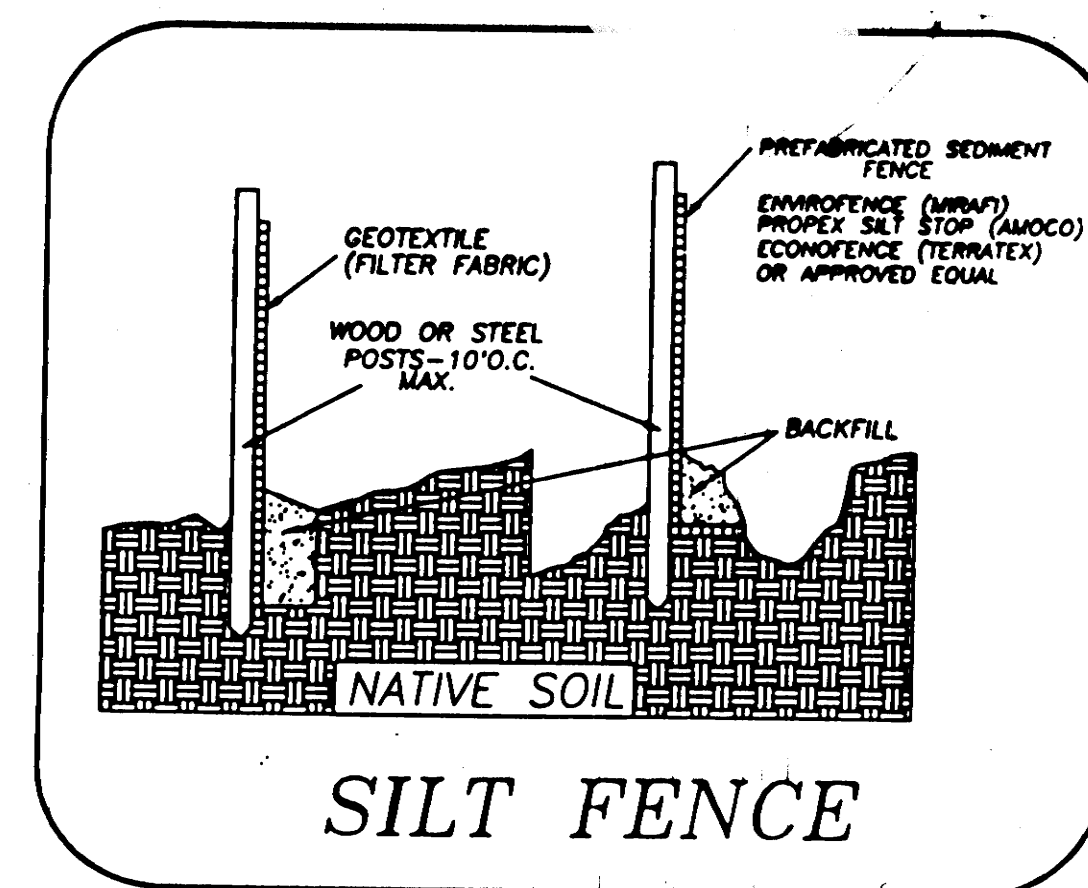

SILT FENCE SPECIFICATIONS

- Installation Requirements**
- This sediment barrier utilizes burlap or standard strength or extra strength synthetic filter fabric. It is designed for situations in which only short or overlaid flows are expected. In special cases burlap may be used in drainage areas.
- The height of the barrier shall not exceed 36 inches (higher barriers may impose volumes of water sufficient to cause failure of the structure). Ideally the filter fence shall be placed 10 feet away from the toe-of-slope.
 - When joints are necessary, filter cloth shall be applied together only at a support post, with a minimum 6-inch overlap, and securely sealed. See manufacturer's recommendations.
 - Posts shall be spaced a maximum of 10 feet apart at the barrier location and driven securely into the ground (minimum of 12 inches). When extra strength fabric is used without the wire support fence, post spacing shall be as per manufacturer's recommendations.
 - A trench shall be excavated approximately 6 inches wide and 6 inches deep along the line of posts and upslope from the barrier in accordance with manufacturer's recommendations.
 - When standard strength filter fabric is used, a wire mesh support fence shall be fastened securely to the upslope side of the posts using heavy duty wire staples at least 1 inch long, at every 6 feet. The wire shall extend into the trench a minimum of 2 inches and shall extend more than 36 inches above the original ground surface.
 - The standard strength filter fabric shall be stapled, wired or tied to the wire fence, and 8 inches of the fabric shall not exceed into the trench. The fabric shall not extend more than 36 inches above the original ground surface.
 - When extra strength filter fabric or burlap and closer post spacing are used, the wire mesh support fence may be eliminated.
 - In such a case, the filter fabric is stapled, wired or tied directly to the posts with all other provision of item (1) applying.
 - The trench shall be backfilled and the soil compacted over the filter fabric.
 - Filter barriers shall be removed when they have served their useful purpose, but not before the upslope area has been permanently stabilized.
- Maintenance**
- Filter barriers shall be inspected immediately after each rainfall and at least daily during prolonged rainfall. Any required repairs shall be made immediately.
 - Should the fabric decompose or become ineffective prior to the end of the expected usable life and the barrier still be necessary, the fabric shall be replaced promptly.
 - Sediment deposits should be removed when they reach approximately one-half the height of the barrier.
 - Any sediment deposits remaining in place after the silt fence or filter barrier is no longer required shall be dressed to conform to the existing grade, prepared and seeded.

SPECIFICATIONS
SKYLINE DRIVE
EAST LONGMEADOW, MA.
FOR
PAUL J. SEARS


SHEET-5

ECOTEC ENVIRONMENTAL ASSOCIATES INC.

180 DENLOW ROAD
P.O. BOX 168
EAST LONGMEADOW, MA 01028

PHONE (413) 525-6703 FAX (413) 525-3582

SCALE	AS NOTED	DATE	NOV. 1999
DRAWN BY	G.W.	TRACED BY	G.W.
SURVEY BOOK NO.		PROJECT NO.	
		FILE NO.	

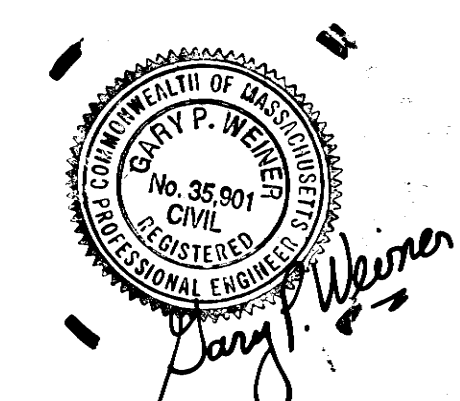

REVISED 3/23/00

APPROVED BY THE EAST LONGMEADOW PLANNING BOARD
DATE: 3/28/00
CHAIRMAN