NOTE:
ALL HOUSES TO BE RECONNECTED TO NEW MAIN. EXISTING PIPE TO BE DROPPED FROM SERVICE.

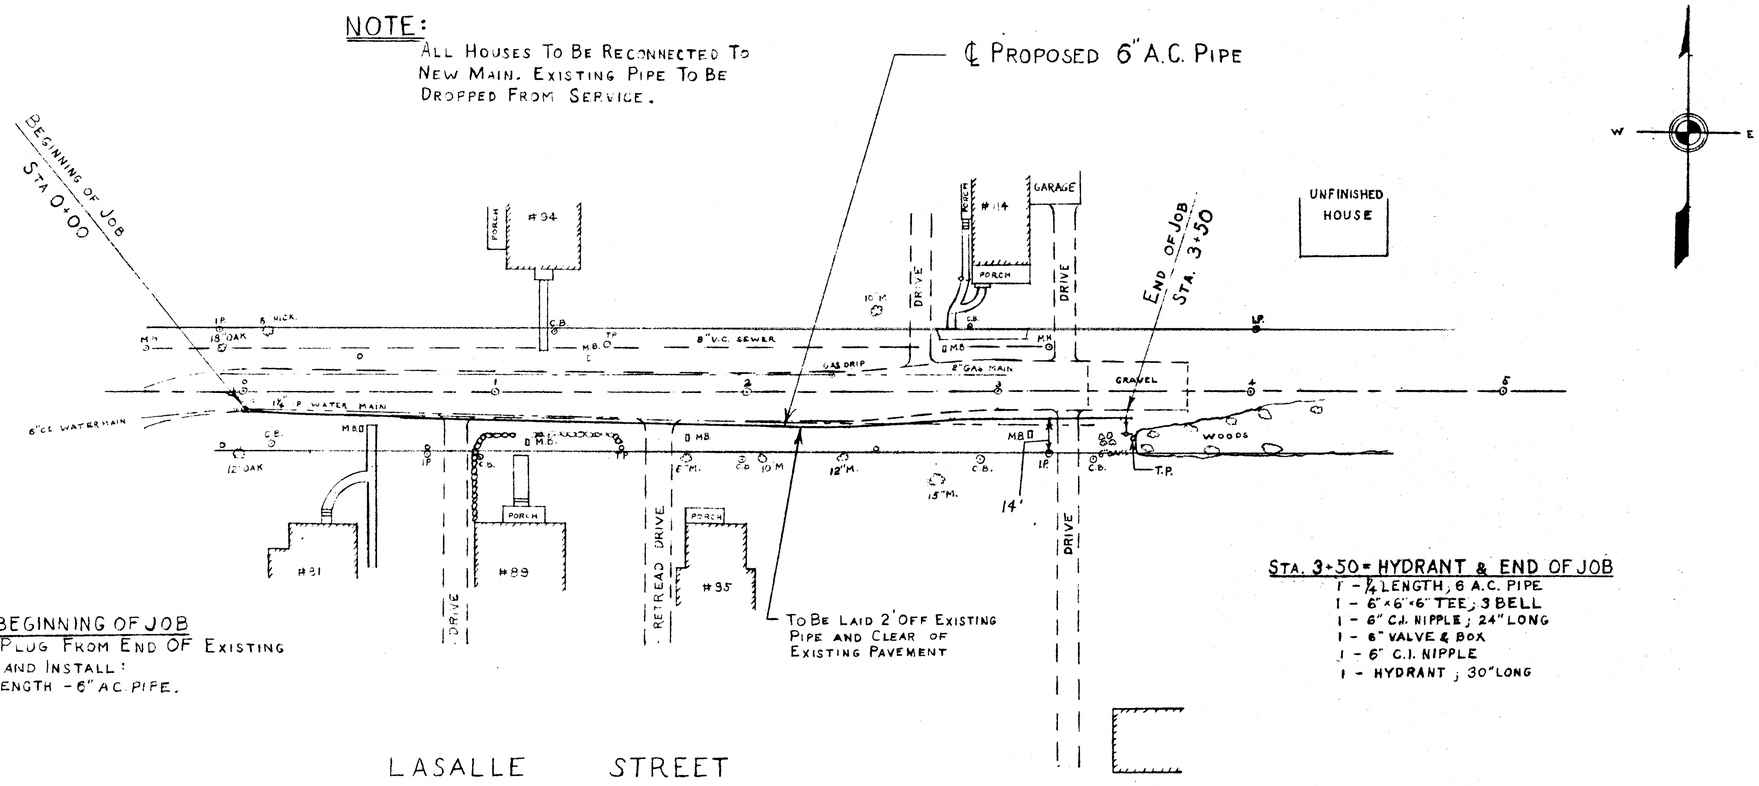

STA. 0+00 BEGINNING OF JOB
REMOVE PLUG FROM END OF EXISTING 6" MAIN AND INSTALL:
1 - ¼ LENGTH - 6" AC PIPE.

STA. 3+50 = HYDRANT & END OF JOB
1 - ¼ LENGTH, 6 A.C. PIPE
1 - 6"×6"×6" TEE; 3 BELL
1 - 6" C.I. NIPPLE; 24" LONG
1 - 6" VALVE & BOX
1 - 6" C.I. NIPPLE
1 - HYDRANT; 30" LONG

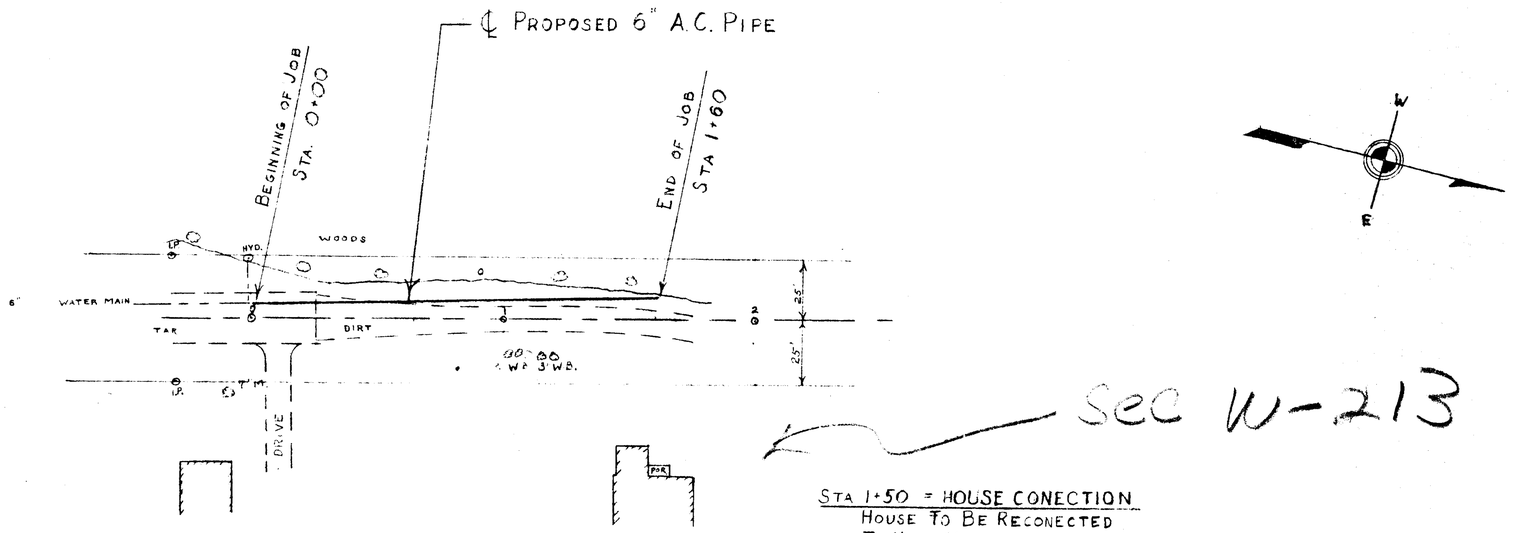

See W-213

STA 1+50 = HOUSE CONECTION
HOUSE TO BE RECONECTED TO NEW MAIN.

STA. 0+00 BEGINNING OF JOB
CONTRACTOR TO REMOVE EXISTING PLUG AND INSTALL:
1 - ¼ LENGTH - 8" A.C. PIPE

STA 1+60 = END OF JOB
1 - ¼ LENGTH - 6" A.C. PIPE
1 - 6" CAP

LA SALLE ST. & THOMPKINS AVE.

PROPOSED WATER MAINS FOR 1951
BOARD OF WATER COMMISSIONERS
TOWN OF EAST LONGMEADOW, MASS.

TIGHE & BOND, CONSULTING ENGINEERS.
HOLYOKE, MASS

SCALE: HORZ. 1" = 40'
VERT.

MARCH, 1951