



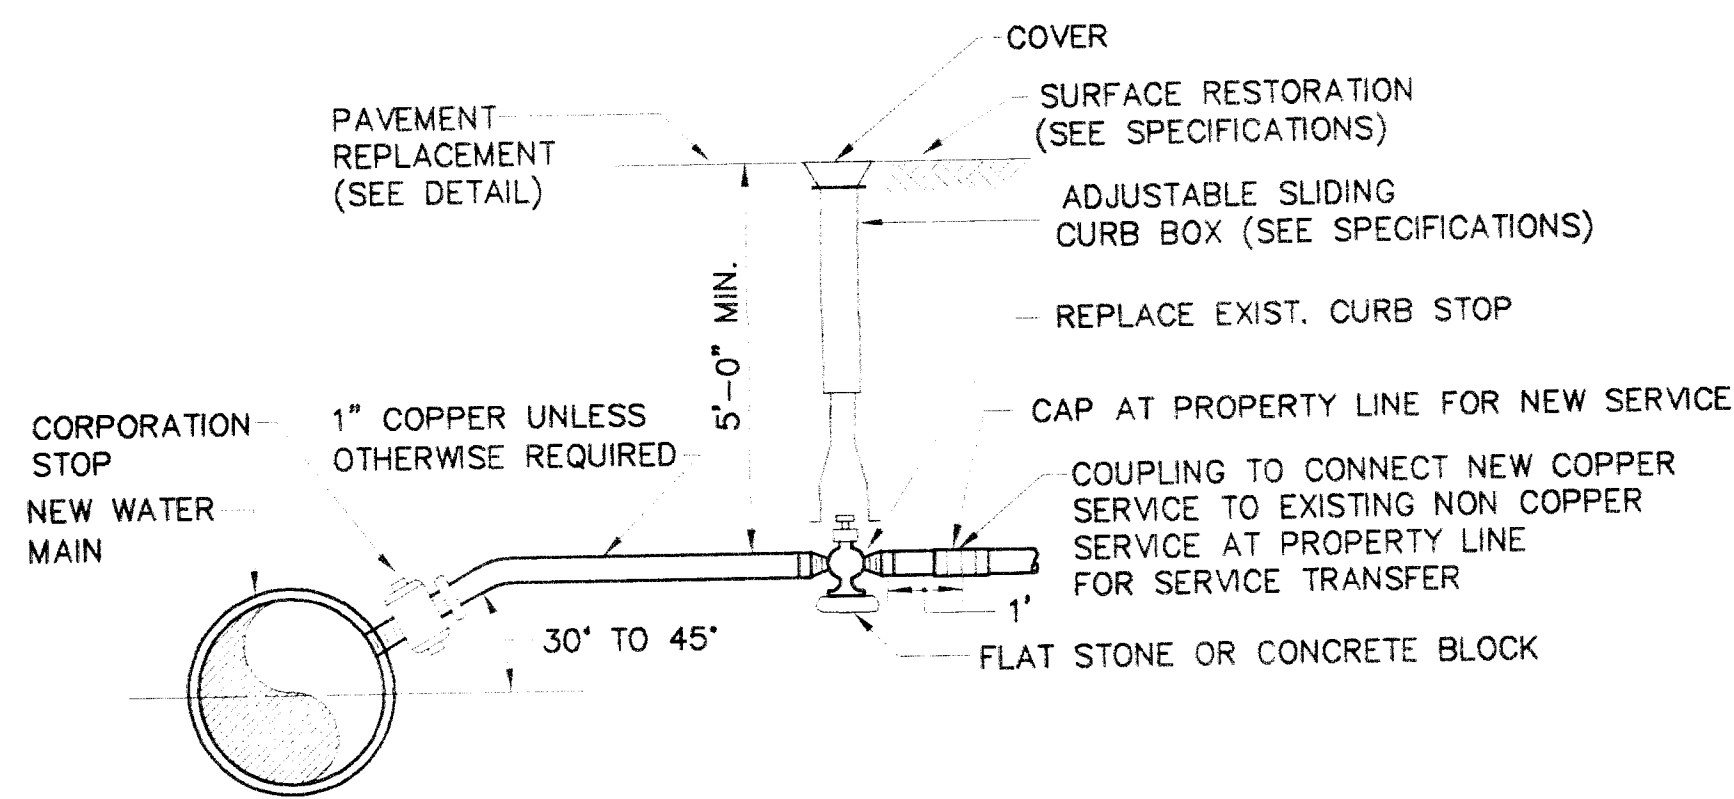

NOTE: PROVIDE SADDLE FOR ALL AC AND PVC MAINS AND ALL 2" OR LARGER STOPS

WATER SERVICE DETAIL

N.T.S.

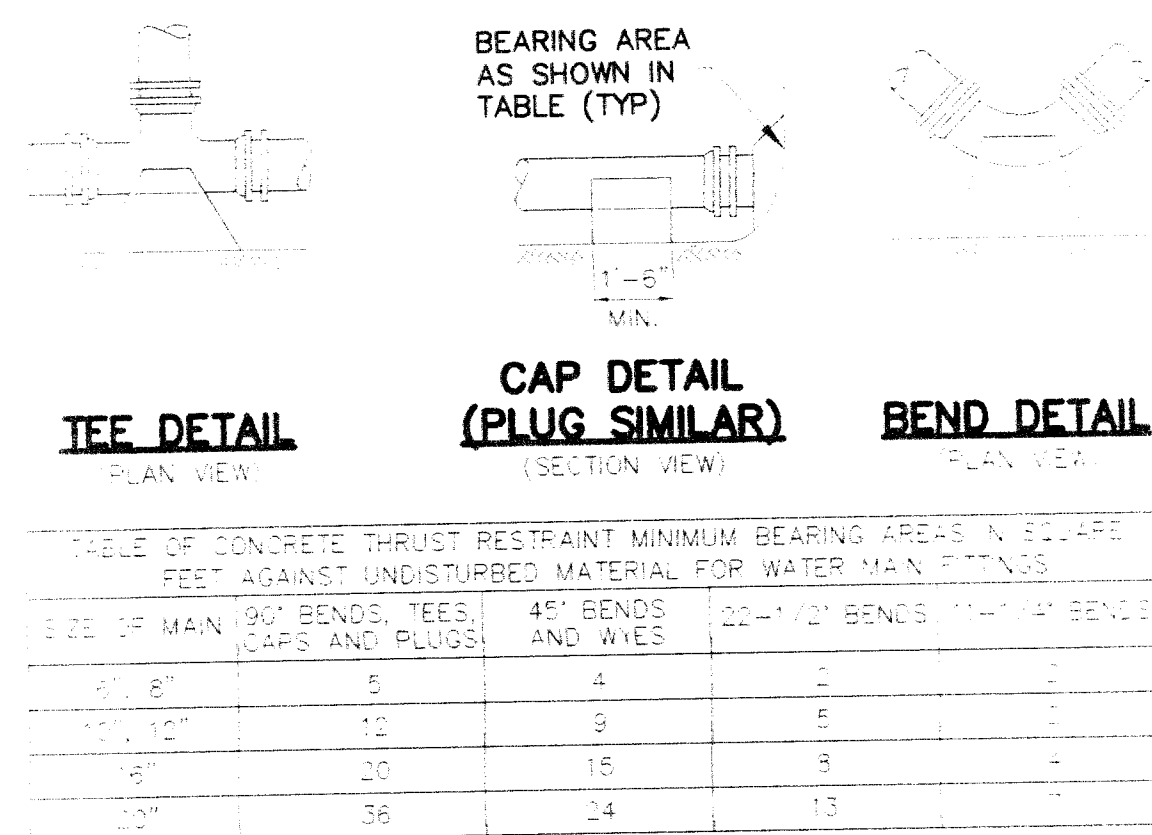

CONCRETE THRUST RESTRAINT FOR FITTINGS

N.T.S.


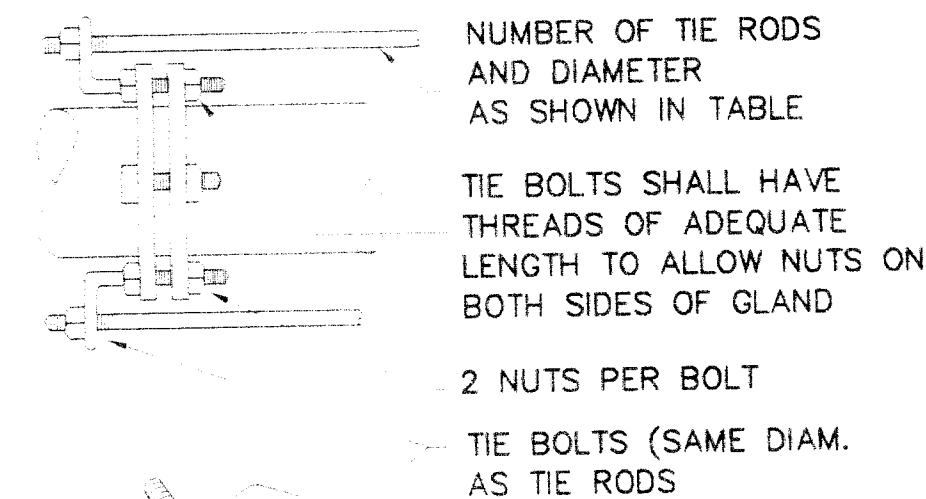


TABLE OF TIE RODS

PIPE SIZE	TIE ROD NO. DIA.
6"	2 1/2"
8"	2 5/8"
10"	2 3/4"
12"	4 3/4"
16"	6 3/4"
20"	10 3/4"


JOINT RESTRAINT DETAIL

N.T.S.

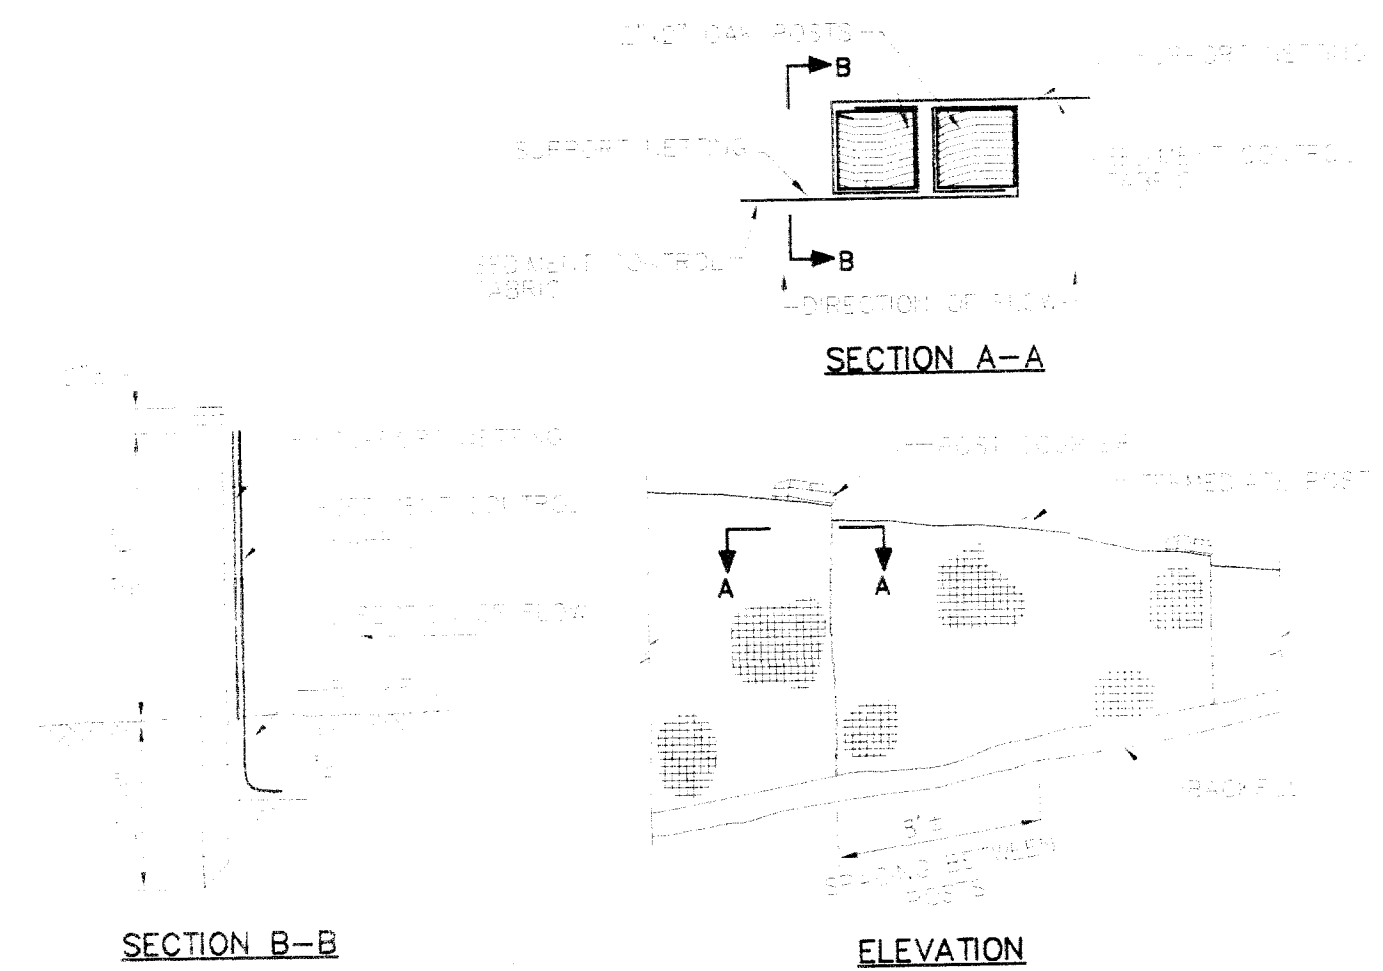


SILT FENCE DETAIL

N.T.S.

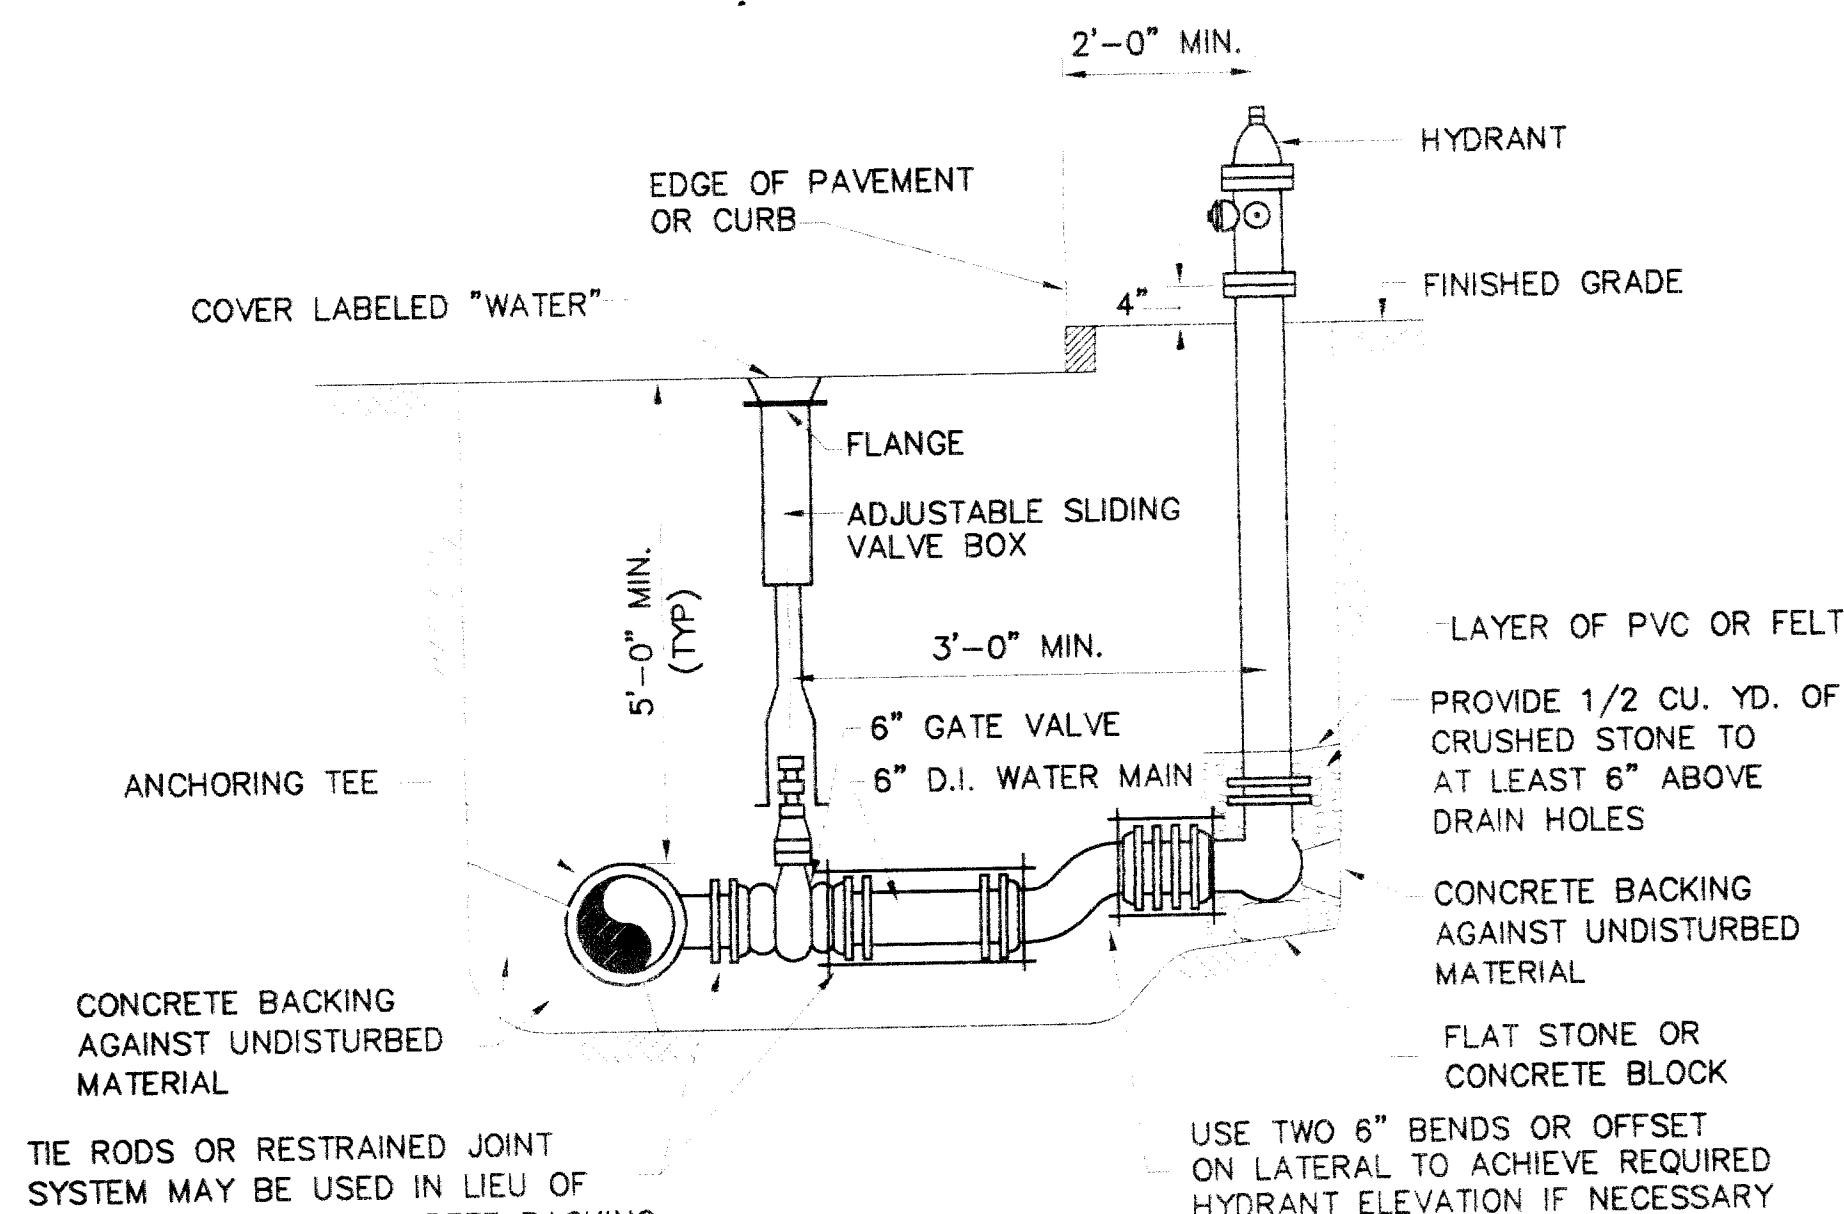


HYDRANT AND VALVE DETAIL

N.T.S.

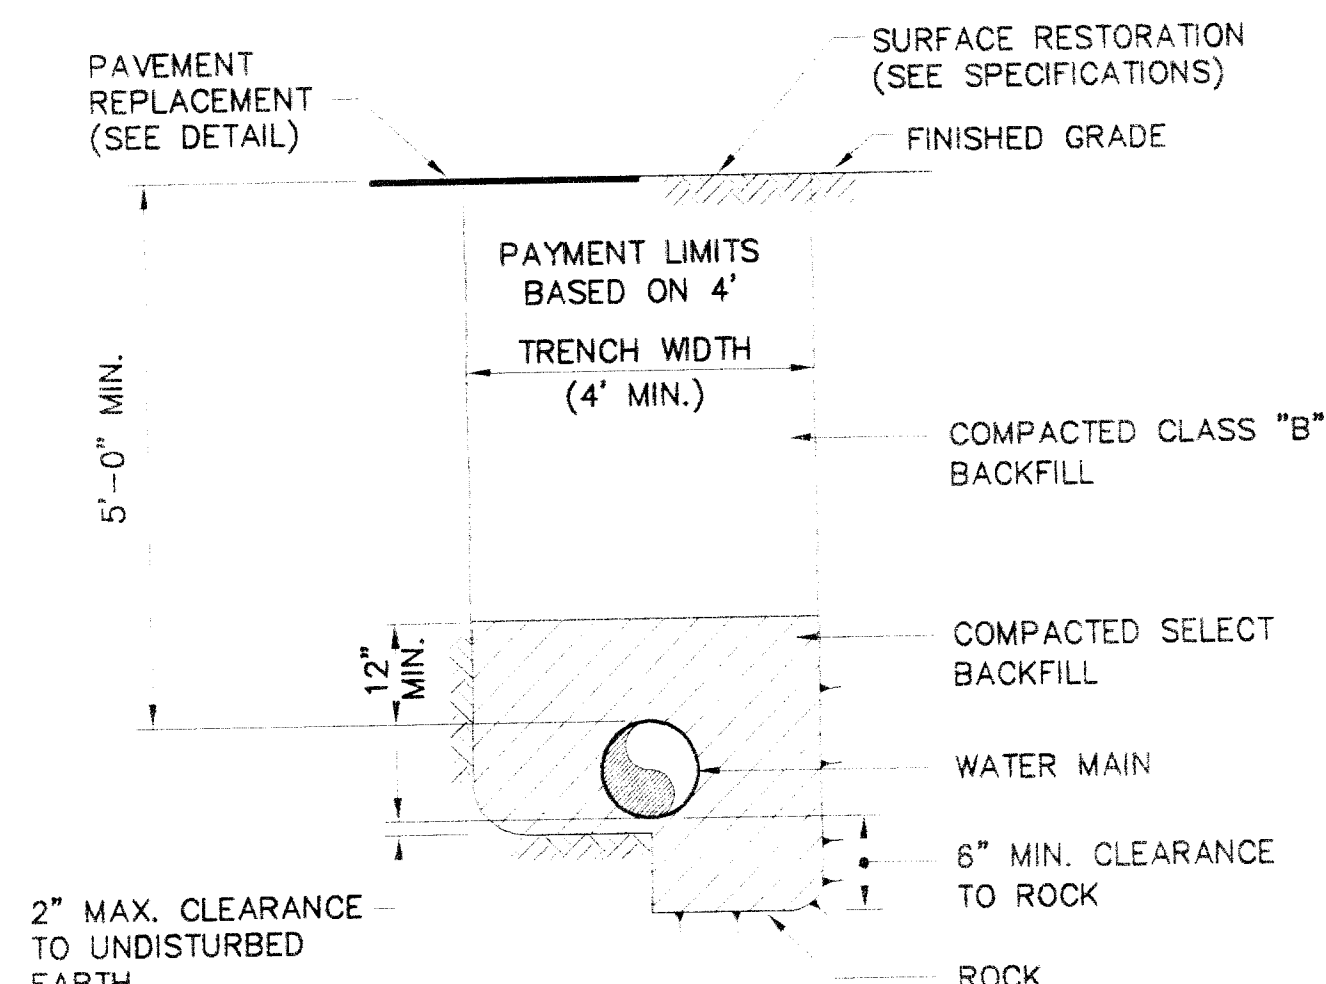


WATER MAIN TRENCH DETAIL

N.T.S.

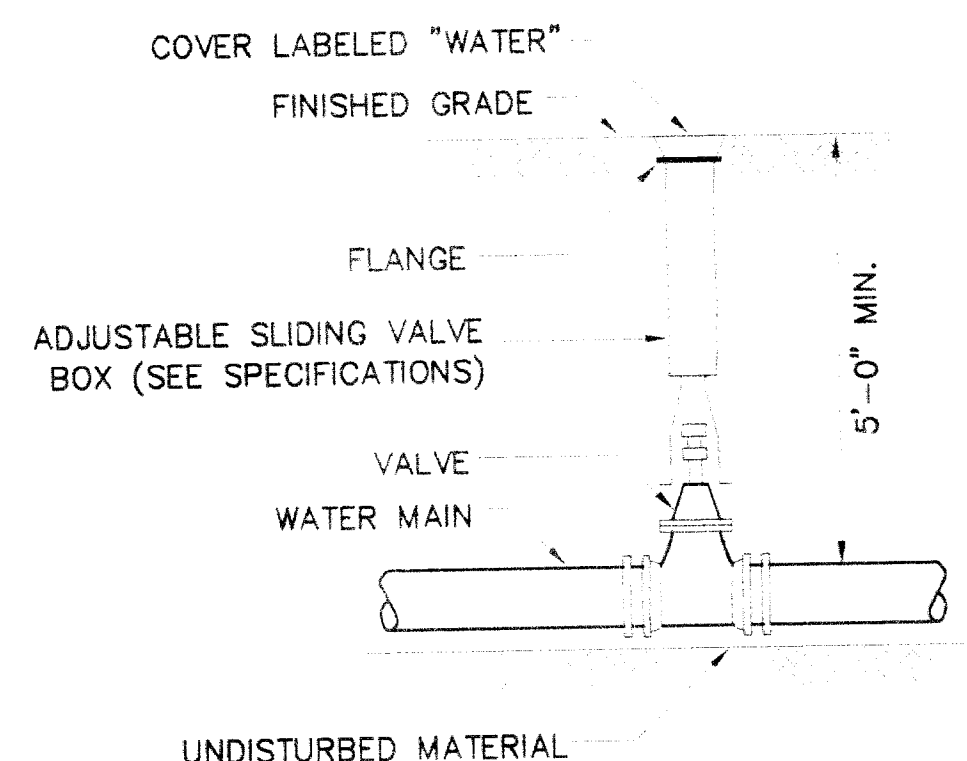


VALVE AND BOX DETAIL

N.T.S.

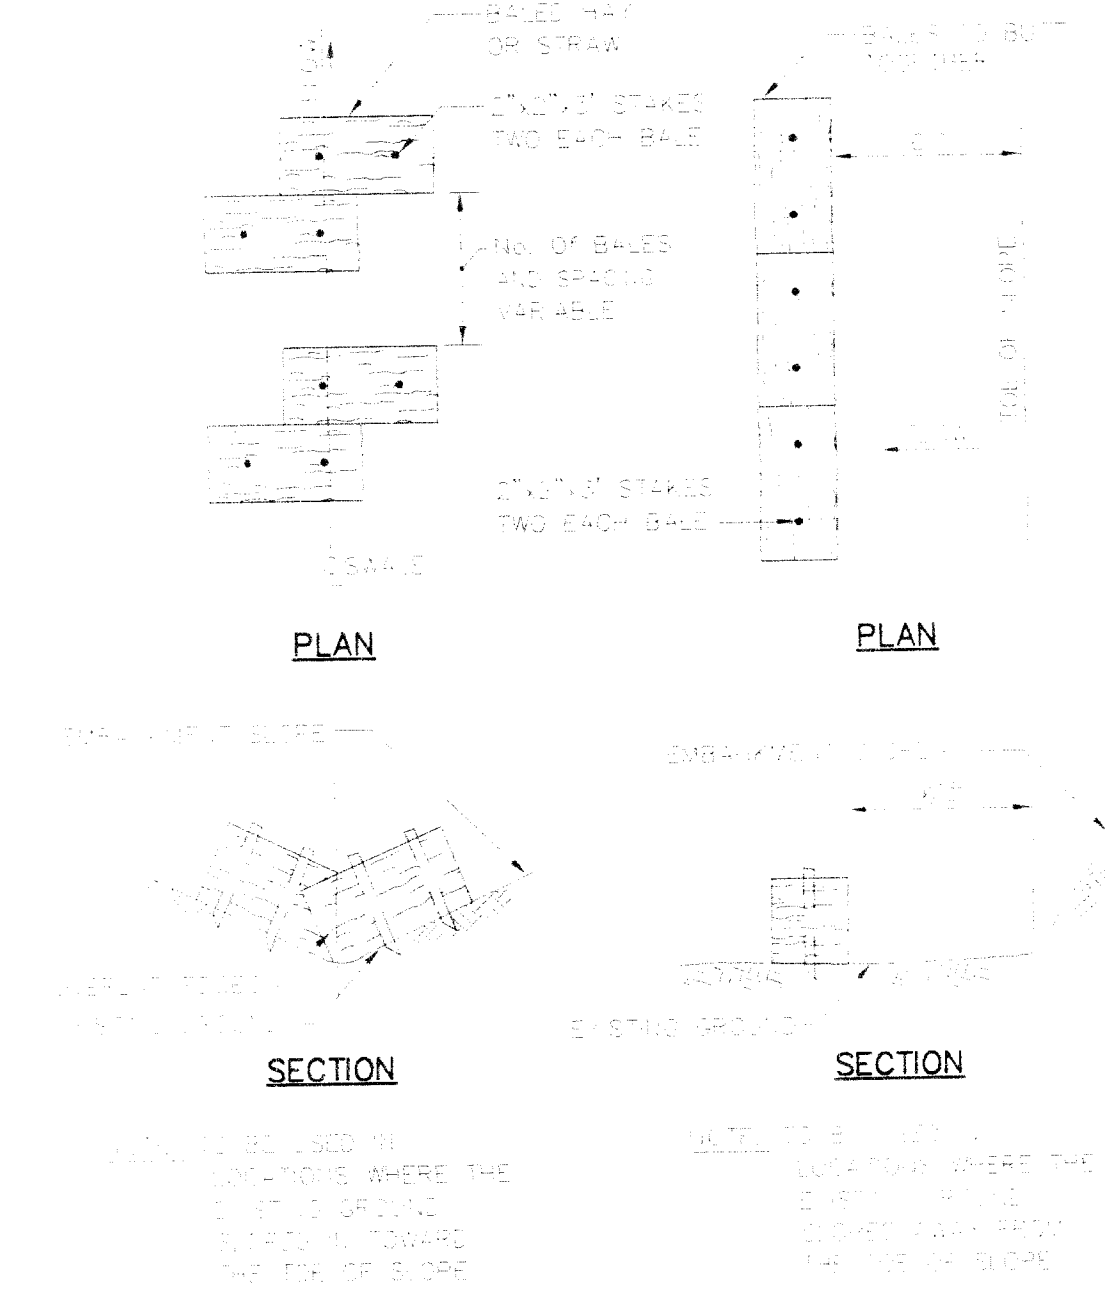

HAY BALES DETAIL


N.T.S.

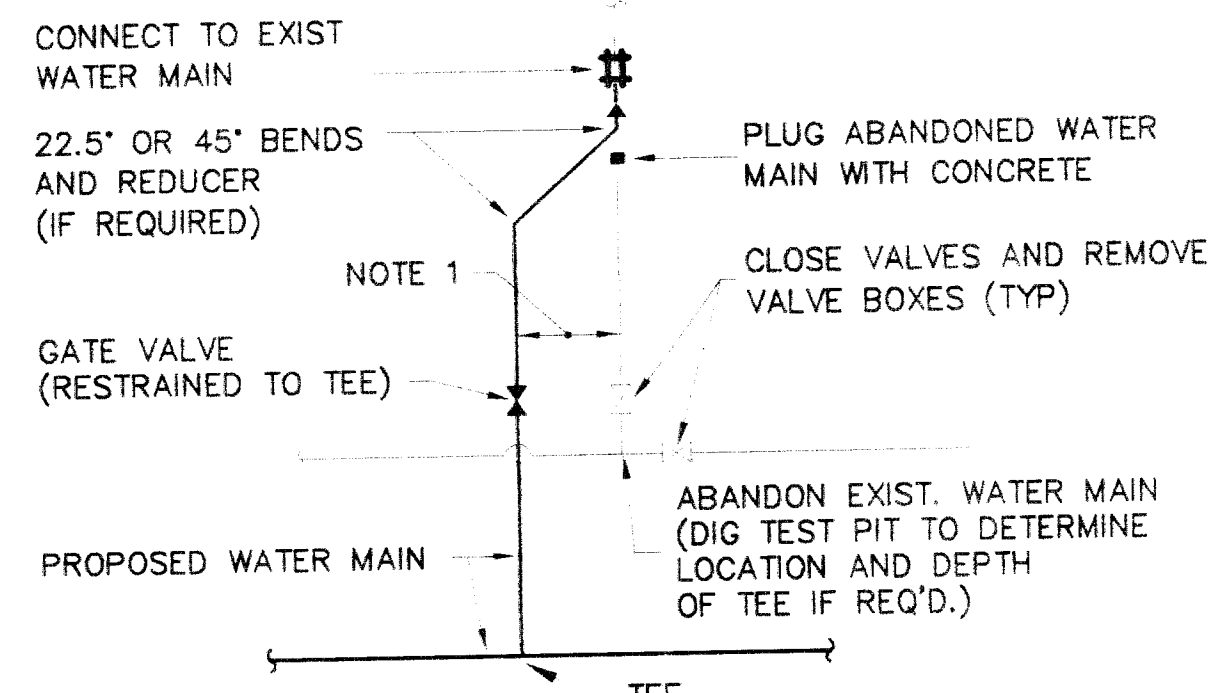

NOTE 1: MINIMUM PRACTICAL DISTANCE - GENERALLY NO MORE THAN 5 FT.


WATER MAIN LATERAL CONNECTION

N.T.S.

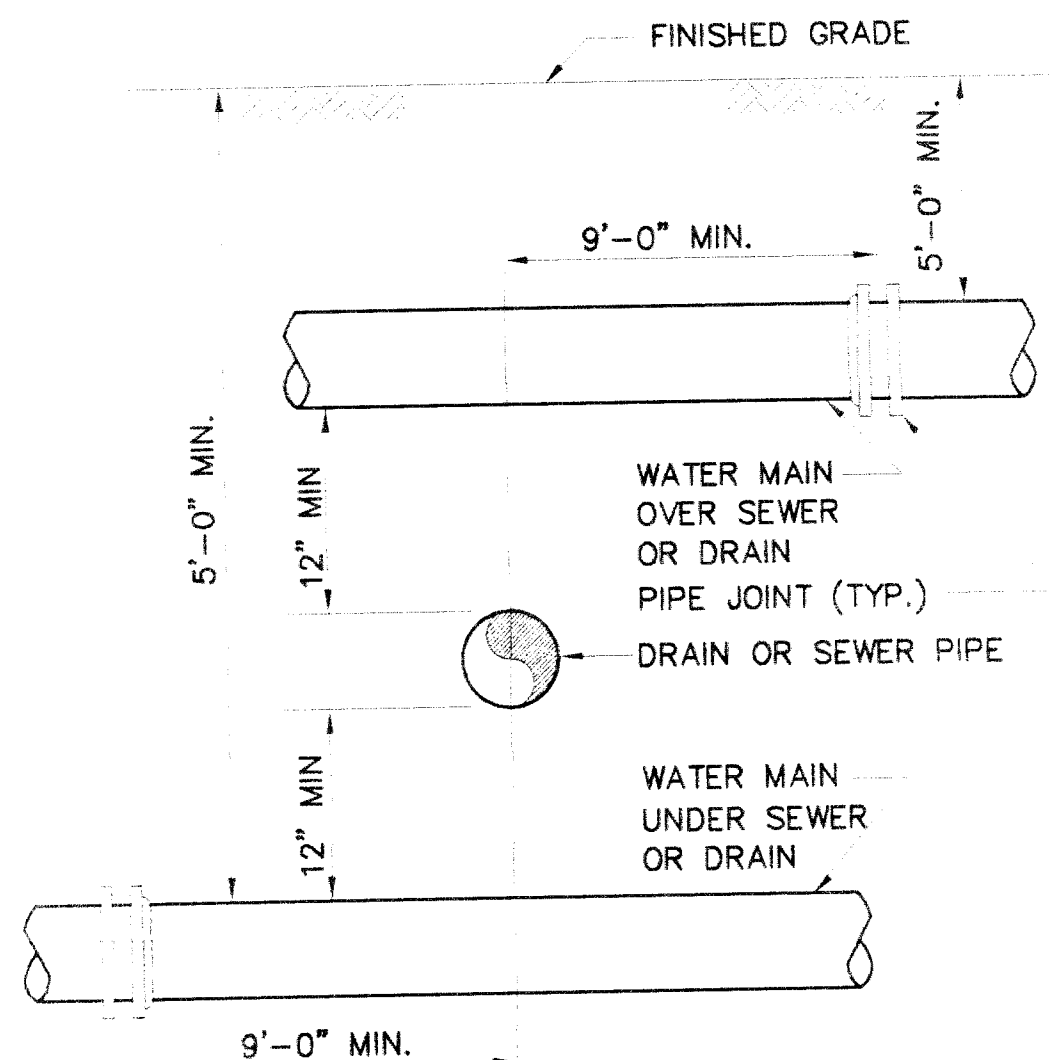


SEWER OR DRAIN CROSSING DETAIL

N.T.S.

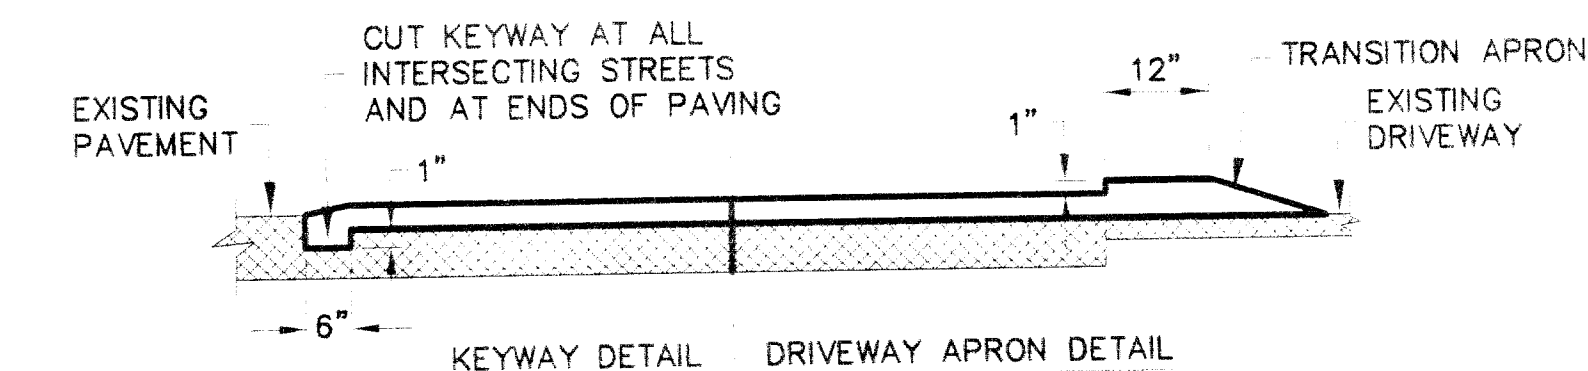


KEYWAY AND DRIVEWAY APRON DETAIL

N.T.S.

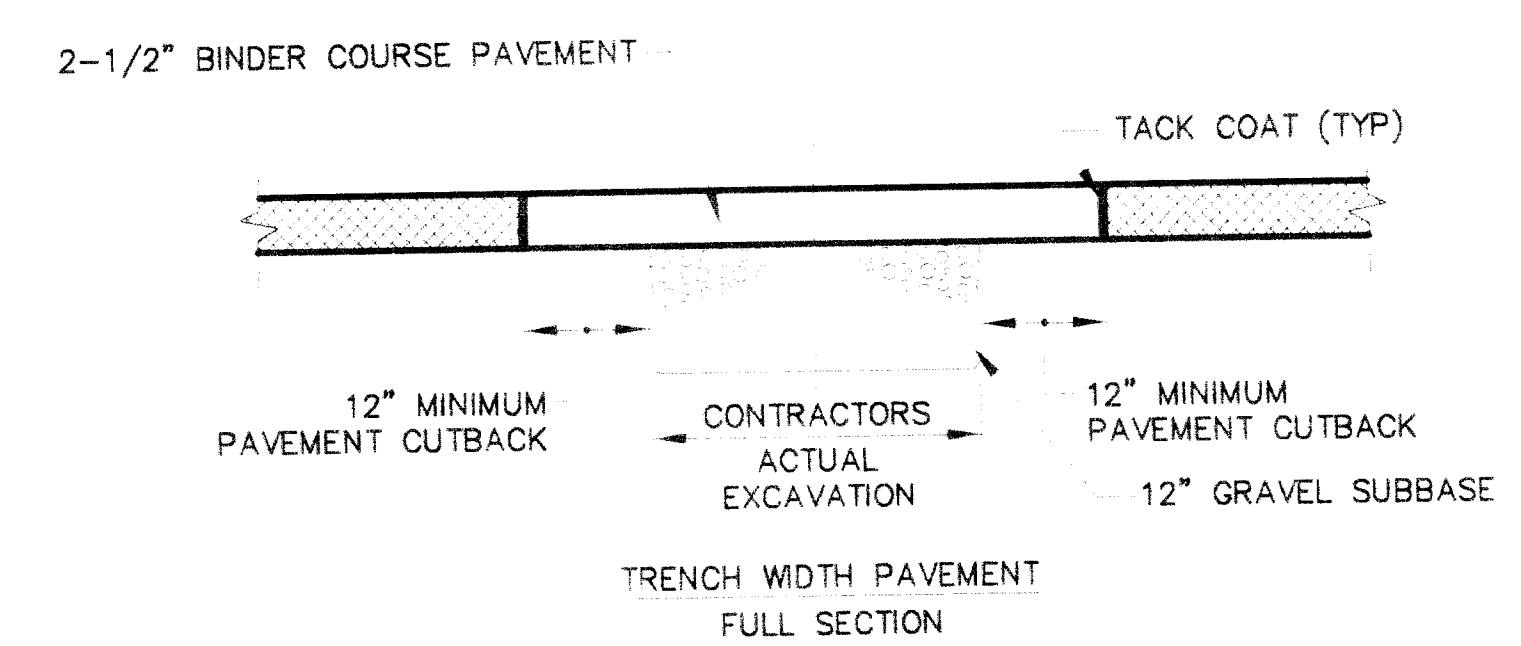

TEMPORARY PAVEMENT REPLACEMENT DETAILS

N.T.S.

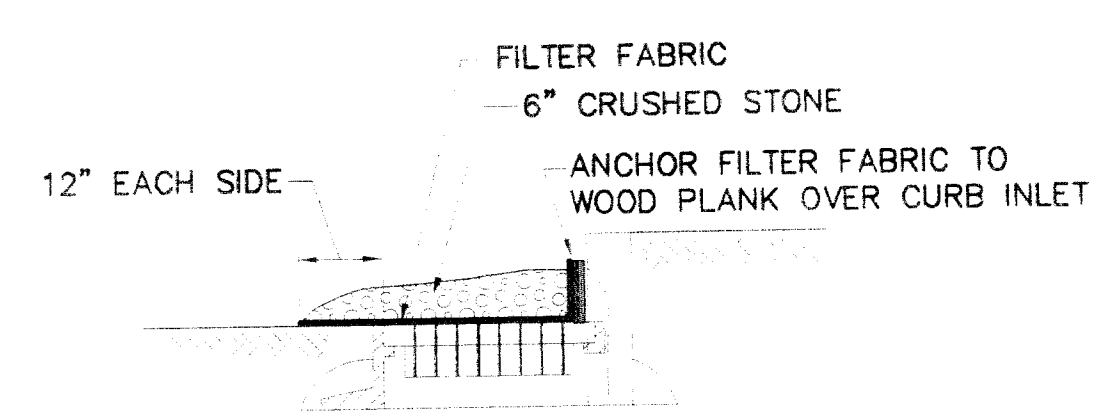

CATCH BASIN INLET PROTECTION DETAIL

N.T.S.