362-368 Parker Street Parcel IDs: 75-IO-IA,75-IIO,63-26-0 and 62-3I-A+B East Longmeadow, MA.

SUBDIVISION REVIEW			
TYPE	MAXIMUM	PROPOSED	
STREET LENGTH (SCARLETT DRIVE)	900 FT *	900 FT	
NUMBER OF LOTS	-	13	

* Proposed lengths measured from the property line at Parker Street to the end of the right-of-way

ZONING REVIEW - RESIDENCE A (RES-A)		
ТҮРЕ	REQUIRED	
AREA	25,000 FT ²	
FRONTAGE	140 FT*	
FRONT YARD	50 FT	
SIDE YARD	20 FT	
REAR YARD	50 FT	
HEIGHT (MAX)	35 FT	

* On the turning radius of a cul-de-sac, lot frontage may be considered as the distance between side lot lines measured at the setback line, provided that the distance measured on the street line shall be at least 75 percent of the minimum frontage required for the zone in which the lot is situated.

25%

LOT COVERAGE (MAX)

East Longmeadow Pl	anning Board
Action Taken	Date
Application Filed	
Preliminary Plan Filed	
Definitive Plan Filed	
Public Hearing	
Approval of Board of Health	
Plan Approved	
Plan Endorsed	
Names of Planning Board Me	embers


RLA Project Number: 230113

Definitive Subdivision Plan "OAKWOOD ESTATES"

AS PREPARED FOR

Bretta Construction, LLC c/o Mr. Thomas Bretta

32 Eastwood Drive Wilbraham, MA 01095

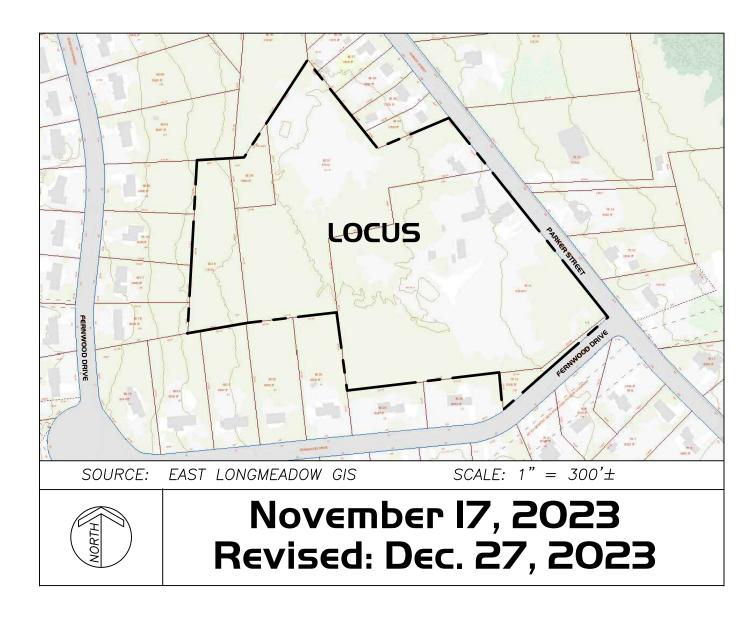



DRAWING INDEX				
SHEET NO.	SHEET NAME	ISSUE DATE	REVISION	REVISION DATE
T-1	TITLE SHEET	11/17/23	REV. A	12/27/23
EX-1	EXISTING CONDITIONS PLAN	11/17/23		
P-1	DEFINITIVE SUBDIVISION PLAN	11/17/23		
C-1	NOTES, SYMBOLS & LINE LEGEND AND ABBREVIATIONS	11/17/23		
C-2	CONSTRUCTION NOTES	11/17/23		
C-3	GRADING, EROSION & SEDIMENTATION CONTROL PLAN	11/17/23		
C-4	PLAN & PROFILE - Scarlett Drive - Sta -0+50 to Sta 9+50	11/17/23	REV. A	12/27/23
C-5	PLAN & PROFILE - Utility Easement - Sta 0+00 to Sta 6+15	11/17/23		
C-6	EXTENDED DRY DETENTION BASIN	11/17/23		
D-1	DETAILS	11/17/23	REV. A	12/27/23
D-2	DETAILS	11/17/23		
D-3	DETAILS	11/17/23		
D-4	DETAILS	11/17/23		



40 School Street · Westfield, MA · 01085 ph 413.568.0985 · fax 413.568.0986 www.rlaland.com



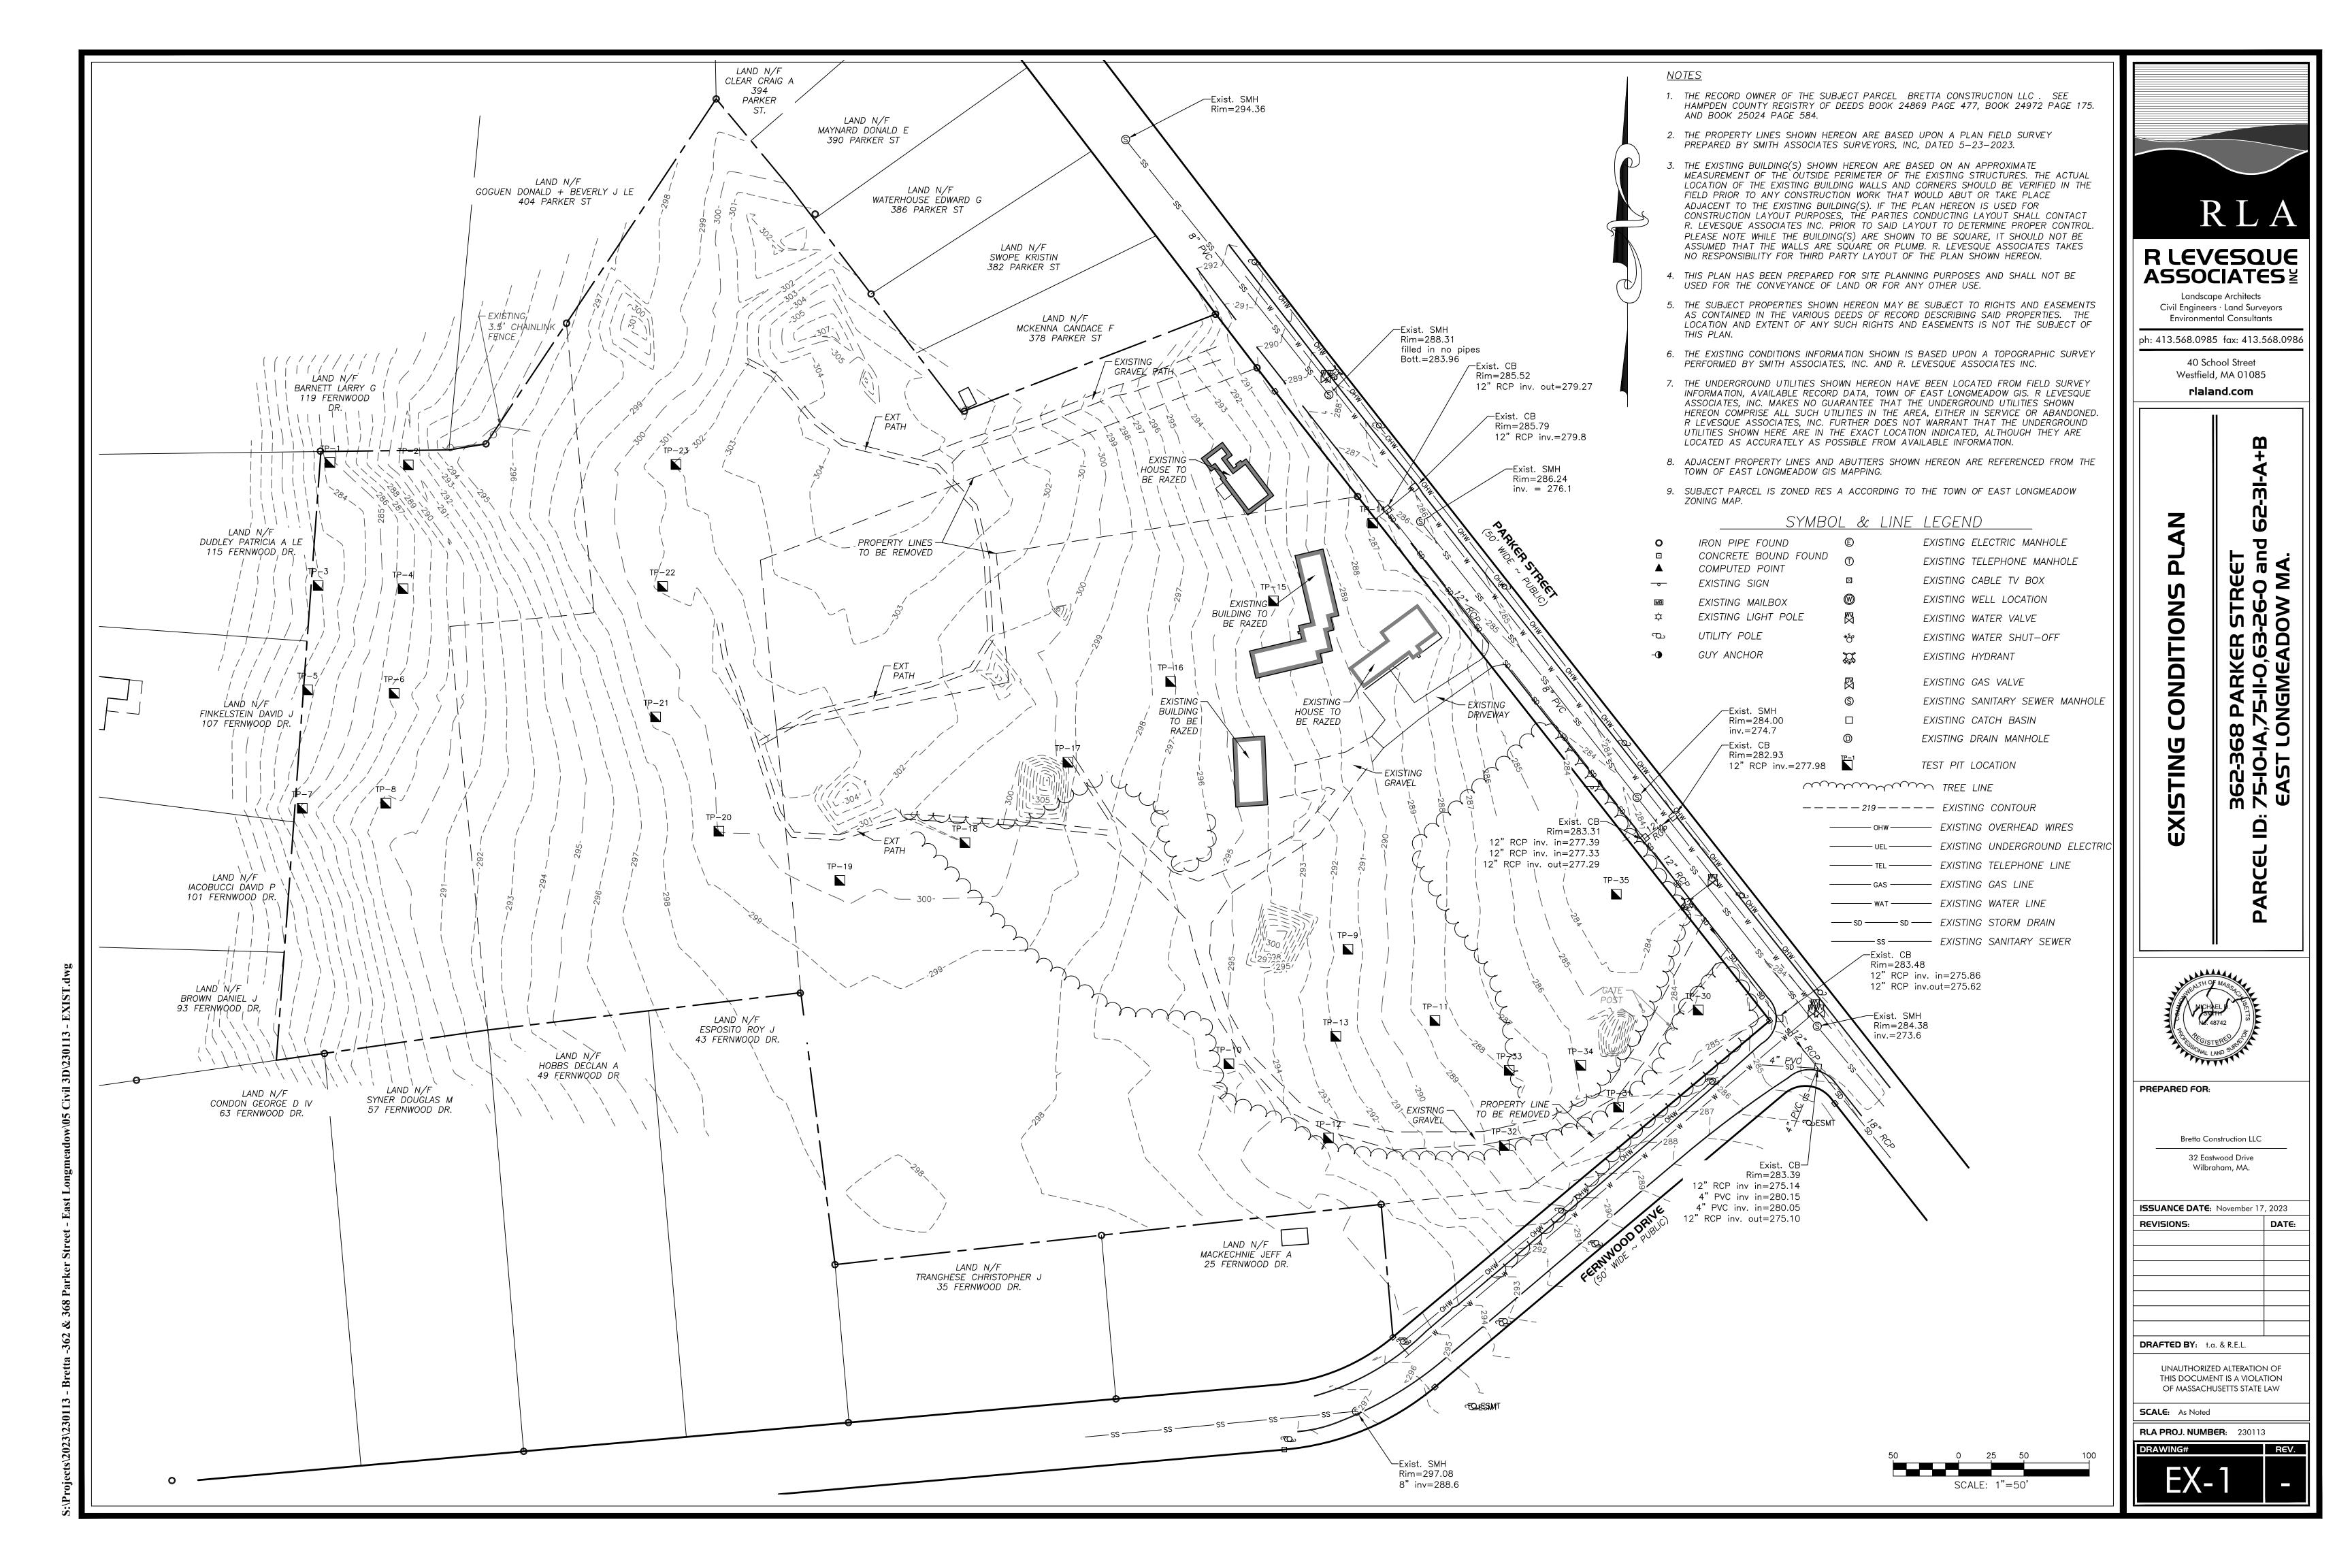

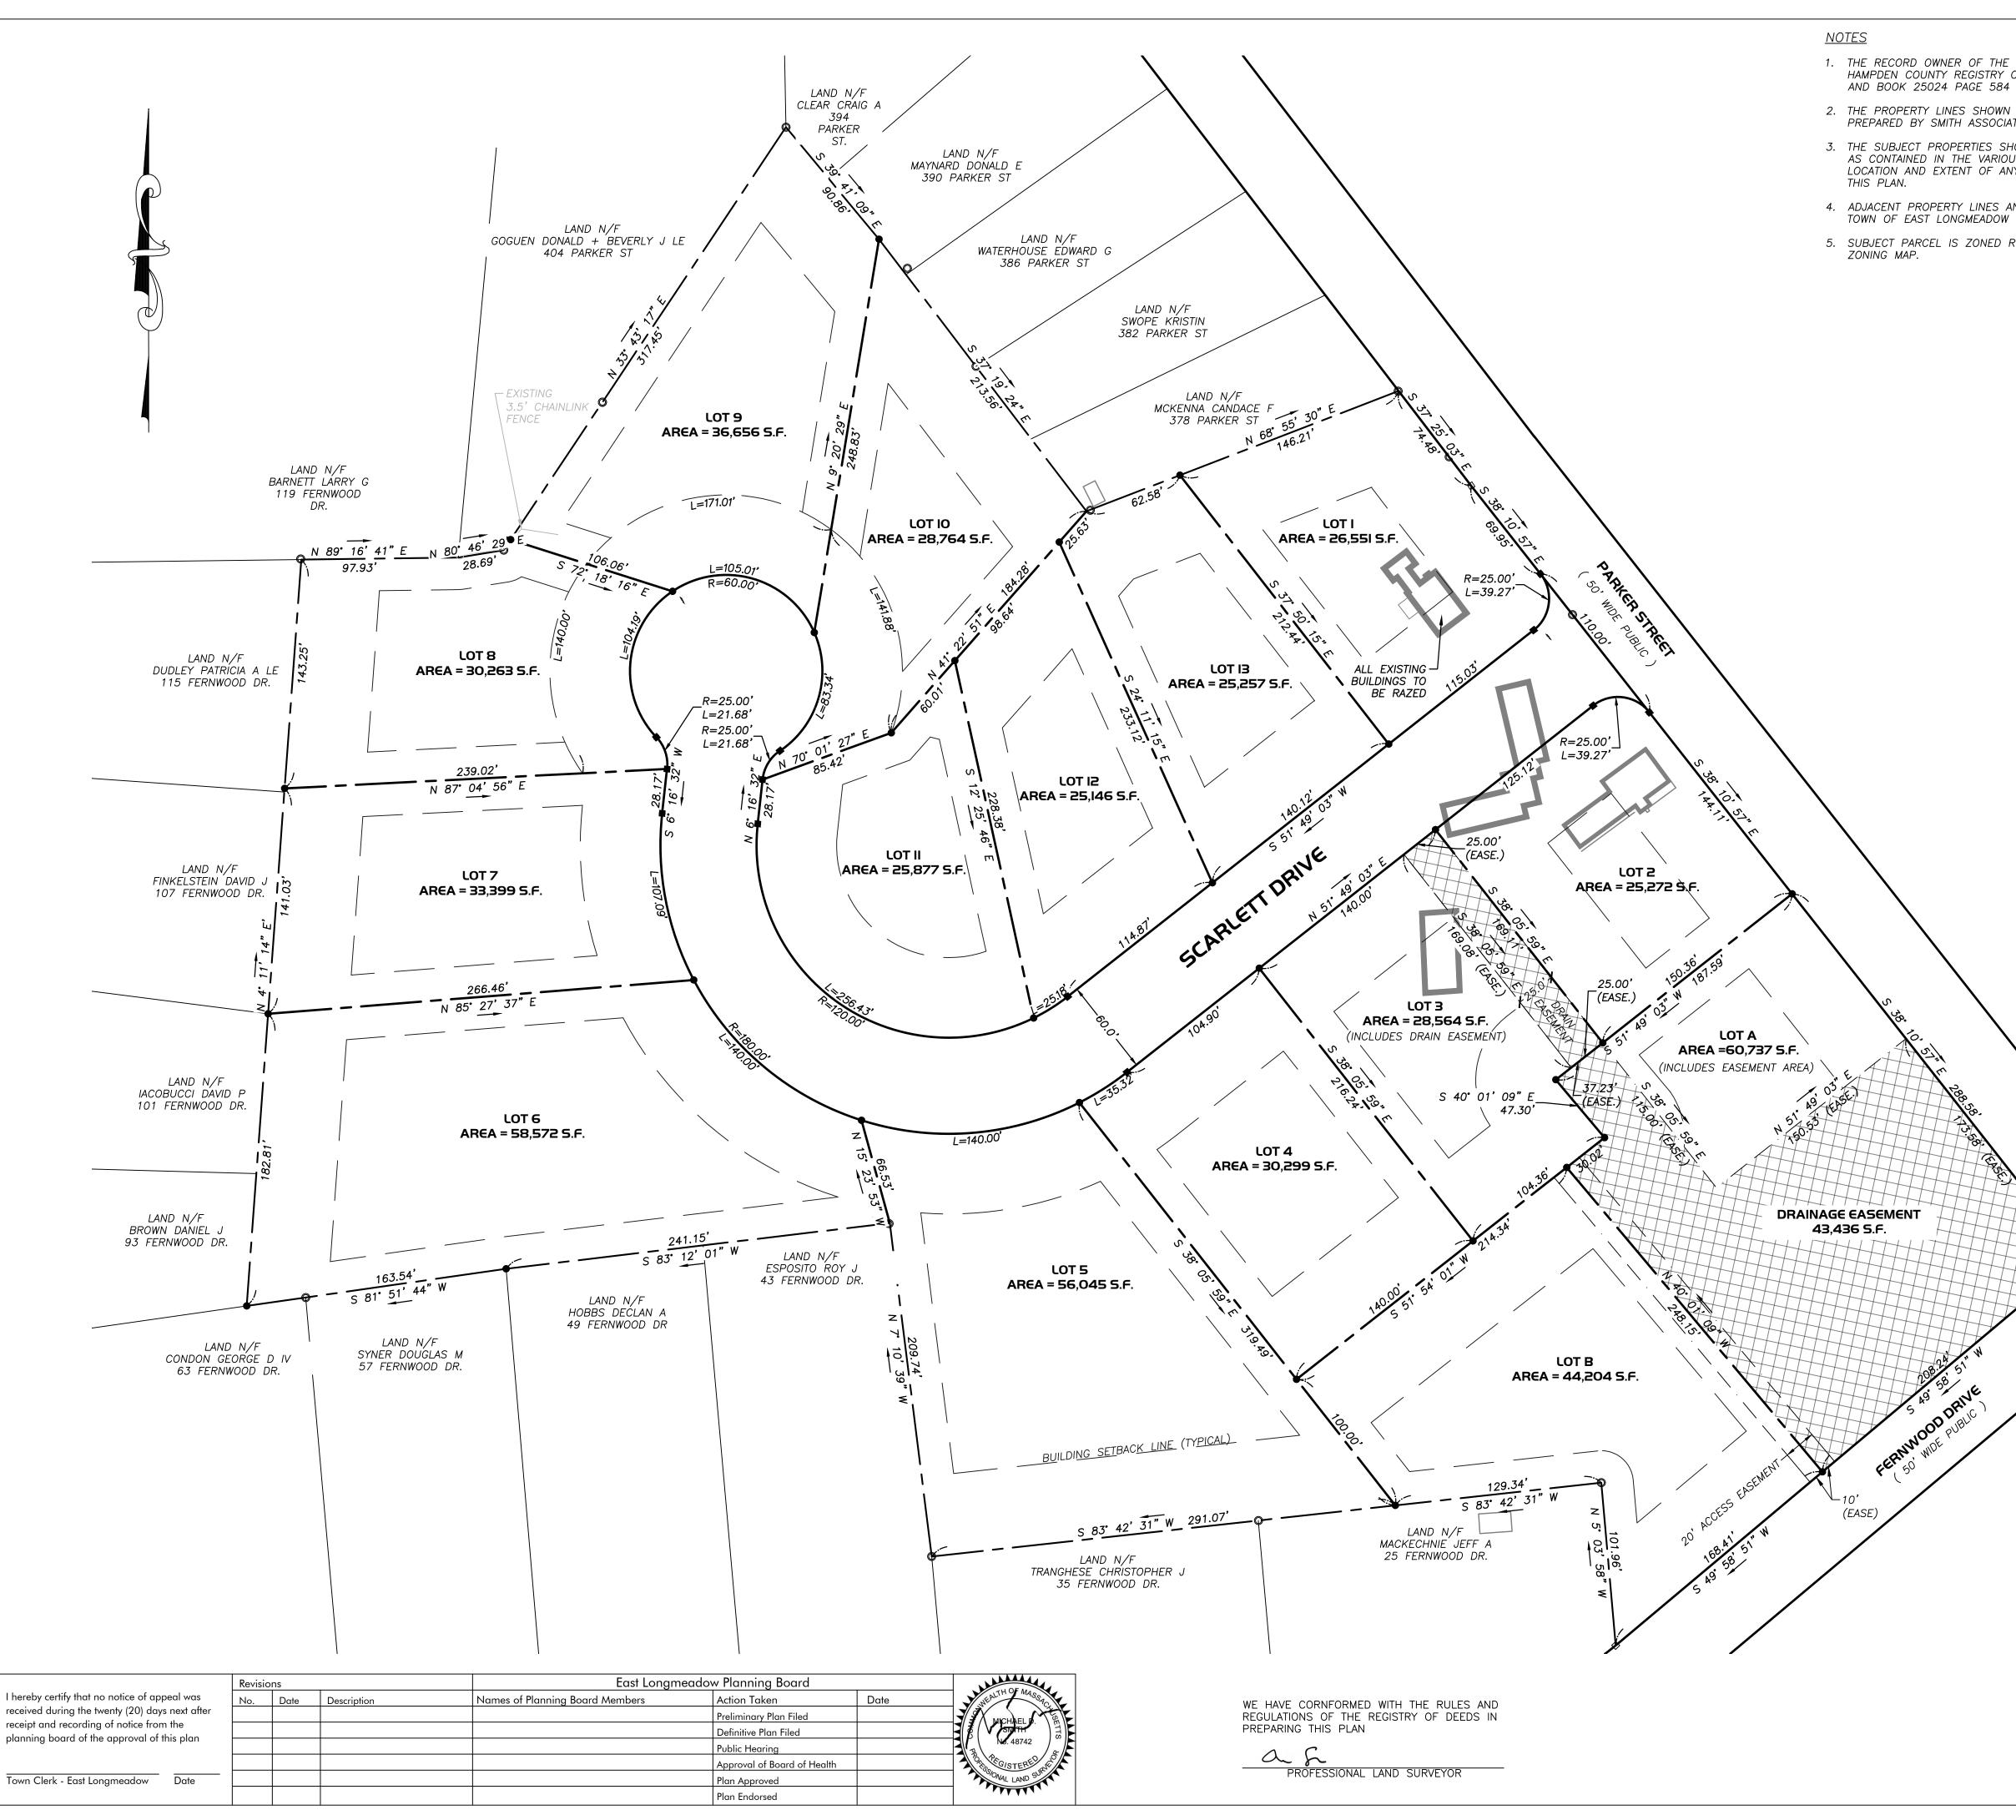


1. THE RECORD OWNER OF THE SUBJECT PARCEL ARE BRETTA CONSTRUCTION LLC. SEE HAMPDEN COUNTY REGISTRY OF DEEDS BOOK 24869 PAGE 477, BOOK 24972 PAGE 175

2. THE PROPERTY LINES SHOWN HEREON ARE BASED UPON A PLAN FIELD SURVEY PREPARED BY SMITH ASSOCIATES SURVEYORS, INC, DATED 5-23-2023.

3. THE SUBJECT PROPERTIES SHOWN HEREON MAY BE SUBJECT TO RIGHTS AND EASEMENTS AS CONTAINED IN THE VARIOUS DEEDS OF RECORD DESCRIBING SAID PROPERTIES. THE LOCATION AND EXTENT OF ANY SUCH RIGHTS AND EASEMENTS IS NOT THE SUBJECT OF

4. ADJACENT PROPERTY LINES AND ABUTTERS SHOWN HEREON ARE REFERENCED FROM THE TOWN OF EAST LONGMEADOW GIS MAPPING.

5. SUBJECT PARCEL IS ZONED RES A ACCORDING TO THE TOWN OF EAST LONGMEADOW

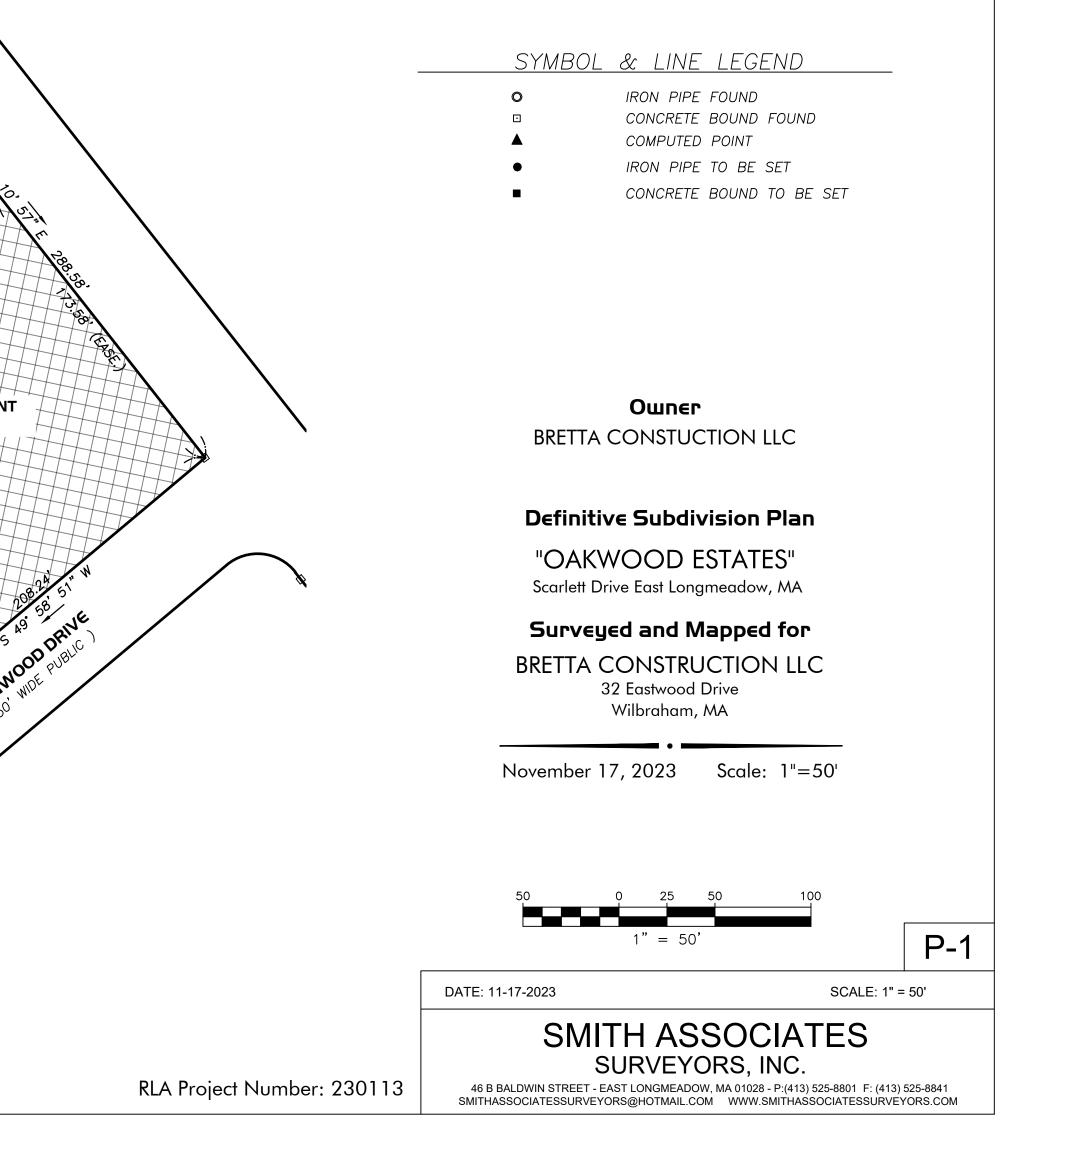

SYMBOL	& LINE LEGEND	ABBREVIATIONS	<u>EROSION & SEDIMENT (</u>
0	IRON PIPE FOUND	A.F.F. – ABOVE FINISHED FLOOR A.F.S. – ABOVE FINISHED SLAB	MANAGEMENT STRATEGIES
•	IRON PIPE TO BE SET	APPROX. – APPROXIMATE	1. CONSTRUCTION TRAFFIC SHALL BE LI
	CONCRETE BOUND FOUND	A.T.F. — ABOVE TOP OF FOUNDATION BLDG. — BUILDING	2. CONSTRUCTION SEQUENCE SHALL BE
•	CONCRETE BOUND TO BE SET	BLDG. – BOILDING BLK. – BLOCK	FOR LONG PERIODS OF TIME.
	COMPUTED POINT	BOT. – BOTTOM	3. TEMPORARY SEED AND MULCH SHALL
- 0 -	EXISTING SIGN	B.O.W. – BOTTOM OF WALL BRG. – BEARING	GRADING.
MB	EXISTING MAILBOX	CB. – CATCH BASIN	4. SEDIMENTATION CONTROL MEASURES FOLLOWING STORM EVENTS TO LOCAT
O ^{MW}	EXISTING MONITORING WELL	CL – CENTERLINE C.I. – CAST IRON	ROUTINE MAINTENANCE OPERATIONS.
¢	EXISTING LIGHT POLE	CLR. – CLEAR	5. THE CONSTRUCTION SUPERINTENDENT SEDIMENTATION CONTROL PROGRAM.
ى ك	UTILITY POLE	CONC. – CONCRETE CONT. – CONTINUOUS	VEGETATIVE CONTROL PRACTICES
-0	GUY ANCHOR	CONTR. – CONTRACTOR	
E	EXISTING ELECTRIC MANHOLE	DBL. – DOUBLE DET. – DETAIL	1. TOPSOIL STOCKPILING: TOPSOIL SHAL STOCKPILED FOR LATER USE. STOCK
\bigcirc	EXISTING TELEPHONE MANHOLE	D.I. – DUCTILE IRON	AND ENGINEER AND BE WITHIN LIMIT
⊠	EXISTING CABLE TV BOX	DIA. – DIAMETER	2. TEMPORARY SEEDING: THE TEMPORAR GRADED AREAS SHALL BE SEEDED W
\otimes	EXISTING WELL LOCATION	DIM. – DIMENSION DT'L. – DETAIL	ANY SOILS THAT ARE LEFT EXPOSED
×⊠	EXISTING WATER VALVE	DWG. – DRAWING	SHALL BE TEMPORARILY SEEDED.
*	EXISTING WATER SHUT-OFF	EA. – EACH ELEC. – ELECTRIC	A. SITE PREPARATION • COMPLETE ALL ROUGH GRADING AC
Х.	EXISTING HYDRANT	ELEV. – ELEVATION	 REMOVE ALL ROCKS AND DEBRIS L TEMPORARILY SEEDED. — EVENLY AP
	PROPOSED WATER VALVE	EXIST. – EXISTING EXT. – EXTERIOR	• EVENLY APPLY 14 LBS. OF 5–10– SUITABLE EQUIPMENT.
×	PROPOSED HYDRANT	FFE – FINISH FLOOR ELEVATION	• SEEDBED IS TO BE LEFT IN FIRM A
cv ⊠	EXISTING GAS VALVE	FIN. – FINISH	• THE LAST TILLAGE OPERATION SHAL
S	EXISTING SANITARY SEWER MANHOLE	FLR. – FLOOR FOUND. – FOUNDATION	B. ESTABLISHMENT• EVENLY APPLY SEED IN ACCORDANCE
	EXISTING CATCH BASIN	FT. – FOOT OR FEET	BY MEANS OF BROADCASTING OR H • UNLESS HYDROSEEDED, COVER SEE
D	EXISTING DRAIN MANHOLE	INSTL. – INSTALLED LT. – LIGHT	APPLY MULCH OR EROSION CONTRO VERIFY SEEDING DATES WITH ENGIN
	PROPOSED CATCH BASIN	MAX. – MAXIMUM	ENGINEER/LANDSCAPE ARCHITECT D
	PROPOSED MANHOLE	M.A.H.W. — MEAN ANNUAL HIGH WATER MH.	CLIMATE, TOPSOIL SHALL NOT BE S EXPOSED SURFACE TO STABILIZE S
SB-1	SOIL BORING LOCATION	MIN. – MINIMUM	PERIOD. • PERMANENT SEEDING SHALL BE API
	TEST PIT LOCATION	MISC. – MISCELLANEOUS	TEMPORARY SEEDING SHALL BE APF FRAME, UPON APPROVAL BY THE E
₽-1	PERC TEST LOCATION	N.T.S. – NOT TO SCALE O.A. – OVERALL	
₩F-1	WETLAND FLAG LOCATION	O.C. – ON CENTER	C. MAINTENANCE • ALL SEEDED/MULCHED AREAS SHAL
* ‴''' ►R−1	M.A.H.W. FLAG LOCATION	PCB — PROPOSED CATCH BASIN PDMH — PROPOSED DRAIN MANHOLE	STAND IS MAINTAINED. AREAS SHA
	EXISTING STONE WALL	PFES – PROP. FLARED END SECTION	NONSTRUCTURAL CONTROL PRACTI
		POCS – PROP. OUTLET CONTROL STRUCT. PROP. – PROPOSED	1. SCARIFICATION: EXPOSED SLOPES E
× 102.4	EXISTING SPOT GRADE	PSMH – PROP. SANITARY SEWER MANHOLE	ANGLES TO THE SLOPE. PROVIDE PE PERIOD UNTIL VEGETATION IS ESTABL
	EXISTING SPOT GRADE	PWQU – PROP. WATER QUALITY UNIT	POSSIBLE.
	PROPOSED SPOT GRADE	P.S.I. – POUNDS PER SQUARE INCH REINF. – REINFORCING	2. STRAW MULCH: STRAW MULCH SHAL TEMPORARY/PERMANENT SEEDING AN
× 94.7		R.H. – RIGHT HAND	OUTSIDE OF RECOMMENDED SEEDING PER 1000 S.F. CONTRACTOR SHALL
214	PROPOSED CONTOUR	SHT. – SHEET SPEC. – SPECIAL OR SPECIFICATIONS	PER 1000 S.F. CONTRACTOR SHALL PARTICULARLY FOLLOWING SIGNIFICAN
	EDGE OF WETLAND	SQ. – SQUARE	3. TOPSOIL: DISTURBED AREAS SHALL
	FENCE LINE	ST. – STEEL STA. – STATION	APPLICATION STANDARDS: • REMOVE ALL ROCKS AND DEBRIS O
	GUARDRAIL	T.O.F. – TOP OF FOUNDATION	 SCARIFY SURFACE PRIOR TO SEED APPLY 6" DEPTH OF TOPSOIL.
	EXISTING OVERHEAD WIRES	T.O.W. – TOP OF WALL	
	EXISTING UNDERGROUND ELECTRIC	T.S. – TOP OF STEEL TYP. – TYPICAL	4. SILT FENCE: SILT FENCE SHALL BE AT CULVERT OUTLET LOCATIONS, OR
	EXISTING TELEPHONE LINE	W/ – WITH	BE INSPECTED AND REPAIRED ROUTIN THE SITE HAS BEEN STABILIZED (COV
G G		WTR. – WATER W.W.M. – WELDED WIRE MESH	STRUCTURAL CONTROL PRACTICES
	EXISTING WATER LINE		
	EXISTING STORM DRAIN		1. RIP-RAP OUTLET PROTECTION: RIP-R MATERIAL SHALL BE HARD, DURABLE
	EXISTING SANITARY SEWER		RESISTS BREAKING DOWN WHEN EXPO
LOW LOW	LIMIT OF WORK LINE		2. CONSTRUCTION ENTRANCE: CONSTRUC ACCORDANCE WITH THE DRAWINGS.
SFSFSF	SILT FENCE LINE		ACCORDANCE WITH THE DIAWINGS.

- - INCHES DEEP.

& SEDIMENT CONTROL NOTES

STRATEGIES

ON TRAFFIC SHALL BE LIMITED TO THE CONSTRUCTION ENTRANCE.

- ON SEQUENCE SHALL BE PHASED TO AVOID LEAVING LARGE AREAS EXPOSED PERIODS OF TIME.
- SEED AND MULCH SHALL BE APPLIED IMMEDIATELY FOLLOWING ROUGH
- ON CONTROL MEASURES SHALL BE INSPECTED CONTINUOUSLY, ESPECIALLY STORM EVENTS TO LOCATE FAILING CONTROL MEASURES AND CONDUCT NTENANCE OPERATIONS.
- UCTION SUPERINTENDENT SHALL INFORM ALL ON-SITE WORKERS OF THE ON CONTROL PROGRAM.
- NTROL PRACTICES
- CKPILING: TOPSOIL SHALL BE STRIPPED FROM AREAS TO BE DISTURBED AND FOR LATER USE. STOCKPILE LOCATION SHALL BE APPROVED BY THE OWNER ER AND BE WITHIN LIMIT OF WORK.
- SEEDING: THE TEMPORARY SEDIMENT BASIN, TOPSOIL STOCKPILE AND ROUGH AS SHALL BE SEEDED WITH WINTER RYE AT A RATE OF 30 LBS. PER ACRE HAT ARE LEFT EXPOSED AND UNDISTURBED FOR MORE THAN 30 DAYS EMPORARILY SEEDED.
- ALL ROUGH GRADING ACTIVITIES
- ROCKS AND DEBRIS LARGER THAN 3" IN DIAMETER FROM AREAS TO BE LY SEEDED. -EVENLY APPLY LIME TO ACHIEVE A PH VALUE OF 6.0. PLY 14 LBS. OF 5–10–10 ANALYSIS FERTILIZER TO A DEPTH OF 4" USING QUIPMENT. S TO BE LEFT IN FIRM AND SMOOTH CONDITION.
- TILLAGE OPERATION SHALL BE PERFORMED ACROSS THE SLOPE.
- PLY SEED IN ACCORDANCE WITH THE SPECIES AND RATE INDICATED ABOVE OF BROADCASTING OR HYDROSEEDING.
- 'DROSEEDED, COVER SEED WITH 1/4" TO 1/2" OF TOPSOIL CH OR EROSION CONTROL BLANKET IMMEDIATELY FOLLOWING SEEDING.
- DING DATES WITH ENGINEER/LANDSCAPE ARCHITECT. IF LANDSCAPE ARCHITECT DETERMINES THAT SEED CANNOT BE APPLIED DUE TO OPSOIL SHALL NOT BE SPREAD AND MULCHING SHALL BE APPLIED TO THE SURFACE TO STABILIZE SOILS UNTIL THE NEXT RECOMMENDED SEEDING
- SEEDING SHALL BE APPLIED BETWEEN APRIL 15 AND SEPTEMBER 30. SEEDING SHALL BE APPLIED TO ALL DISTURBED AREAS OUTSIDE THIS TIME ON APPROVAL BY THE ENGINEER/LANDSCAPE ARCHITECT.
- D/MULCHED AREAS SHALL BE INSPECTED REGULARLY TO SEE THAT A GOOD MAINTAINED. AREAS SHALL BE REPAIRED AS NECESSARY.
- RAL CONTROL PRACTICES
- N: EXPOSED SLOPES EXCEEDING 4:1 SHALL BE SCARIFIED AT RIGHT THE SLOPE. PROVIDE PERIODIC UPGRADING OF SERRATIONS DURING EXPOSED VEGETATION IS ESTABLISHED. PROVIDE VEGETATIVE COVER AS SOON AS
- TH: STRAW MULCH SHALL BE APPLIED IN CONJUNCTION WITH PERMANENT SEEDING AND TO GRADED AREAS WHICH REMAIN EXPOSED RECOMMENDED SEEDING DATES. MULCH SHALL BE APPLIED AT 90 LBS. F. CONTRACTOR SHALL PERIODICALLY INSPECT AND REAPPLY AS NECESSARY, Y FOLLOWING SIGNIFICANT STORM EVENTS.
- ISTURBED AREAS SHALL BE TOPSOILED PRIOR TO SEED APPLICATION.
- N STANDARDS: ROCKS AND DEBRIS OVER $1^{"}-1$ 1/2" IN DIAMETER. JRFACE PRIOR TO SEED APPLICATION.
- DEPTH OF TOPSOIL.
- SILT FENCE SHALL BE INSTALLED AROUND THE PERIMETER OF THE SITE, OUTLET LOCATIONS, OR AS INDICATED ON THE DRAWINGS. SILT FENCE SHALL D AND REPAIRED ROUTINELY, ESPECIALLY FOLLOWING STORM EVENTS UNTIL AS BEEN STABILIZED (COVER > 70%) BY VEGETATION.
- CONTROL PRACTICES
- ITLET PROTECTION: RIP-RAP SHALL BE PROVIDED AT ALL PIPE OUTLETS. ALL BE HARD, DURABLE FIELD OR QUARRY STONE WHICH IS ANGULAR AND AKING DOWN WHEN EXPOSED TO WATER OR WEATHERING.
- ON ENTRANCE: CONSTRUCTION ENTRANCE SHALL BE CONSTRUCTED IN
- 3. DUST CONTROL: A WATER TRUCK SHOULD BE LOCATED ON-SITE FOR DUST CONTROL WHILE WORK IS PROCEEDING. MAINTENANCE SEDIMENTATION CONTROL MEASURES SHALL BE CHECKED WEEKLY AND AFTER EACH SIGNIFICANT RAINFALL EVENT. THE FOLLOWING ITEMS SHALL BE CHECKED IN PARTICULAR:
 - A. RIP-RAP OUTLET PROTECTION SHALL BE CHECKED REGULARLY FOR SEDIMENT ACCUMULATION. IF SIGNIFICANT AMOUNTS OF SEDIMENT ACCUMULATE, RIP-RAP SHALL BE REMOVED AND REPLACED. B. SILT FENCING SHALL BE INSPECTED REGULARLY FOR UNDERMINING AND
 - DETERIORATION. REMOVE SEDIMENT FROM BEHIND FENCE WHEN IT BECOMES 6
 - C. SEEDED/MULCHED AREAS SHALL BE INSPECTED REGULARLY TO SEE THAT A GOOD STAND IS MAINTAINED. AREAS SHALL BE REPAIRED AS NECESSARY.

SILT FENCE INSTALLATION NOTES

- 1. THIS SEDIMENT BARRIER UTILIZES MIRAFI ENVIROFENCE (100X) OR EQUAL. IT IS DESIGNED FOR SITUATIONS IN WHICH ONLY SHEET OR OVERLAND FLOWS ARE EXPECTED.
- 2. THE HEIGHT OF THE BARRIER SHALL NOT EXCEED 36 INCHES (HIGHER BARRIERS MAY IMPOUND VOLUMES OF WATER SUFFICIENT TO CAUSE FAILURE OF THE STRUCTURE). IDEALLY THE FILTER FENCE SHALL BE PLACED 10 FEET AWAY FROM THE TOE OF SLOPE.
- 3. WHEN JOINTS ARE NECESSARY, FILTER FABRICS SHALL BE SPLICED TOGETHER ONLY AT A SUPPORT STAKES WITH A MINIMUM 6-INCH OVERLAP, AND SECURELY SEALED. SEE MANUFACTURER'S RECOMMENDATION.
- 4. STAKES SHALL BE SPACED A MAXIMUM OF 10 FEET APART AT THE BARRIER LOCATION AND DRIVEN SECURELY INTO THE GROUND (MINIMUM OF 12 INCHES). IN APPLICATIONS WHERE HEAVY FLOWS ARE EXPECTED SUCH AS IN-STREAM INSTALLATIONS STAKE SPACING SHALL BE PER MANUFACTURER'S RECOMMENDATIONS AND/OR THE ENGINEERS RECOMMENDATIONS.
- 5. A TRENCH SHALL BE EXCAVATED APPROXIMATELY 6 INCHES WIDE AND 6 INCHES DEEP ALONG THE LINE OF STAKES AND UPSLOPE FROM THE BARRIER IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.
- 6. THE PRE ASSEMBLED SILT FENCE SYSTEM SHALL BE UNROLLED, POSITION THE STAKES ON THE DOWNHILL SIDE OF THE TRENCH AND HAMMER THE STAKES AT LEAST 12 INCHES INTO THE GROUND.
- 7. THE BOTTOM SIX (6) INCHES OF THE FABRIC SHALL BE LAID INTO THE TRENCH TO PREVENT UNDERMINING BY STORM WATER RUNOFF.
- 8. BACKFILL THE TRENCH OVER THE FILTER FABRIC AND COMPACT SUFFICIENTLY TO PREVENT THE RUNOFF FROM ERODING THE BACKFILL.
- 9. THE FABRIC SHALL NOT EXTEND MORE THAT 36 INCHES ABOVE THE ORIGINAL GROUND SURFACE. FILTER FABRIC SHALL NOT BE STAPLED TO EXISTING TREES OR SUPPORTS OTHER THAN THE STANDARD STAKES.
- 10. INSTALLED SILT FENCE BARRIERS SHALL BE MAINTAINED ON A REGULAR SCHEDULE WHICH MAY BE PRESCRIBED BY THE LOCAL, STATE OF FEDERAL REGULATORY AUTHORITY; BUT, AT MINIMUM SHALL BE CHECKED WEEKLY AS WELL AS AFTER EACH STORM EVENT. MAINTENANCE SHALL CONSIST OF AN INSPECTION OF THE ENTIRE LENGTH OF THE BARRIER TO DETERMINE IF IT IS FUNCTIONING AS INTENDED. ALL BREAKS, DETACHED FABRIC, SLUMPED FABRIC, CLOGGED FABRIC, AND UNDERMINED AREAS SHALL BE FIXED THE DAY THAT THEY ARE DISCOVERED.
- 11. WHEN A MAXIMUM OF SIX (6) INCHES OF SEDIMENT HAS ACCUMULATED BEHIND THE SILT FENCE THIS SEDIMENT SHALL BE REMOVED AND THE FENCE SHALL BE INSPECTED FOR TEARS, CLOGGING OF BREAKS. ALL DEFICIENCIES SHALL BE CORRECTED IMMEDIATELY EITHER BY REPAIR OF REPLACEMENT OF THE SILT FENCE BARRIER AND/OR STAKES AS NEEDED.
- 12. SILT FENCE BARRIERS SHALL BE REMOVED WHEN THEY HAVE SERVED THEIR USEFUL PURPOSE, BUT NOT BEFORE THE UPSLOPE AREA HAS BEEN CLEANED OF SILT AND PERMANENTLY STABILIZED.

HAY BALE INSTALLATION & MAINTENANCE (as reg'd)

- 1. HAY BALES SHALL BE PLACED IN A SINGLE ROW, LENGTHWISE ON THE CONTOUR, WITH ENDS OF ADJACENT BALES TIGHTLY ABUTTING ONE ANOTHER.
- 2. ALL BALES SHALL BE EITHER WIRE BOUND OR STRING TIES. BALES SHALL BE INSTALLED SO THAT BINDINGS ARE ORIENTED AROUND THE SIDES RATHER THAN ALONG THE TOPS AND BOTTOMS OF THE BALES TO PREVENT DETERIORATION OF THE BINDINGS.
- 3. THE BARRIER SHALL BE ENTRENCHED AND BACKFILLED. A TRENCH SHALL BE EXCAVATED THE WIDTH OF A BALE AND THE LENGTH OF THE PROPOSED BARRIER TO A MINIMUM DEPTH OF FOUR (4) INCHES AND A MAXIMUM DEPTH OF SIX (6) INCHES. AFTER THE BALES ARE STAKED AND CHINKED, THE EXCAVATED SOIL SHALL BE BACKFILLED AGAINST THE BARRIER. BACKFILL SOIL SHALL CONFORM TO THE GROUND LEVEL ON THE DOWNHILL SIDE AND SHALL BE BUILT UP TO FOUR (4) INCHES AGAINST THE UPHILL SIDE OF THE BARRIFR.
- 4. EACH BALE SHALL BE SECURELY ANCHORED BY AT LEAST TWO (2) STAKES OR REBARS DRIVEN THROUGH THE BALE. THE FIRST STAKE IN EACH BALE SHALL BE DRIVEN TOWARD THE PREVIOUSLY LAID BALE TO FORCE THE BALES TOGETHER. STAKES OR REBARS SHALL BE DRIVEN DEEP ENOUGH INTO THE GROUND TO SECURELY ANCHOR THE BALES.
- 5. THE GAPS BETWEEN BALES SHALL BE CHINKED (FILLED BY WEDGING) WITH STRAW TO PREVENT WATER FROM ESCAPING BETWEEN THE BALES. (LOOSE STRAW SCATTERED OVER THE AREA IMMEDIATELY UPHILL FROM A STRAW BALE BARRIER TENDS TO INCREASE BARRIER EFFICIENCY.)
- 6. HAY BALES GENERALLY DETERIORATE IN 2-6 MONTHS AND THUS NEED REPLACEMENT.
- 7. INSPECTION SHALL BE FREQUENT AND REPAIR OR REPLACEMENT SHALL BE MADE PROMPTLY AS NEEDED.
- 8. BALE BARRIERS SHALL BE REMOVED WHEN THEY HAVE SERVED THEIR USEFULNESS, BUT NOT BEFORE THE UPSLOPE AREAS HAVE BEEN PERMANENTLY STABILIZED.

SITE PREP

OWNER.

- CONTRACTOR SHALL BE RESPONSIBLE FOR ALL RELOCATION. INCLUDING BUT NOT LIMITED TO, ALL UTILITIES, STORM DRAINAGE, SIGNS, TRAFFIC SIGNALS & POLES, ETC. AS REQUIRED. ALL WORK SHALL BE IN ACCORDANCE WITH GOVERNING AUTHORITIES SPECIFICATIONS AND SHALL BE APPROVED BY SUCH.
- 2. CONTRACTOR SHALL ERECT AND MAINTAIN SAFETY BARRICADES AND POST PROPER NOTICES PRIOR TO THE COMMENCEMENT OF WORK.
- 3. CONTRACTOR SHALL PROTECT EXISTING SITE IMPROVEMENTS, APPURTENANCES, AND LANDSCAPING TO REMAIN.
- 4. CONTRACTOR SHALL MAINTAIN EXISTING UTILITIES TO REMAIN IN SERVICE AND PROTECT THEM FROM DAMAGE DURING DEMOLITION OPERATIONS.
- 5. DO NOT DAMAGE EXISTING UTILITIES TO REMAIN WITHIN PROJECT AREA. ALL DAMAGE TO EXISTING UTILITIES TO REMAIN SHALL BE REPAIRED AT THE CONTRACTOR'S EXPENSE TO THE
- SATISFACTION OF THE UTILITY OWNER. 6. THERE SHALL BE NO BURNING OF DEMOLISHED MATERIAL ALLOWED ON SITE.
- 7. CONTRACTOR SHALL COORDINATE WITH OWNER FOR ANY ITEMS TO BE TURNED OVER TO
- 8. DEMOLISH AND REMOVE ALL PAVEMENT, SLABS, FOOTINGS, SUBSURFACE ELEMENTS,

MISCELLANEOUS DEBRIS, ETC. WITHIN PROPERTY LINES UNLESS NOTED OTHERWISE.

- 9. CONTRACTOR IS RESPONSIBLE FOR CONTROLLING DUST SO THAT DUST DOES NOT CREATE A NUISANCE ON ADJACENT ROADS OR PROPERTIES. SITE CONTRACTOR SHALL BE RESPONSIBLE FOR STREET SWEEPING AND CATCH BASIN CLEANING AFTER EACH PHASE OF CONSTRUCTION AND AS NEED IS DETERMINED BY THE ENGINEER.
- 10. CONTRACTOR SHALL REMOVE AND DISPOSE OF ANY ABANDONED SUBSURFACE SOIL ABSORPTION SYSTEM (SAS) AND MISCELLANEOUS DEBRIS.
- 11. NO ACTIVITY OTHER THAN NORMAL MAINTENANCE SHALL OCCUR OUTSIDE OF LIMIT OF WORK LINES AS SHOWN ON PLAN WITHOUT THE APPROVAL OF THE ENGINEER.
- 12. THE CONTRACTOR SHALL NOTIFY DIG SAFE @ 1-888-344-7233 PRIOR TO COMMENCEMENT OF ANY DEMOLITION/CONSTRUCTION ACTIVITY.


LANDSCAPE NOTES

- 1. THE CONTRACTOR SHALL VERIFY FINAL SELECTION OF PLANT MATERIALS WITH THE LANDSCAPE ARCHITECT AND OWNER PRIOR TO INSTALLATION.
- 2. NO PLANT MATERIAL WILL BE ACCEPTED WHICH DISPLAYS MAJOR IRREGULARITIES OR DAMAGE. THE OWNER/LANDSCAPE ARCHITECT RETAINS THE RIGHT TO REJECT ANY PLANT MATERIAL DEEMED UNFIT.
- 3. WARRANTEE: FOR A PERIOD OF TWO GROWING SEASONS FROM THE DATE THAT THE WORK UNDER THIS CONTRACT IS CERTIFIED AS SUBSTANTIALLY COMPLETE, THE CONTRACTOR SHALL: 1) WARRANTEE ALL PLANTS AND SEEDED AREAS UNDER THIS CONTRACT; 2)REMOVE AND REPLACE DURING THIS GUARANTEE PERIOD PLANTS WHICH DIE OR ARE IN POOR CONDITION AS DETERMINED BY THE OWNER; 3) REPLANT WITH STOCK OF SAME SIZE AND QUALITY AS ORIGINALLY SPECIFIED; 4) GUY AND MAINTAIN AS SPECIFIED HEREIN AT NO ADDITIONAL COST TO THE OWNER.
- 4. ALL NEW LAWN AREAS SHALL RECEIVE A MINIMUM OF 4 INCHES TOPSOIL OF THE PROPER ph and organic content suitable for the healthy growth of lawns. These AREAS SHALL BE SEEDED WITH A FINE BLADE LAWN GRASS SEED OR SODDED. ADDITIONAL OFF-SITE TOPSOIL MAY BE REQUIRED.
- 5. ALL AREAS TO BE MULCHED SHALL RECEIVE 4 INCHES MINIMUM 100% SHREDDED BARK MULCH WITHIN 48 HOURS OF PLANTING UNLESS OTHERWISE NOTED IN PLANTING DETAILS.
- 6. ALL TREE AND SHRUB PITS SHALL BE AT LEAST 2 FEET WIDER AND 1 FOOT DEEPER THAN THE TREE OR SHRUB ROOT BALL TO BE PLANTED IN IT. BACKFILL SHALL BE HIGH QUALITY LOAM OF THE PROPER PH AND ORGANIC CONTENT SUITABLE FOR THE HEALTHY GROWTH OF PLANT MATERIALS.
- 7. ALL PLANTS SHALL BE NURSERY GROWN AND CONFORM TO THE LATEST EDITION OF "ANSI Z60.1, AMERICAN STANDARD FOR NURSERY STOCK".
- 8. EACH PLANT TO BE FREE FROM DISEASE, INSECT INFESTATION, MECHANICAL INJURIES, AND IN ALL RESPECTS BE SUITABLE FOR FIELD PLANTING.
- 9. EACH PLANT TO BE IN THE TOP OF ITS SIZE CLASS AFTER SHEARING AND PRUNING. 10. ADJACENT TO THE TOP OF ANY WALLS OVER 36" A FENCE OR WALL SHALL BE CONSTRUCTED PER PLAN THAT MEETS LOCAL BUILDING CODE AND ALL OTHER APPLICABLE STATE AND FEDERAL LAWS.
- 11. SEE DETAIL SHEETS FOR ADDITIONAL DETAILS & SPECIFICATIONS.
- 12. SHOULD GC OR ANY SUBCONTRACTOR ENCOUNTER A DISCREPANCE/CONFLICT IN THE PLAN AN THE ACTUAL LOCATION OF A SITE FEATURE, THE CONTRACTOR SHALL CONTACT THE LANDSCAPE ARCHITECT/ENGINEER AND OWNER IMMEDIATELY.
- 13. ALL AREAS DISTURBED DURING CONSTRUCTION NOT DESIGNATED TO RECEIVE OTHER TREATMENT SHALL BE LOAMED TO A MINIMUM DEPTH OF 4" AND SEEDED IN ACCORDANCE WITH THE FOLLOWING:
 - A. INCORPORATE GROUND LIMESTONE INTO ALL AREAS TO BE SEEDED AT A RATE OF 50 LBS/1,000 S.F.
 - B. APPLY 10-6-4 FERTILIZER TO ALL AREAS TO BE SEEDED AT A RATE OF 2
 - LBS/1,000 S.F. C. THOROUGHLY INCORPORATE LIME AND FERTILIZER INTO SEED BED TO DEPTH OF 3"
 - BY DISCING OR OTHER APPROVED METHOD. D. SEED WITH THE FOLLOWING MIXTURE, APPLIED AT A RATE OF 10 LBS/1,000 S.F. SEED MIX:

NAME OF SEED	% BY WEIGHT IN MIXTURE	MIN. % PURITY	MIN. GERMINATION
POS PRETENSES "BARON" BARON BLUEGRASS	50	90	75
FESTUCA RUBRA "PENNLAWN" PENNLAWN FESCUE	25	95	85
LOLIUM PERENNE "PENNFINE" PENNFINE	25	98	95

- E. MULCH ALL SEEDED AREAS WITH STRAW AT A RATE OF 5 LBS/1,000 S.F.UNLESS HYDROSEEDING WAS USED.
- F. ALL SLOPES OF 3:1 OR GREATER AFTER BEING LOAMED, SEEDED AND MULCHED IN ACCORDANCE WITH THE ABOVE SHALL SECURED WITH EROSION CONTROL BLANKETS (NO. AMERICAN GREEN S150 OR EQUAL). OVERLAP ALL NETTING JOINTS A MINIMUM OF 6" AND SECURE WITH DOUBLE ROW OF STAPLES.

East Longmeadow Plar	ning Board
Action Taken	Date
Application Filed	
Preliminary Plan Filed	
Definitive Plan Filed	
Public Hearing	
Approval of Board of Health	
Plan Approved	
Plan Endorsed	
Names of Planning Board Mem	bers

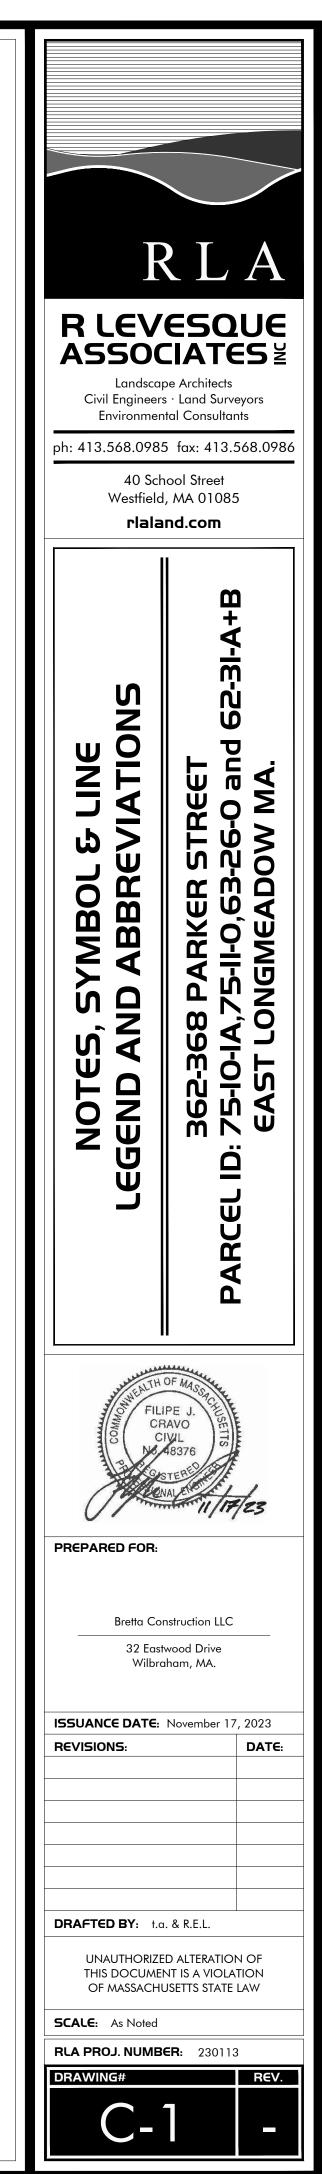

GENERAL CONSTRUCTION NOTES

- PRIOR TO BEGINNING CONSTRUCTION, THE CONTRACTOR OR HIS AUTHORIZED REPRESENTATIVE SHALL CONVENE A PRE-CONSTRUCTION CONFERENCE BETWEEN THE CITY/TOWN REPRESENTATIVES, CONSULTING ENGINEER/LANDSCAPE ARCHITECT, UTILITY COMPANY REPRESENTATIVES, AND ANY OTHER AFFECTED PARTIES.
- 2. THE OWNER, R LEVESQUE ASSOCIATES, INC. AND/OR THEIR REPRESENTATIVES, IN PREPARING THESE PLANS HAVE ATTEMPTED TO LOCATE ALL EXISTING UTILITIES IN THE PROJECT AREA. HOWEVER. THERE MAY BE UTILITIES THAT WERE NOT OR COULD NOT BE LOCATED. UNDERGROUND UTILITIES SHOWN ON THE PLANS ARE IN APPROXIMATE LOCATIONS ONLY. THE CONTRACTOR SHALL DETERMINE THE EXACT LOCATIONS AND ELEVATIONS OF ALL EXISTING UTILITIES BEFORE COMMENCING WORK. THE CONTRACTOR SHALL CALL ALL APPROPRIATE UTILITY COMPANIES FOR LOCATIONS OF THEIR UTILITIES AT LEAST 48 HOURS BEFORE COMMENCING EXCAVATION. IN THE EVENT THAT A UTILITY IS SITUATED SUCH THAT CONSTRUCTION CANNOT PROCEED AS SHOWN ON THE PLANS, THE PROJECT ENGINEER/LANDSCAPE ARCHITECT AND OWNER SHALL BE NOTIFIED IMMEDIATELY.
- 3. THE SITE CONTRACTOR IS RESPONSIBLE FOR ANY AND ALL DAMAGES WHICH OCCUR DUE TO HIS FAILURE TO LOCATE AND PRESERVE ANY AND ALL UTILITIES.
- 4. ALL FILL WORK REQUIRED TO BRING THE PROPOSED ROADWAY UP TO SUB-GRADE LEVEL SHALL CONFORM TO MHD SPECIFICATIONS SECTION 150.
- 5. CONSTRUCTION SHALL COMPLY WITH ALL APPLICABLE GOVERNING CODES AND BE CONSTRUCTED TO SAME.
- 6. ALL WORK IN THE CITY/TOWN RIGHT-OF-WAY AND EASEMENTS SHALL BE IN ACCORDANCE WITH THE CITY/TOWN SPECIFICATIONS AND MASSACHUSETTS DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION, LATEST EDITION.
- 7. THE CONTRACTOR SHALL GIVE THE CITY/TOWN A MINIMUM OF 48 HOURS NOTICE BEFORE BEGINNING EACH PHASE OF CONSTRUCTION.
- 8. CONTRACTOR IS RESPONSIBLE FOR REPAIRS OF DAMAGE TO ANY EXISTING IMPROVEMENTS DURING CONSTRUCTION, SUCH AS, BUT NOT LIMITED TO, DRAINAGE, UTILITIES, PAVEMENT, STRIPING, CURB, ETC. REPAIRS SHALL BE EQUAL TO OR BETTER THAN EXISTING CONDITIONS
- 9. ALL WORK SHALL BE PERFORMED IN CONFORMANCE WITH THE CONDITIONS OF APPROVAL OUTLINED IN ALL STATE AND LOCAL PERMITS. COPIES OF THE CONDITIONS ARE INCLUDED WITHIN THE PROJECTS TECHNICAL SPECIFICATIONS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR REVIEWING THIS INFORMATION PRIOR TO CONSTRUCTION AND CONFORMING TO THE CONDITIONS AS REQUIRED DURING CONSTRUCTION.
- 10. THE CONTRACTOR SHALL MAINTAIN THE JOB CLEAR OF TRASH AND DEBRIS. THE WORK AREAS ARE TO BE PICKED UP AT THE END OF EACH WORK DAY.
- 11. ANY TEMPORARY FACILITIES FOR THE STORAGE OR PROTECTION OF TOOLS, EQUIPMENT OR MATERIALS SHALL CONFORM TO LOCAL REGULATIONS AND SHALL BE THE GENERAL CONTRACTORS RESPONSIBILITY. THESE DOCUMENTS DO NOT INCLUDE THE NECESSARY COMPONENTS FOR CONSTRUCTION SAFETY. SAFETY, CARE OF ADJACENT PROPERTIES DURING CONSTRUCTION, AND COMPLIANCE WITH STATE AND FEDERAL REGULATIONS REGARDING SAFETY SHALL BE THE GENERAL CONTRACTORS RESPONSIBILITY.
- 12. THE GENERAL CONTRACTOR AND HIS SUBCONTRACTORS SHALL VISIT THE SITE AND BECOME FAMILIAR WITH ALL CONDITIONS PRIOR TO SUBMITTING HIS PROPOSAL. NO EXTRAS DUE TO UNFAMILIARITY WITH THE EXISTING SITE OR WORKING CONDITIONS WILL BE ALLOWED.
- 13. CONTRACTOR SHALL BE REQUIRED TO PERFORM FINAL CLEANUP CONSISTING OF CLEANING THE PROPOSED DRAINAGE AND SEWER SYSTEMS OF ALL DEBRIS PRIOR TO THE ACCEPTANCE BY THE OWNER. ADDITIONALLY, THE PROPOSED ROADWAY SHALL BE CLEANED AND SWEPT BY THE CONTRACTOR PRIOR TO ACCEPTANCE.
- 14. ALL EXCAVATION SHALL COMPLY WITH OSHA'S LATEST STANDARDS. ALL REQUIREMENTS OF OSHA'S EXCAVATION STANDARDS SHALL BE PROVIDED BY THE CONTRACTOR INCLUDING. BUT NOT LIMITED TO, THE PROVISION FOR A COMPETENT PERSON ON SITE MANAGER AND ANY REQUIRED DOCUMENTATION THAT MAY REQUIRE CERTIFICATION BY A PROFESSIONAL ENGINEER. THE OWNER, THROUGH ITS ENGINEER, SHALL EXPRESSLY NOT PROVIDE ANY OF THE ABOVE REQUIREMENTS DESIGNATED BY OSHA'S EXCAVATION STANDARD.
- 15. THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR THE COST OF LAYING OUT ALL ITEMS OF THE WORK BASED ON CERTAIN HORIZONTAL CONTROL AND BENCHMARK SUPPLIED BY THE SURVEYOR OF RECORD. ANY DISCREPANCIES SHALL BE IMMEDIATELY REPORTED TO THE ENGINEER.
- 16. THE CONTRACTOR SHALL PROVIDE ALL MATERIALS, LABOR, EQUIPMENT, PERMITS AND APPURTENANCES NECESSARY TO PROVIDE A COMPLETE PROJECT AS INDICATED ON THE PLANS AND IN THESE SPECIFICATIONS.
- 17. THE CONTRACTOR SHALL BE RESPONSIBLE FOR A THOROUGH SITE EXAMINATION IN ORDER TO PREPARE SITE FOR CONSTRUCTION.
- 18. ANY AND ALL DEMOLISHED TREES. STRUCTURES AND OTHER RUBBLE MATERIAL PERTAINING TO THIS PROJECT SHALL BE DISPOSED OF BY THE CONTRACTOR OFF-SITE AT HIS EXPENSE IN ACCORDANCE WITH ALL OF THE CITY/TOWN ORDINANCES AND ALL APPLICABLE STATE AND FEDERAL ENVIRONMENTAL REGULATIONS.
- 19. ALL PAVEMENT DISTURBED BY THE CONTRACTOR'S OPERATIONS SHALL BE REPLACED IN ACCORDANCE WITH THE SPECIFICATIONS AND AS SHOWN ON THE DRAWINGS.
- 20. ALL STREET EXCAVATIONS SHALL BE COMPLETELY CLOSED AT THE END OF EACH WORKING DAY BY BACKFILLING OR COVERING WITH STEEL PLATES.
- 21. ALL MATERIALS AND METHODS ARE TO COMPLY WITH THE CITY/TOWN DPW STANDARDS OR MASSACHUSETTS DEPARTMENT OF TRANSPORTATION (MASSDOT) (WHERE APPLICABLE), UNLESS OTHERWISE DIRECTED BY THE ENGINEER.
- 22. PERMITS WILL BE REQUIRED BY CONTRACTOR WHEN WORKING WITHIN OR OCCUPYING PUBLIC WAY. CONTRACTOR IS RESPONSIBLE FOR OBTAINING ALL REQUIRED WORK PERMITS AND MAINTAINING A COPY OF ALL PERMITS IN A THREE RING BINDER OR PROJECT BOOK AND ON-SITE AT ALL TIMES.
- 23. BACKFILL WILL BE PLACED IN SUCCESSIVE LAYERS NOT MORE THAN TWELVE INCHES IN THICKNESS AND SHALL BE COMPACTED TO 95% OF MAXIMUM DRY DENSITY DETERMINED BY STANDARD PROCTOR TEST (ASTM 698) FOR ALL APPLICABLE TYPES OF BACKFILL MATERIAL. NO FROZEN MATERIAL SHALL BE USED AS BACKFILL. IF, IN THE OPINION OF THE ENGINEER OR THE DPW, THE EXCAVATED MATERIAL IS UNSUITABLE, THE ENTIRE MATERIAL FOR BACKFILLING SHALL CONSIST OF APPROVED GRAVEL OR APPROVED BORROW, AS DIRECTED. AFTER THOROUGH TAMPING AROUND AND BENEATH THE UTILITY, A SIX-INCH LAYER OF BACKFILL WILL BE THOROUGHLY COMPACTED AS FOLLOWS: IF DRY, SHALL BE MOISTENED AND THEN COMPACTED WITH MECHANICAL TAMPERS OR BY HAND TAMPERS HAVING A TAMPING FACE NOT EXCEEDING 25 SQUARE INCHES IN AREA. THE FINAL TWELVE INCHES OF FILLING WILL, IN ALL CASES, CONSIST OF APPROVED GRAVEL THOROUGHLY TAMPED.
- 24. CONTRACTOR SHALL PROVIDE FIELD COMPACTION VERIFICATION UTILIZING ASTM D5195-02, STANDARD TEST METHOD FOR DENSITY OF SOIL & ROCK IN-PLACE AT DEPTHS BELOW THE SURFACE BY NUCLEAR METHODS.
- 25. CONTRACTOR SHALL PROVIDE FIELD COMPACTION RESULTS TO ENGINEER WITHIN 24-HOURS PRIOR TO PLACEMENT OF INFRASTRUCTURE OR BITUMINOUS BINDER.
- 26. ALL FILL TO BRING PROPOSED ROADWAY UP TO THE SUB-GRADE LEVEL SHALL EXTEND PAST THE EDGE OF THE RIGHT-OF-WAY AT A 2:1 SLOPE. THIS IS TO PROVIDE ADEQUATE SUPPORT FOR THE RIGHT-OF-WAY.

LAYOUT NOTES

- ACCORDANCE WITH THE CITY/TOWN STANDARD SPECIFICATIONS.
- 2. IN THE EVENT OF DISCREPANCIES BETWEEN LOCAL SPECIFICATIONS AND SITE SPECIFICATIONS, THE MORE STRINGENT REQUIREMENT SHALL GOVERN.
- MONUMENTATION DISTURBED DURING CONSTRUCTION.
- OTHERWISE NOTED ON THE PLANS.
- WORK.
- BE NOTIFIED IMMEDIATELY.
- SHALL ASSUME RESPONSIBILITY FOR ALL CORRECTIONS.
- 9. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE REMOVAL & LEGAL DISPOSAL OF ALL THE SITE DRAWINGS.
- THE CITY/TOWN REGULATIONS.
- TO PAVEMENT TO BE REMOVED.
- PLANS.

EARTHWORK NOTES

- CONFLICT WITH THE PROPOSED IMPROVEMENTS SHOWN ON THE PLANS.
- 3. STORM PIPE SHALL BE AS NOTED ON PLANS.
- EXISTING PIPES TO BE CLEANED OUT TO REMOVE ALL SILT AND DEBRIS.
- 5. EXISTING GRADE CONTOUR INTERVALS SHOWN AT 1 FOOT INTERVALS.
- 7. IF ANY EXISTING STRUCTURES TO REMAIN ARE DAMAGED DURING CONSTRUCTION IT SHALL
- STRUCTURE IS WATERTIGHT.
- GRADES, AND SHALL HAVE TRAFFIC BEARING RING & COVERS (H20).
- A SMOOTH FIT AND CONTINUOUS GRADE.
- AND PAVED AREAS.
- SPECIFICATIONS UNTIL A HEALTHY STAND OF GRASS IS OBTAINED.
- CONSTRUCTED TO SAME.
- 4" LOW FOR THE PLACEMENT OF SUITABLE TOPSOIL OR PLANTING MIX.

1. ALL CONSTRUCTION IN CITY/TOWN RIGHT-OF-WAYS AND/OR EASEMENTS SHALL BE IN

3. SITE CONTRACTOR SHALL PROTECT ALL BENCHMARKS AND PROPERTY MONUMENTATION AND SHALL REPLACE OR REPAIR, AT HIS OWN EXPENSE, BENCHMARKS AND

4. ALL STRIPING, PAVEMENT MARKINGS, AND TRAFFIC SIGNAGE SHALL BE IN ACCORDANCE WITH THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES, LATEST EDITION, UNLESS

5. ALL WORK SHALL COMPLY WITH FEDERAL, STATE AND LOCAL CODES AND ORDINANCES INCLUDING BUT NOT LIMITED TO: AASHTO, OSHA, EPA, DEP, MASSDOT, ETC. THE GENERAL CONTRACTOR SHALL APPLY FOR ALL PERMITS AND SHALL PAY ALL PERMIT RELATED FEES. ALL NECESSARY PERMITS SHALL BE OBTAINED PRIOR TO THE START OF

6. ALL DIMENSIONS AND CONDITIONS SHOWN ON THE DRAWINGS ARE TO BE VERIFIED BY THE CONTRACTOR. IF FIELD CONDITIONS VARY SIGNIFICANTLY ENOUGH TO REQUIRE A CHANGE TO THE CONTRACT DOCUMENTS, THE PROJECT PROPONENT AND ENGINEER SHALL

7. THE SITE/GENERAL CONTRACTOR AND SUBCONTRACTORS SHALL CONTACT THE OWNER AND ENGINEER SHOULD HE FIND ANY CONFLICT OR INCONSISTENCY BETWEEN THE WORK SHOWN ON THE DRAWINGS AND NORMAL ACCEPTED CONSTRUCTION PRACTICES, OR HE

8. ANY CORRECTIONS REQUIRED FOR REVISIONS TO THE CONTRACT DRAWINGS INITIATED BY THE GENERAL CONTRACTOR OR SUBCONTRACTORS WITHOUT PRIOR APPROVAL OF THE OWNER AND OR THE ENGINEER SHALL BE ACCOMPLISHED AT THE CONTRACTORS RISK.

MATERIAL NECESSARY TO PREPARE THE SITE FOR THE NEW CONSTRUCTION AS SHOWN ON

10. REPAIR DAMAGED CITY/TOWN ROADS AND CURBS IN ACCORDANCE WITH MASSDOT AND/OR

11. CONTRACTOR SHALL SAWCUT PAVEMENT EDGE WHERE PAVEMENT TO REMAIN IS ADJACENT

12. CONTRACTOR SHALL PREPARE SITE AS NECESSARY FOR CONSTRUCTION SHOWN ON THE

1. THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING UTILITIES AS SHOWN ON THESE PLANS IS BASED ON RECORDS OF THE VARIOUS UTILITY COMPANIES, AND WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THE INFORMATION IS NOT TO BE RELIED ON AS BEING EXACT OR COMPLETE. THE CONTRACTOR MUST CALL THE APPROPRIATE UTILITY COMPANIES AT LEAST 72 HOURS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATION OF UTILITIES. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH

2. ALL CUT OR FILL SLOPES SHALL BE 3:1 OR FLATTER UNLESS OTHERWISE NOTED.

4. EXISTING DRAINAGE STRUCTURES TO BE INSPECTED AND REPAIRED AS NEEDED, AND

6. PROPOSED GRADE CONTOUR INTERVALS SHOWN AT 1 FOOT INTERVALS.

BE THE CONTRACTORS RESPONSIBILITY TO REPAIR AND/OR REPLACE THE EXISTING STRUCTURE AS NECESSARY TO RETURN IT TO EXISTING CONDITIONS OR BETTER.

8. ALL STORM PIPE ENTERING STRUCTURES SHALL BE SEALED TO ASSURE CONNECTION AT

9. ALL STORM SEWER MANHOLES FRAMES AND GRATES ARE TO BE SET EQUAL TO FINISH

10. CONTRACTOR SHALL ADJUST AND/OR CUT EXISTING PAVEMENT AS NECESSARY TO ASSURE

11. CONTRACTOR SHALL ASSURE POSITIVE DRAINAGE AWAY FROM BUILDINGS FOR ALL NATURAL

12. ALL UNSURFACED AREAS DISTURBED BY GRADING OPERATION SHALL RECEIVE 4 INCHES OF TOPSOIL. CONTRACTOR SHALL APPLY STABILIZATION FABRIC TO ALL SLOPES 3H:1V OR STEEPER. CONTRACTOR SHALL GRASS DISTURBED AREAS IN ACCORDANCE WITH THE

13. CONSTRUCTION SHALL COMPLY WITH ALL APPLICABLE GOVERNING CODES AND BE

14. IF CONTRACTOR RELOCATES OR SETS NEW BENCHMARKS, THE VERTICAL ELEVATIONS OF THE BENCHMARKS SHALL BE SET WITHIN A TOLERANCE OF 0.010 FT.

15. CONTRACTOR SHALL LEAVE GRADE BEHIND CURB IN ALL PLANTER AREAS A MINIMUM OF

SITE UTILITY NOTES

- GENERAL: 1. ALL FILL MATERIAL IS TO BE IN PLACE, AND COMPACTED BEFORE INSTALLATION OF PROPOSED UTILITIES.
- 2. TOPS OF EXISTING MANHOLES SHALL BE SET EQUAL TO FINISH GRADE. IN GRASSED LANDSCAPED AREAS WITH WATER TIGHT LIDS.
- 3. ALL CONCRETE FOR ENCASEMENTS SHALL HAVE A MINIMUM 28 DAY COMPRESSION STRENGTH AT 3000 P.S.I.
- 4. DRAWINGS DO NOT PURPORT TO SHOW ALL EXISTING UTILITIES.
- 5. EXISTING UTILITIES SHALL BE VERIFIED IN FIELD PRIOR TO INSTALLATION OF ANY NEW LINES.
- 6. SITE/GENERAL CONTRACTOR IS RESPONSIBLE FOR COMPLYING TO THE SPECIFICATIONS OF THE LOCAL AUTHORITIES AT THE CITY WITH REGARD TO MATERIALS AND INSTALLATION OF THE WATER AND SEWER LINES.
- 7. THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING UTILITIES AS SHOWN ON THESE PLANS IS BASED ON RECORDS OF THE VARIOUS UTILITY COMPANIES, AND WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THE INFORMATION IS NOT TO BE RELIED ON AS BEING EXACT OR COMPLETE. THE CONTRACTOR MUST CALL THE APPROPRIATE UTILITY COMPANIES AT LEAST 72 HOURS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATION OF UTILITIES. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH CONFLICT WITH THE PROPOSED IMPROVEMENTS SHOWN ON THE PLANS.
- 8. CONTRACTOR SHALL COORDINATE WITH ALL UTILITY COMPANIES FOR INSTALLATION REQUIREMENTS AND SPECIFICATIONS.
- 9. CONTRACTOR SHALL COORDINATE INSPECTION OF UTILITY LINES WITH APPROPRIATE AUTHORITIES PRIOR TO BACKFILLING TRENCHES.
- 10. CONTRACTOR SHALL COMPLY WITH THE LATEST OSHA STANDARDS OR DIRECTIVES OR ANY OTHER AGENCY HAVING JURISDICTION FOR EXCAVATION AND TRENCHING PROCEDURES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE DESIGN AND MAINTENANCE OF ALL SUPPORT SYSTEMS, SLOPING, BENCHING, AND OTHER MEANS OF PROTECTION.
- 11. CONTRACTOR SHALL COORDINATE INSTALLATION OF UTILITIES WITH LOCAL COMPANIES TO AVOID CONFLICTS AND TO ASSURE THAT PROPER DEPTHS ARE ACHIEVED. CONTRACTOR SHALL COORDINATE WITH LOCAL UTILITY COMPANIES FOR EXACT LOCATION AND SCHEDULING OF CONNECTIONS TO THEIR FACILITIES.
- 12. THE LOCATION OF EXISTING UNDERGROUND UTILITIES ARE SHOWN IN AN APPROXIMATE WAY ONLY, DUE TO THE LACK OF AVAILABLE DOCUMENTATION. ALL UTILITIES, INCLUDING CURB BOXES, MAY NOT BE SHOWN ON THESE DRAWINGS. THE CONTRACTOR SHALL CALL THE "DIG SAFE CENTER" TO HAVE ALL UTILITIES MARKED ON THE GROUND PRIOR TO THE START OF CONSTRUCTION
- 13. THE CONTRACTOR SHALL BE RESPONSIBLE FOR DETERMINING THE EXACT LOCATION OF ALL EXISTING UTILITIES. THE CONTRACTOR SHALL BE FULLY RESPONSIBLE FOR ANY AND ALL DAMAGES WHICH OCCUR DUE TO HIS FAILURE TO LOCATE AND PRESERVE ANY AND ALL UNDERGROUND UTILITIES.
- 14. DO NOT INTERRUPT EXISTING UTILITIES WITHOUT AUTHORIZATION FROM THE OWNER. OWNERS OF ADJACENT PROPERTIES, AND THE CORRESPONDING UTILITY OWNER. CONTRACTOR SHALL ARRANGE TO SHUT OFF UTILITIES, AS REQUIRED, WITH THE UTILITY OWNERS.

15. COORDINATE UTILITY TERMINATION WITH UTILITY OWNERS.

SEWER:

- 1. SANITARY SEWER MAINS AND LATERALS SHALL BE PVC PIPE CONFORMING TO ASTM D 3034-SDR35. THE MINIMUM SIZE FOR SEWER MAINS SHAL BE 8"; SEWER LATERALS SHALL BE 4" MIN.
- 2. ALL SANITARY SEWERS, SEWER FORCE MAINS, AND SEWER LATERALS SHALL BE INSTALLED IN FIRST-CLASS BEDDING AND IN ACCORDANCE WITH THE DEPARTMENT PUBLIC WORKS SPECIFICATIONS. SEWERS SHALL BE INSTALLED TO THE LINE AND GRADE INDICATED ON THE PLANS.
- 3. ONLY PRECAST CONCRETE MANHOLES OF A DESIGN APPROVED BY THE TOWN ENGINEER SHALL BE INSTALLED ON A SANITARY SEWER MAIN.
- 4. NO GROUNDWATER OR SURFACE WATER SHALL BE DISCHARGED INTO THE SANITARY SFWFR.
- 5. WHERE ROCK IS ENCOUNTERED, IT SHALL BE REMOVED TO A DEPTH OF ONE FOOT BELOW THE FLOWLINE OF THE SEWER AND THE PIPE LAID IN A PROPERLY COMPACTED GRANULAR MATERIAL APPROVED BY THE TOWN ENGINEER.
- 6. ONLY GRANULAR MATERIAL APPROVED BY THE TOWN ENGINEER SHALL BE USED AS BACKFILL IN ANY TRENCH EXCAVATION.

WATER:

- 1. CONTRACTOR SHALL CONTACT THE CITY/TOWN WATER DEPARTMENT FOR SPECIFICATIONS AND MAKE OF VALVES, VALVE BOXES, FIRE HYDRANTS AND ALL OTHER WATER LINE APPURTENANCES.
- 2. WATER LINE TESTING AND STERILIZATION SHALL BE PERFORMED IN ACCORDANCE WITH LOCAL DPW SPECIFICATIONS AND WATER DISTRIBUTION SYSTEM. CONTRACTOR SHALL COORDINATE TESTING WITH THE CITY WATER DEPARTMENT.
- 3. ALL WATER MAIN SHALL BE DUCTILE IRON (D.I.), CLASS 52, AWWA C-151 (ANSI A21.40). D.I. PIPE SHALL BE DOUBLE CEMENT LINED WITH A SEAL COAT CONFORMING TO AWWA C-104 (ANSI A-21.4).
- 4. JOINTS FOR D.I. PIPE SHALL BE PUSH-ON OR OTHERWISE APPROVED, AWWA C151(ANSI A-21.51) WITH GASKETS CONFORMING TO AWWA C-111 (ANSI A-21.11) MAXIMUM LENGTH OF PIPE TO BE 20 L.F.
- 5. ALL FITTINGS SHALL BE DUCTILE IRON CLASS 53 WITH PRESSURE RATING OF 350 PSI AND MECHANICAL JOINTS CONFORMING TO AWWA C-151 (ANSI A21.51).
- 6. RETAINER GLANDS: RETAINER GLANDS SHALL BE DESIGNED TO IMPART MULTIPLE WEDGING ACTION AGAINST THE PIPE, INCREASE ITS RESISTANCE AS THE PRESSURE INCREASES. GLANDS SHALL BE MANUFACTURED OF DUCTILE IRON CONFORMING TO ASTM A536-80. RESTRAINING DEVICES SHALL BE DUCTILE IRON HEAT-TREATED TO A MINIMUM HARNESS OF 370 BHN. TWIST-OFF NUTS SHALL BE USED TO INSURE PROPER ACTUATING OF THE RETAINER GLAND. DIMENSIONS OF THE GLAND SHALL BE SUCH THAT IT CAN BE USED WITH THE STANDARD MECHANICAL JOINT BELL AND TEE-HEADED BOLTS CONFORMING TO ANSI/AWWA A21.1 AND ANSI/WWA 153/A21.5. THE RETAINER GLAND SHALL HAVE A WORKING PRESSURE OF 250 PSI WITH A MINIMUM SAFETY FACTOR OF 2:1 AND SHALL BE CERTIFIED BY THE MANUFACTURER TO BE COMPATIBLE WITH THE PIPE CLASS AND PIPE MANUFACTURER FOR ALL SIZES PROVIDED ON THE JOB. THE RETAINER GLAND SHALL BE MEGA-LUG AS MANUFACTURED EBAA IRON, INC., OR APPROVED EQUAL.
- 7. ALL WATER MAINS, UNLESS OTHERWISE NOTED, SHALL BE INSTALLED WITH A MINIMUM FIVE FEET OF COVER. WHEN CROSSING ABOVE OR BELOW WATER PIPELINES, A MINIMUM VERTICAL SEPARATION OF SIX INCHES SHALL BE PROVIDED. WHEN CROSSING SANITARY SEWERS, A MINIMUM OF 18" SHALL BE PROVIDED.

SITE UTILITY NOTES (CONTINUED)

8. THE INSTALLED WATER MAIN SHALL BE PRESSURE TESTED, FLUSHED AND DISINFECTED BY CONTRACTOR IN ACCORDANCE WITH AWWA C-600 AND AWWA C-651 OR PER CITY/TOWN WATER DEPARTMENT STANDARDS.

9. DUCTILE IRON PIPES SHALL BE INSTALLED IN ACCORDANCE WITH AWWA C-600. 10. ALL MECHANICAL JOINTS ARE TO BE RESTRAINED. FITTINGS SHALL BE RESTRAINED BY MECHANICAL JOINT RESTRAINTS. THE PIPE CONNECTED TO THE FITTING SHALL BE RESTRAINED PER THE MANUFACTURER'S SCHEDULE.

11. THE CONTRACTOR SHALL MARK THE LOCATION OF THE PROPOSED WATER MAIN AT LEAST 48 HOURS PRIOR TO EXCAVATING. EXCAVATION SHALL NOT PROCEED WITHOUT AUTHORIZATION BY THE ENGINEER.

12. ALL WATER MAINS, HYDRANT BRANCHES, AND SERVICES SHALL HAVE UTILITY WARNING TAPE. THE TAPE SHALL BE BURIED APPROXIMATELY 2 FEET BELOW FINISHED GRADE.

13. BACKFILL SHALL BE COMPACTED TO 95 PERCENT OF THE STANDARD PROCTOR DENSITY AS DETERMINED BY ASTM D698. COMPACTION EQUIPMENT USED MUST BE SPECIFICALLY DESIGNED FOR COMPACTION. TAMPING WITH THE BACK OF THE BACK HOE BUCKET IS UNACCEPTABLE COMPACTION.

14. ALL WATER SERVICES SHALL BE 1" DIA. COPPER TUBING TYPE K, SOFT TEMPER CONFORMING TO ASTM B88 UNLESS OTHERWISE NOTED.

15. DEPRESS WATER MAIN UNDER EXISTING SERVICES AND HYDRANT BRANCHES TO MAINTAIN 5'-0" OF COVER.

16. ALL WATER MAINS SHALL BE LAID PER THE PLANS TO MAINTAIN THE MAXIMUM SEPARATION FROM EXISTING OR PROPOSED SANITARY SEWER. DISTANCE SHALL BE MEASURED EDGE TO EDGE.

17. IDENTIFY EACH PIPE LENGTH & FITTING CLEARLY WITH MANUFACTURE'S NAME & TRADEMARK. NOMINAL PIPE SIZE & MATERIAL DESIGNATION.

18. ALL WATER MAINS & SERVICE PIPES SHALL BE LAID IN A TRENCH SEPARATE FROM ANY OTHER UTILITY (GAS, ELECTRIC, TELEPHONE, ETC.) SHALL BE A MINIMUM NO LESS THAN FIVE (5) FEET FROM ANOTHER UTILITY.

19. ALL MATERIAL SHALL BE IN ACCORDANCE WITH CITY/TOWN WATER DEPARTMENT "RULES & REGULATIONS". ALL WORK TO BE PERFORMED IN ACCORDANCE WITH CITY/TOWN WATER DEPARTMENT "SPECIFICATIONS". CITY/TOWN WATER DEPARTMENT STANDARDS SHALL TAKE PRECEDENCE OVER ANY REQUIREMENTS LISTED ABOVE.

RLEV ASSOC Landscap Civil Engineers Environmen ph: 413.568.0985 40 Sch Westfield	De Architects · Land Surve tal Consultar	eyors hts 568.0986
CONSTRUCTION NOTES	362-368 PARKER STREET PARCELID: 75-10-14 75-11-0 63-26-0 and 62-31-A+R	W MA.
PREPARED FOR: Bretta Con 32 East	DF MASSICIE PE J. AVO WIL 48376 TERES MALENTING	1/23
ISSUANCE DATE: REVISIONS:	. & R.E.L. D ALTERATION	
SCALE: As Noted RLA PROJ. NUMB	ER: 230113	REV.

East Longmeadow Planning Board

Action Taken

Application Filed

Preliminary Plan Filed


Definitive Plan Filed

Approval of Board of Health

Names of Planning Board Members

Public Hearing

Plan Approved Plan Endorsed

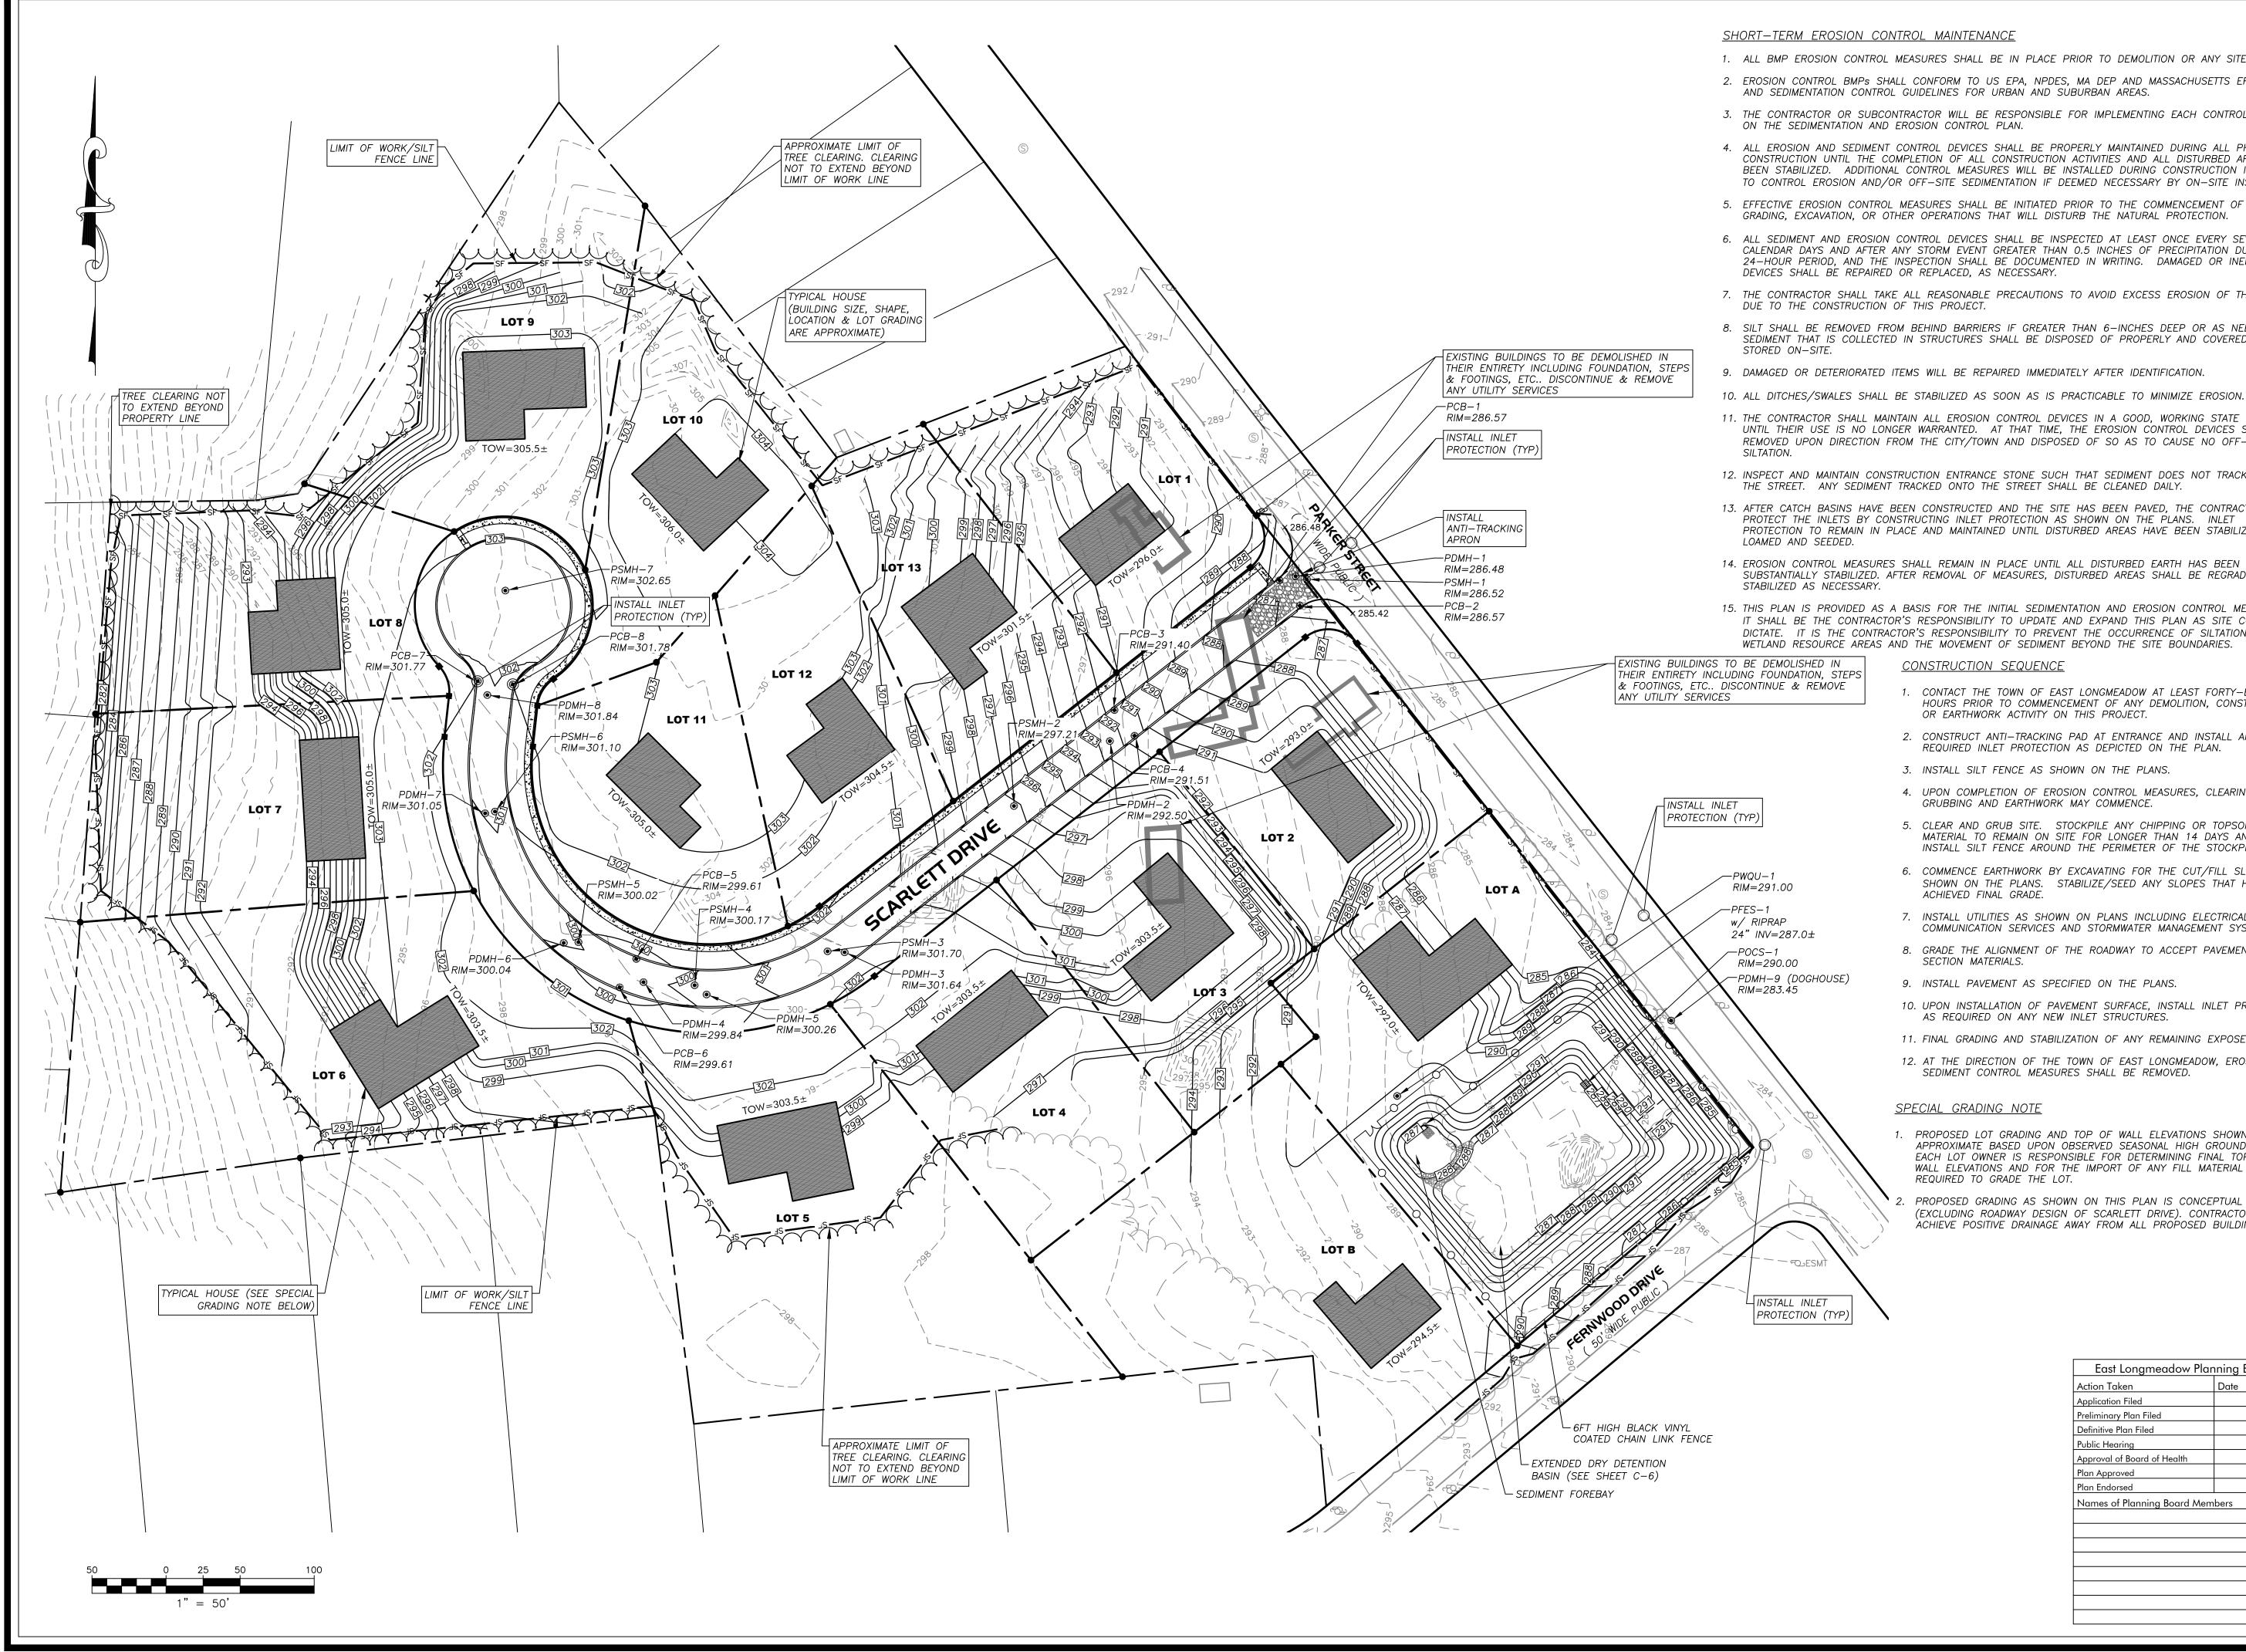

SHORT-TERM EROSION CONTROL MAINTENANCE

1. ALL BMP EROSION CONTROL MEASURES SHALL BE IN PLACE PRIOR TO DEMOLITION OR ANY SITE WORK. 2. EROSION CONTROL BMPs SHALL CONFORM TO US EPA, NPDES, MA DEP AND MASSACHUSETTS EROSION

3. THE CONTRACTOR OR SUBCONTRACTOR WILL BE RESPONSIBLE FOR IMPLEMENTING EACH CONTROL SHOWN ON THE SEDIMENTATION AND EROSION CONTROL PLAN.

4. ALL EROSION AND SEDIMENT CONTROL DEVICES SHALL BE PROPERLY MAINTAINED DURING ALL PHASES OF CONSTRUCTION UNTIL THE COMPLETION OF ALL CONSTRUCTION ACTIVITIES AND ALL DISTURBED AREAS HAVE BEEN STABILIZED. ADDITIONAL CONTROL MEASURES WILL BE INSTALLED DURING CONSTRUCTION IN ORDER TO CONTROL EROSION AND/OR OFF-SITE SEDIMENTATION IF DEEMED NECESSARY BY ON-SITE INSPECTION.

5. EFFECTIVE EROSION CONTROL MEASURES SHALL BE INITIATED PRIOR TO THE COMMENCEMENT OF CLEARING, GRADING, EXCAVATION, OR OTHER OPERATIONS THAT WILL DISTURB THE NATURAL PROTECTION.

6. ALL SEDIMENT AND EROSION CONTROL DEVICES SHALL BE INSPECTED AT LEAST ONCE EVERY SEVEN (7) CALENDAR DAYS AND AFTER ANY STORM EVENT GREATER THAN 0.5 INCHES OF PRECIPITATION DURING ANY 24-HOUR PERIOD, AND THE INSPECTION SHALL BE DOCUMENTED IN WRITING. DAMAGED OR INEFFECTIVE DEVICES SHALL BE REPAIRED OR REPLACED, AS NECESSARY.

7. THE CONTRACTOR SHALL TAKE ALL REASONABLE PRECAUTIONS TO AVOID EXCESS EROSION OF THE SITE DUE TO THE CONSTRUCTION OF THIS PROJECT.

8. SILT SHALL BE REMOVED FROM BEHIND BARRIERS IF GREATER THAN 6-INCHES DEEP OR AS NEEDED. SEDIMENT THAT IS COLLECTED IN STRUCTURES SHALL BE DISPOSED OF PROPERLY AND COVERED IF STORED ON-SITE.

9. DAMAGED OR DETERIORATED ITEMS WILL BE REPAIRED IMMEDIATELY AFTER IDENTIFICATION.

11. THE CONTRACTOR SHALL MAINTAIN ALL EROSION CONTROL DEVICES IN A GOOD, WORKING STATE OF REPAIR UNTIL THEIR USE IS NO LONGER WARRANTED. AT THAT TIME, THE EROSION CONTROL DEVICES SHALL BE REMOVED UPON DIRECTION FROM THE CITY/TOWN AND DISPOSED OF SO AS TO CAUSE NO OFF-SITE

12. INSPECT AND MAINTAIN CONSTRUCTION ENTRANCE STONE SUCH THAT SEDIMENT DOES NOT TRACK ONTO THE STREET. ANY SEDIMENT TRACKED ONTO THE STREET SHALL BE CLEANED DAILY.

13. AFTER CATCH BASINS HAVE BEEN CONSTRUCTED AND THE SITE HAS BEEN PAVED, THE CONTRACTOR SHALL PROTECT THE INLETS BY CONSTRUCTING INLET PROTECTION AS SHOWN ON THE PLANS. INLET PROTECTION TO REMAIN IN PLACE AND MAINTAINED UNTIL DISTURBED AREAS HAVE BEEN STABILIZED, LOAMED AND SEEDED.

14. EROSION CONTROL MEASURES SHALL REMAIN IN PLACE UNTIL ALL DISTURBED EARTH HAS BEEN SUBSTANTIALLY STABILIZED. AFTER REMOVAL OF MEASURES, DISTURBED AREAS SHALL BE REGRADED AND STABILIZED AS NECESSARY.

15. THIS PLAN IS PROVIDED AS A BASIS FOR THE INITIAL SEDIMENTATION AND EROSION CONTROL MEASURES. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO UPDATE AND EXPAND THIS PLAN AS SITE CONDITIONS DICTATE. IT IS THE CONTRACTOR'S RESPONSIBILITY TO PREVENT THE OCCURRENCE OF SILTATION TO WETLAND RESOURCE AREAS AND THE MOVEMENT OF SEDIMENT BEYOND THE SITE BOUNDARIES.

CONSTRUCTION SEQUENCE

DEMOLISHED IN OUNDATION, STEPS NUE & REMOVE	

- FOJESN


- 1. CONTACT THE TOWN OF EAST LONGMEADOW AT LEAST FORTY-EIGHT HOURS PRIOR TO COMMENCEMENT OF ANY DEMOLITION, CONSTRUCTION, OR EARTHWORK ACTIVITY ON THIS PROJECT.
- 2. CONSTRUCT ANTI-TRACKING PAD AT ENTRANCE AND INSTALL ANY REQUIRED INLET PROTECTION AS DEPICTED ON THE PLAN.
- 3. INSTALL SILT FENCE AS SHOWN ON THE PLANS.
- 4. UPON COMPLETION OF EROSION CONTROL MEASURES, CLEARING AND GRUBBING AND EARTHWORK MAY COMMENCE.
- 5. CLEAR AND GRUB SITE. STOCKPILE ANY CHIPPING OR TOPSOIL MATERIAL TO REMAIN ON SITE FOR LONGER THAN 14 DAYS AND INSTALL SILT FENCE AROUND THE PERIMETER OF THE STOCKPILE.
- 6. COMMENCE EARTHWORK BY EXCAVATING FOR THE CUT/FILL SLOPES AS SHOWN ON THE PLANS. STABILIZE/SEED ANY SLOPES THAT HAVE ACHIEVED FINAL GRADE.
- 7. INSTALL UTILITIES AS SHOWN ON PLANS INCLUDING ELECTRICAL AND COMMUNICATION SERVICES AND STORMWATER MANAGEMENT SYSTEM.
- 8. GRADE THE ALIGNMENT OF THE ROADWAY TO ACCEPT PAVEMENT SECTION MATERIALS.
- 9. INSTALL PAVEMENT AS SPECIFIED ON THE PLANS.
- 10. UPON INSTALLATION OF PAVEMENT SURFACE, INSTALL INLET PROTECTION AS REQUIRED ON ANY NEW INLET STRUCTURES.
- 11. FINAL GRADING AND STABILIZATION OF ANY REMAINING EXPOSED AREAS.
- 12. AT THE DIRECTION OF THE TOWN OF EAST LONGMEADOW, EROSION AND SEDIMENT CONTROL MEASURES SHALL BE REMOVED.

SPECIAL GRADING NOTE

- 1. PROPOSED LOT GRADING AND TOP OF WALL ELEVATIONS SHOWN ARE APPROXIMATE BASED UPON OBSERVED SEASONAL HIGH GROUNDWATER. EACH LOT OWNER IS RESPONSIBLE FOR DETERMINING FINAL TOP OF WALL ELEVATIONS AND FOR THE IMPORT OF ANY FILL MATERIAL REQUIRED TO GRADE THE LOT.
- PROPOSED GRADING AS SHOWN ON THIS PLAN IS CONCEPTUAL (EXCLUDING ROADWAY DESIGN OF SCARLETT DRIVE). CONTRACTOR SHALL ACHIEVE POSITIVE DRAINAGE AWAY FROM ALL PROPOSED BUILDINGS.

East Longmeadow Plar	nning Board
Action Taken	Date
Application Filed	
Preliminary Plan Filed	
Definitive Plan Filed	
Public Hearing	
Approval of Board of Health	
Plan Approved	
Plan Endorsed	
Names of Planning Board Mem	bers

GRADING, EROSION & SEDIMENTATION CONTROL PLAN	362-368 Parker Street Parcel ID: 75-10-14,75-11-0,63-26-0 and 62-31-A+B East Longmeadow Ma.	
PREPARED FOR:		
Bretta Construction LLC 32 Eastwood Drive Wilbraham, MA. ISSUANCE DATE: November 17, 2023 REVISIONS: DATE: Instruction Instruction Instruction Instruction Instruction Instruction Instruction Instruction Instruction		
DRAFTED BY: t.a. & R.E.L. UNAUTHORIZED ALTERATION OF THIS DOCUMENT IS A VIOLATION OF MASSACHUSETTS STATE LAW SCALE: As Noted RLA PROJ. NUMBER: 230113 DRAWING# REV.		

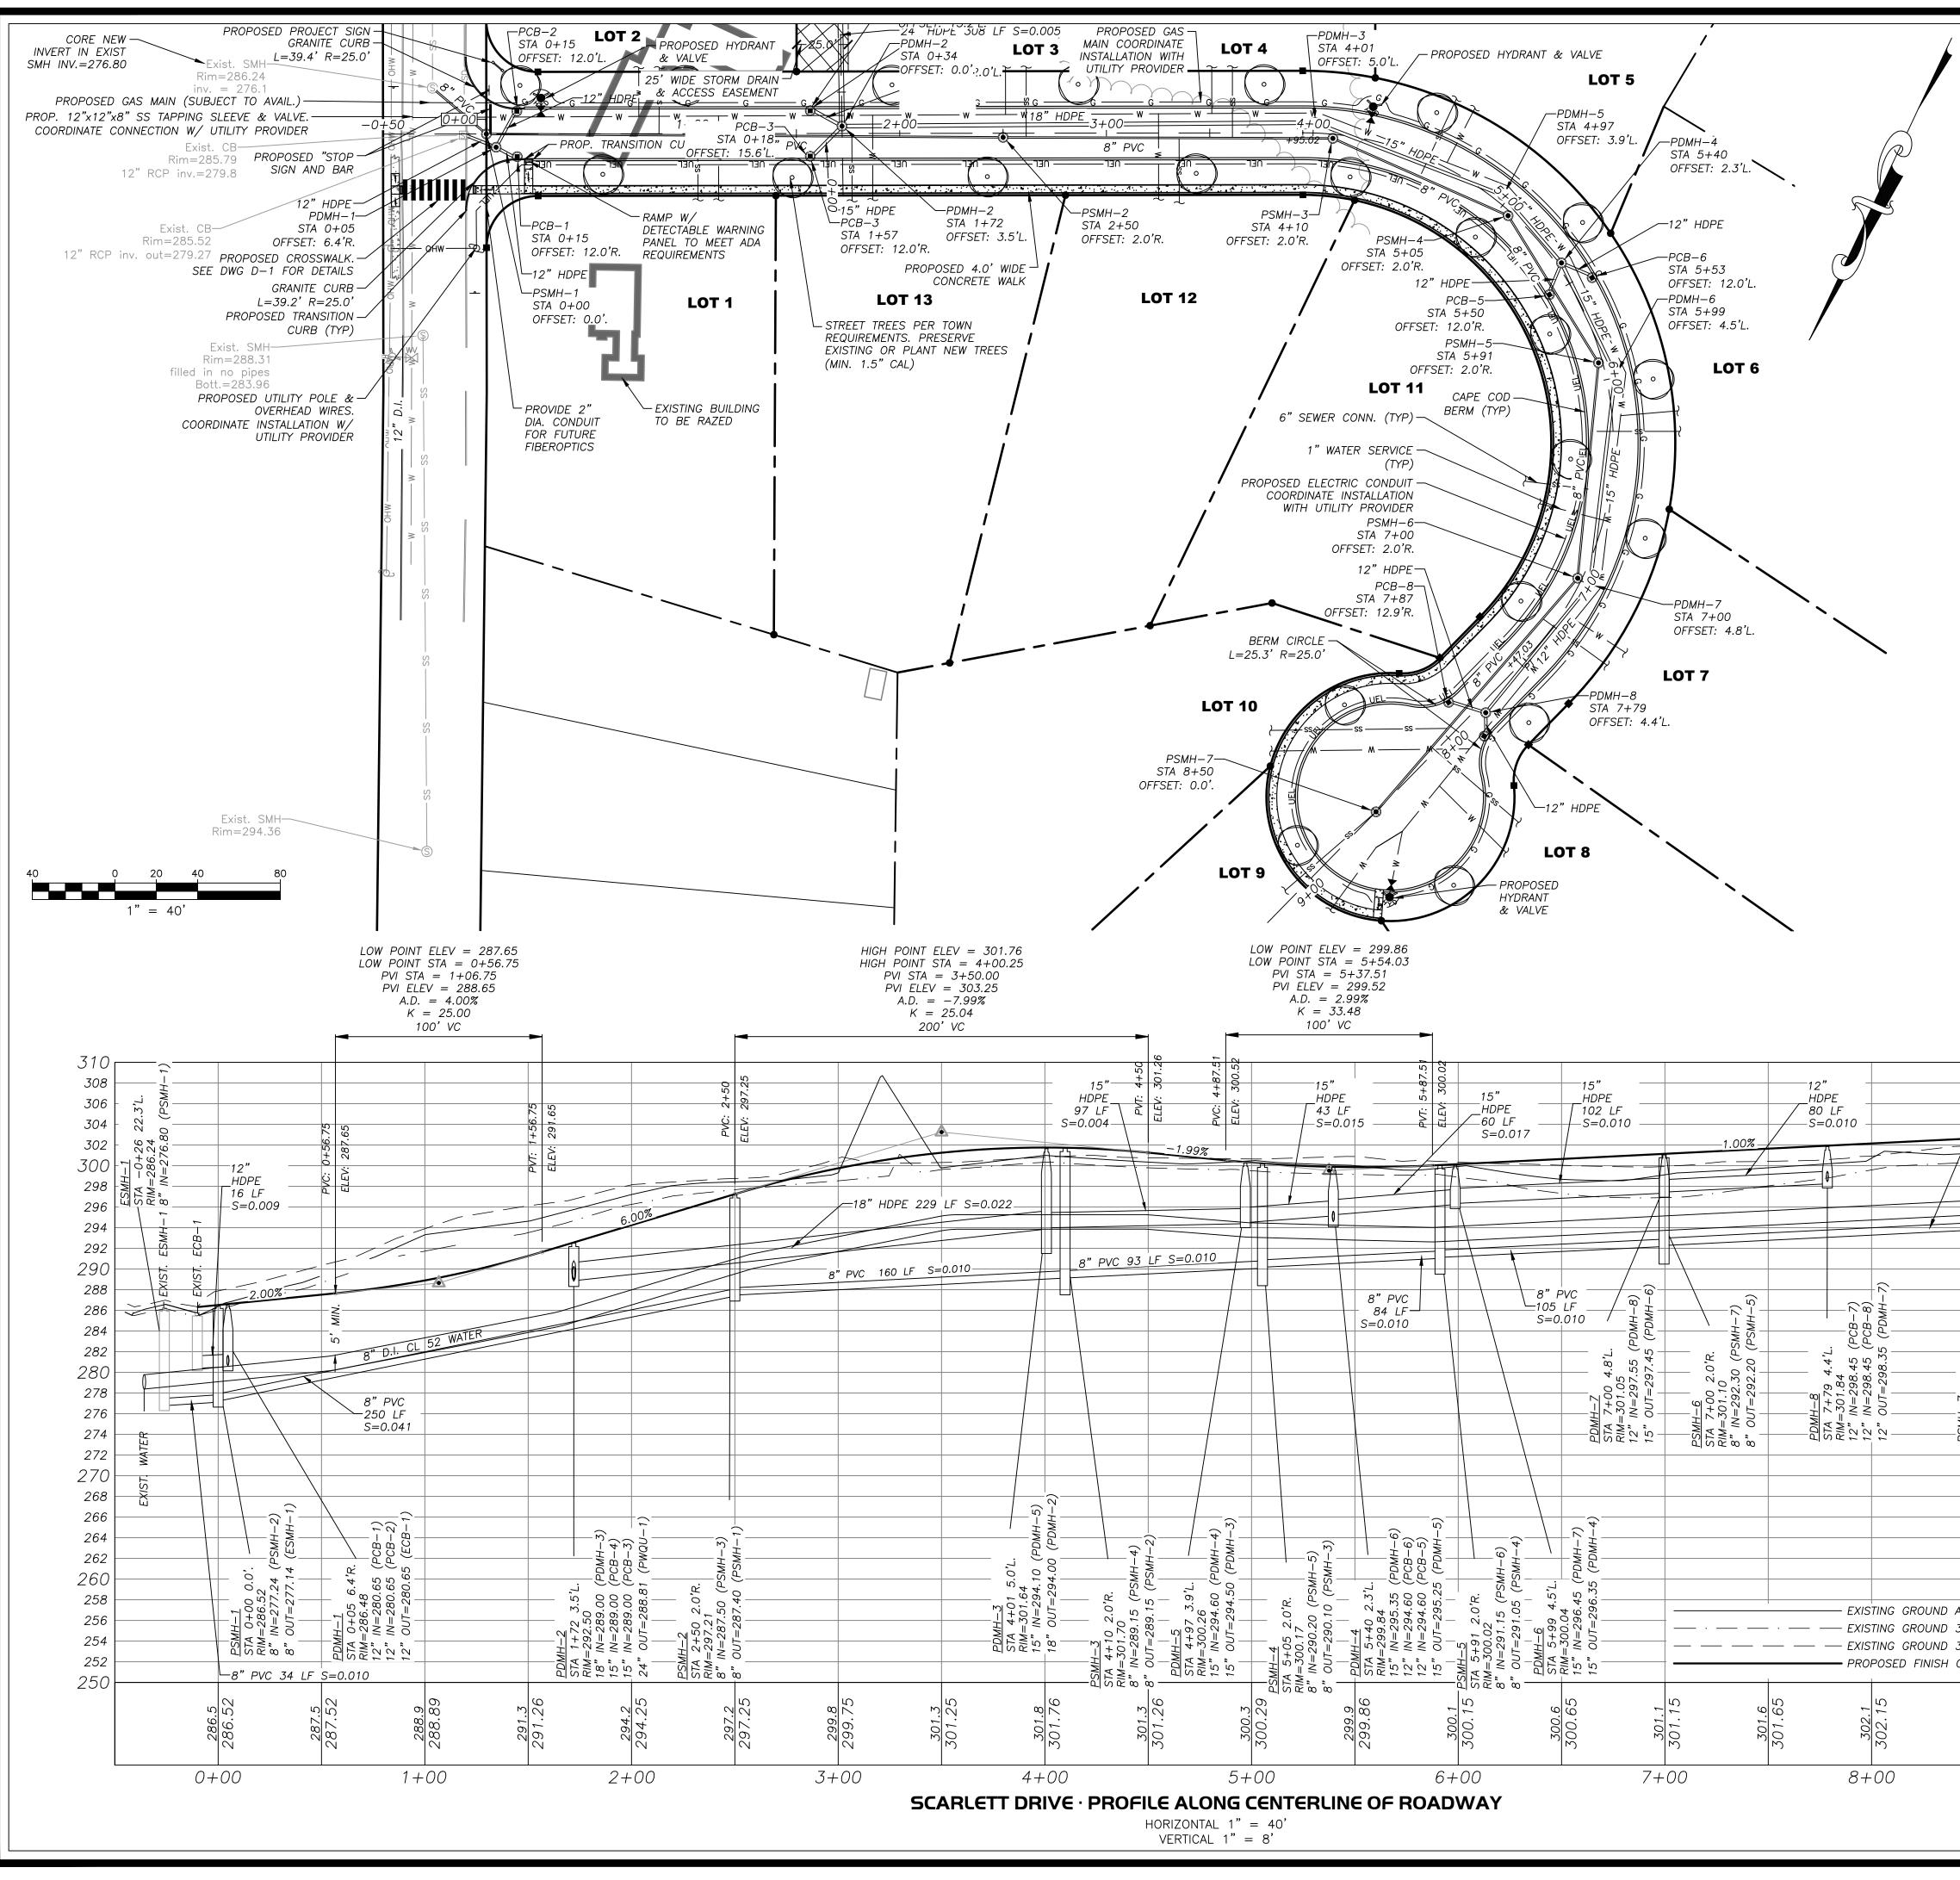

S:\Projects\2023\230113 - Bretta -362 & 368 Parker Street - East Longmeadow\05 Civil 3D\230113 - Definitive.dwg

GENERAL NOTES

- 1. THE CONTRACTOR SHALL OBTAIN A LETTER OF APPROVAL FROM DPW PRIOR TO ANY CONSTRUCTION WITHIN THE RIGHT-OF-WAY.
- 2. ALL WATER CONSTRUCTION SHALL CONFORM TO THE TOWN OF EAST LONGMEADOW REQUIREMENTS.
- 3. ALL WATER CONSTRUCTION SHALL BE INSPECTED BY THE TOWN OF EAST LONGMEADOW DPW BEFORE BEING BACKFILLED. TOWN SHALL BE NOTIFICED AT LEAST 24 HOURS PRIOR TO THE REQUIRED INSPECTIONS.


LANDSCAPE NOTES


- 1. STREET TREE SELECTION SHALL BE APPROVED BY THE DEPARTMENT OF PUBLIC WORKS.
- 2. PLANTING PERIOD SHALL BE NOTED AS MARCH 15 TO MAY 15 AND SEPTEMBER 15 TO NOVEMBER 15, WEATHER PERMITTING.

ALL MATERIALS AND CONSTRUCTION METHODS TO CONFORM TO TOWN OF EAST LONGMEADOW PLANNING BOARD REGULATIONS AND BOARD OF PUBLIC WORKS SPECIFICATIONS


8" PVC 149 LF S=0.010 END OF WATER MAIN	310 308 306 304 302 300 298 296 294 292 290 288 286 286 284
	- 292
<u> </u>	- 282
PSMH-Z -STA 8+50 0.0'. RIM=302.65 8" OUT=293.80 (- 280
= 2965	278
	276
8 RIA 8	274
	_ 272
1" _ 0"	270
1" = 8"	268
4 0 8	266
1" = 40"	264
20 0 40	
	260
ALONG CENTERLINE	- 258
30' SOUTHERLY OF CENTERLINE	256
30' NORTHERLY OF CENTERLINE	— 254 — 252
GRADE ALONG CENTERLINE	250
302.65	
9+00 9	 +50

East Longmeadow Planning Board					
Action Taken	Date				
Application Filed					
Preliminary Plan Filed					
Definitive Plan Filed					
Public Hearing					
Approval of Board of Health					
Plan Approved					
Plan Endorsed					
Names of Planning Board Members					

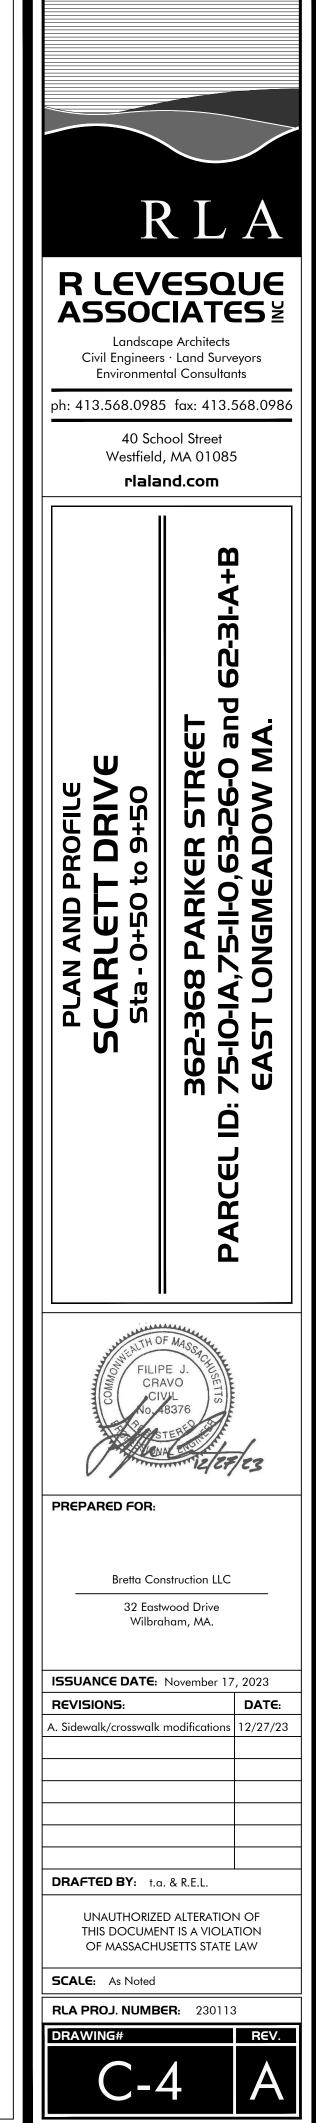


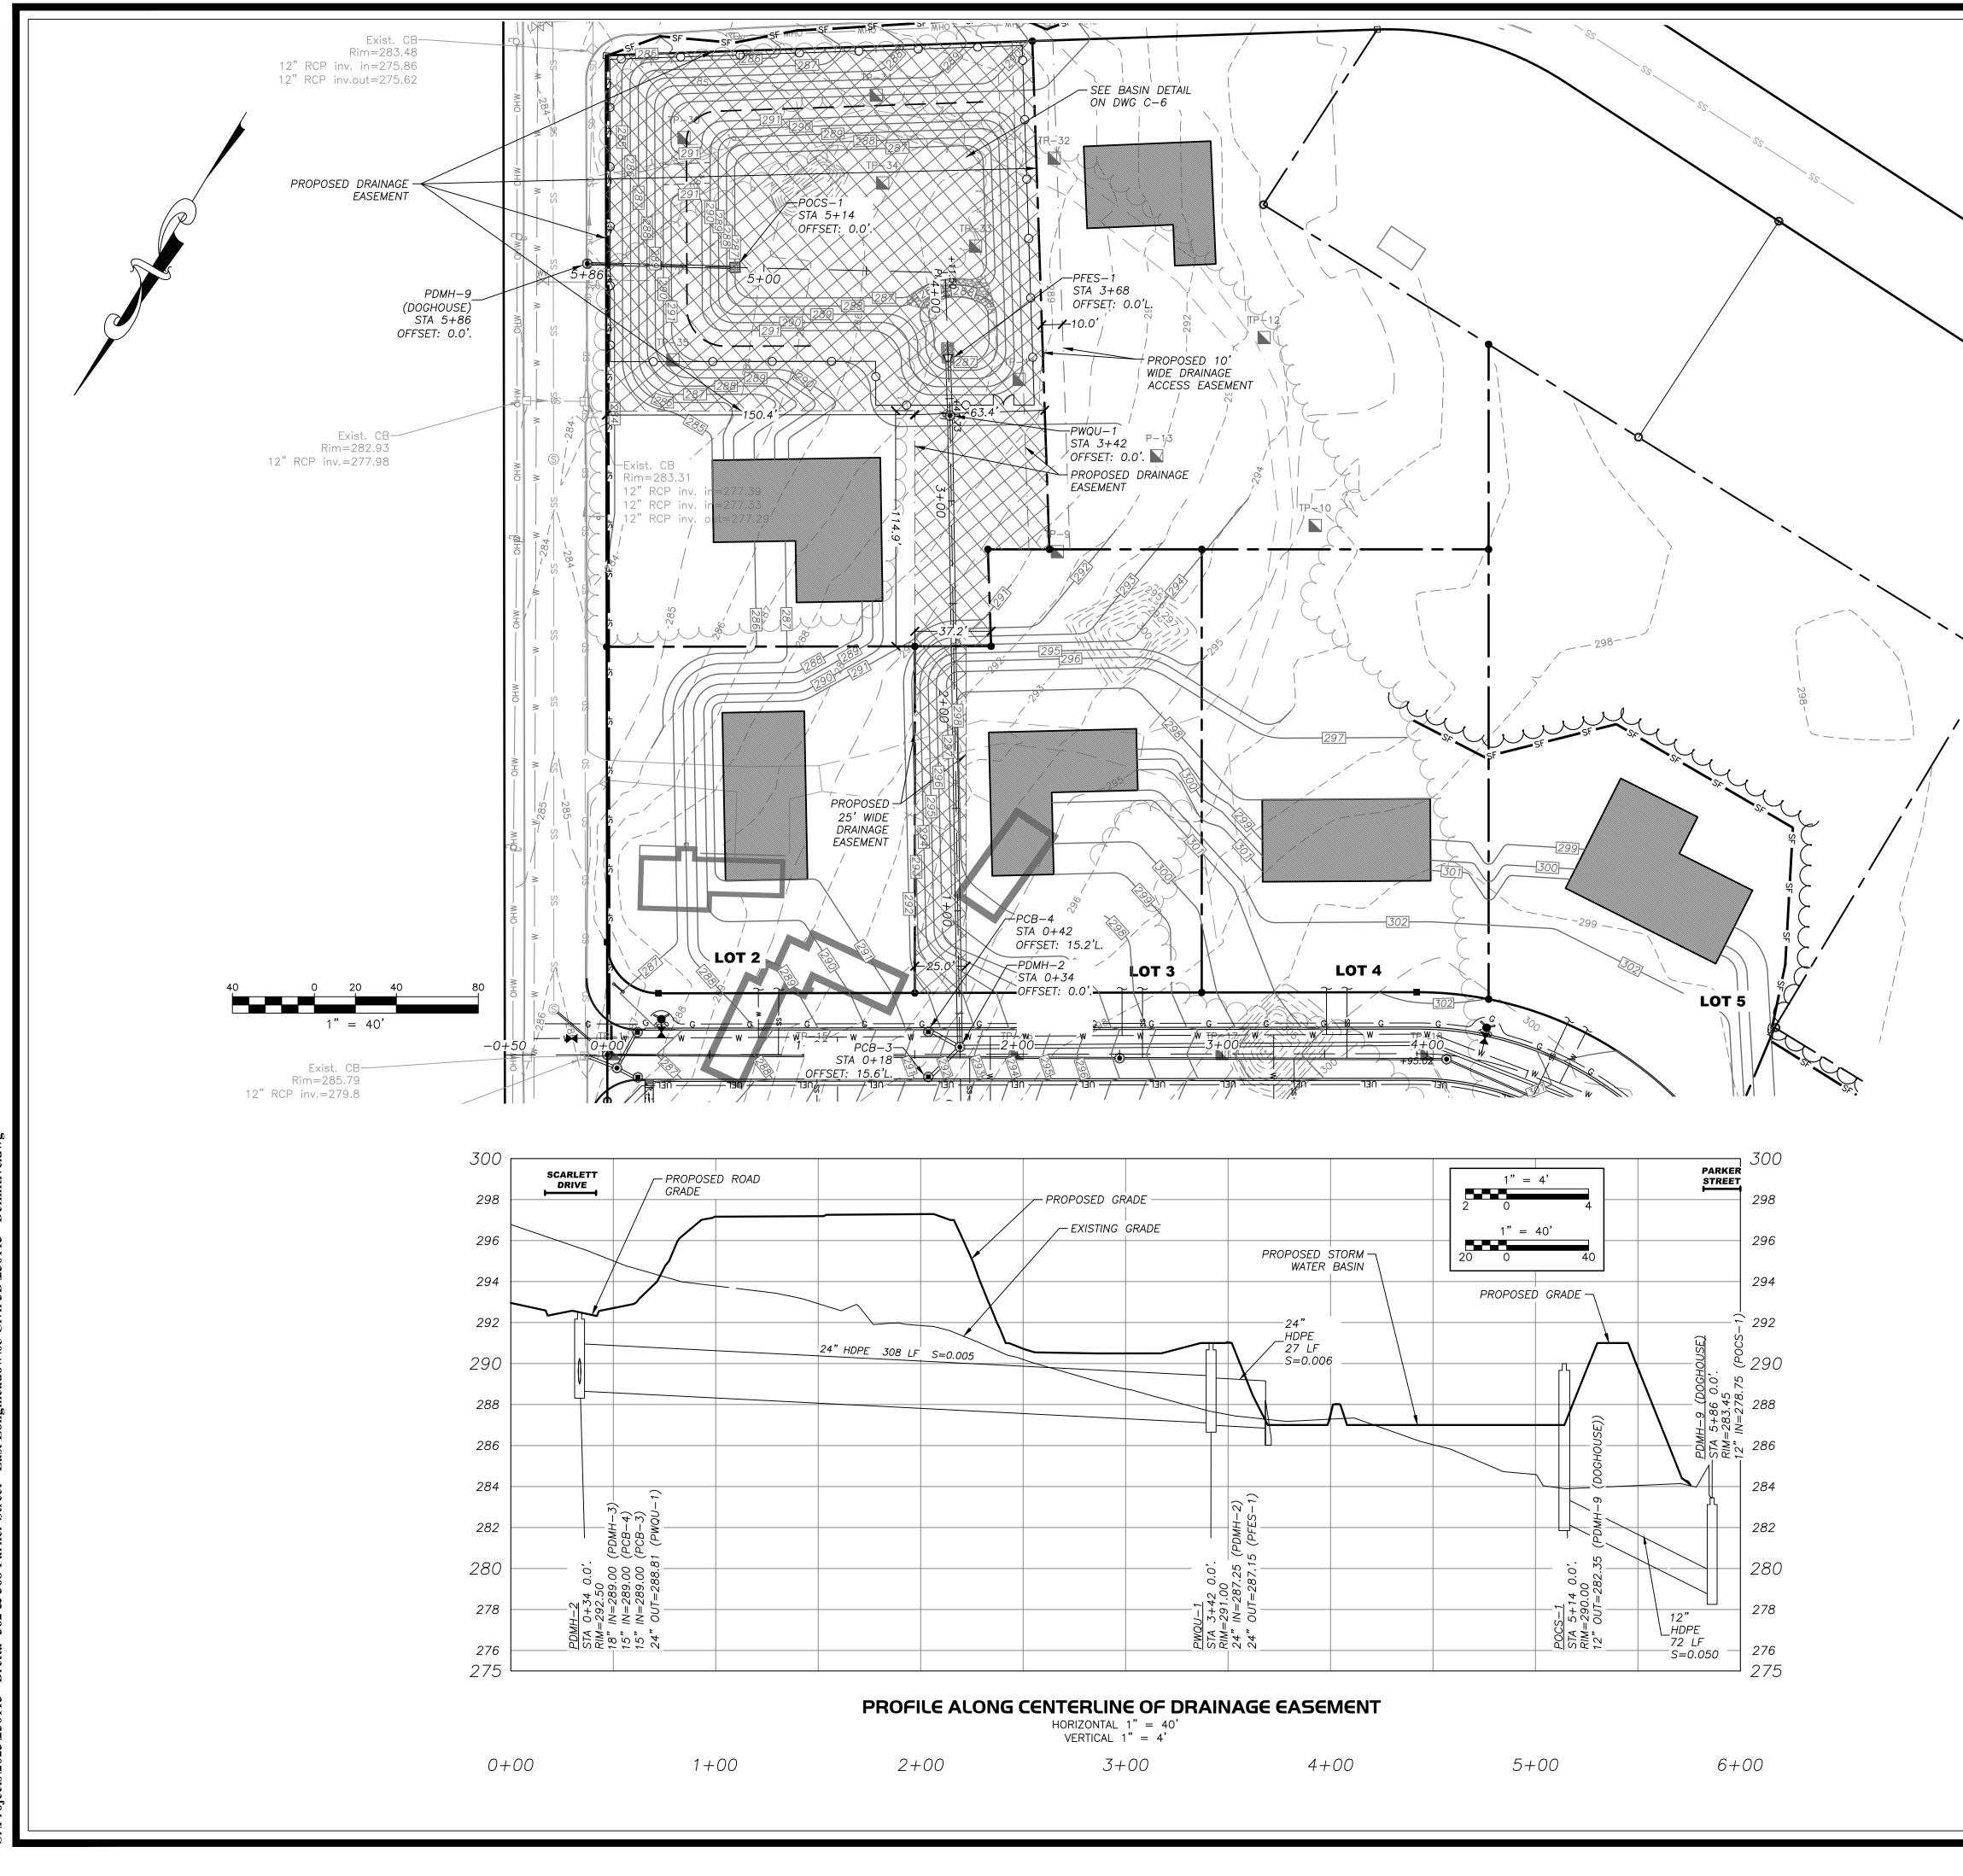



	VERTICAL $1'' = 4'$				
0	3+00	4+00	5+00	6-	

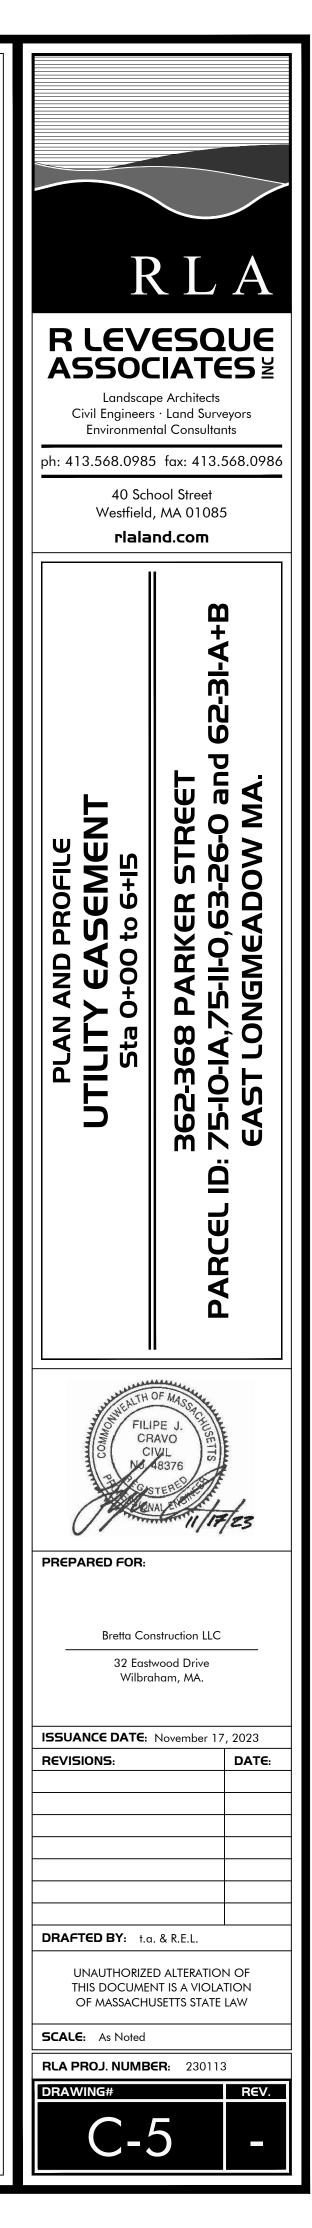



East Longmeadow Planning Board				
Action Taken	Date			
Application Filed				
Preliminary Plan Filed				
Definitive Plan Filed				
Public Hearing				
Approval of Board of Health				
Plan Approved				
Plan Endorsed				
Names of Planning Board Mem	bers			

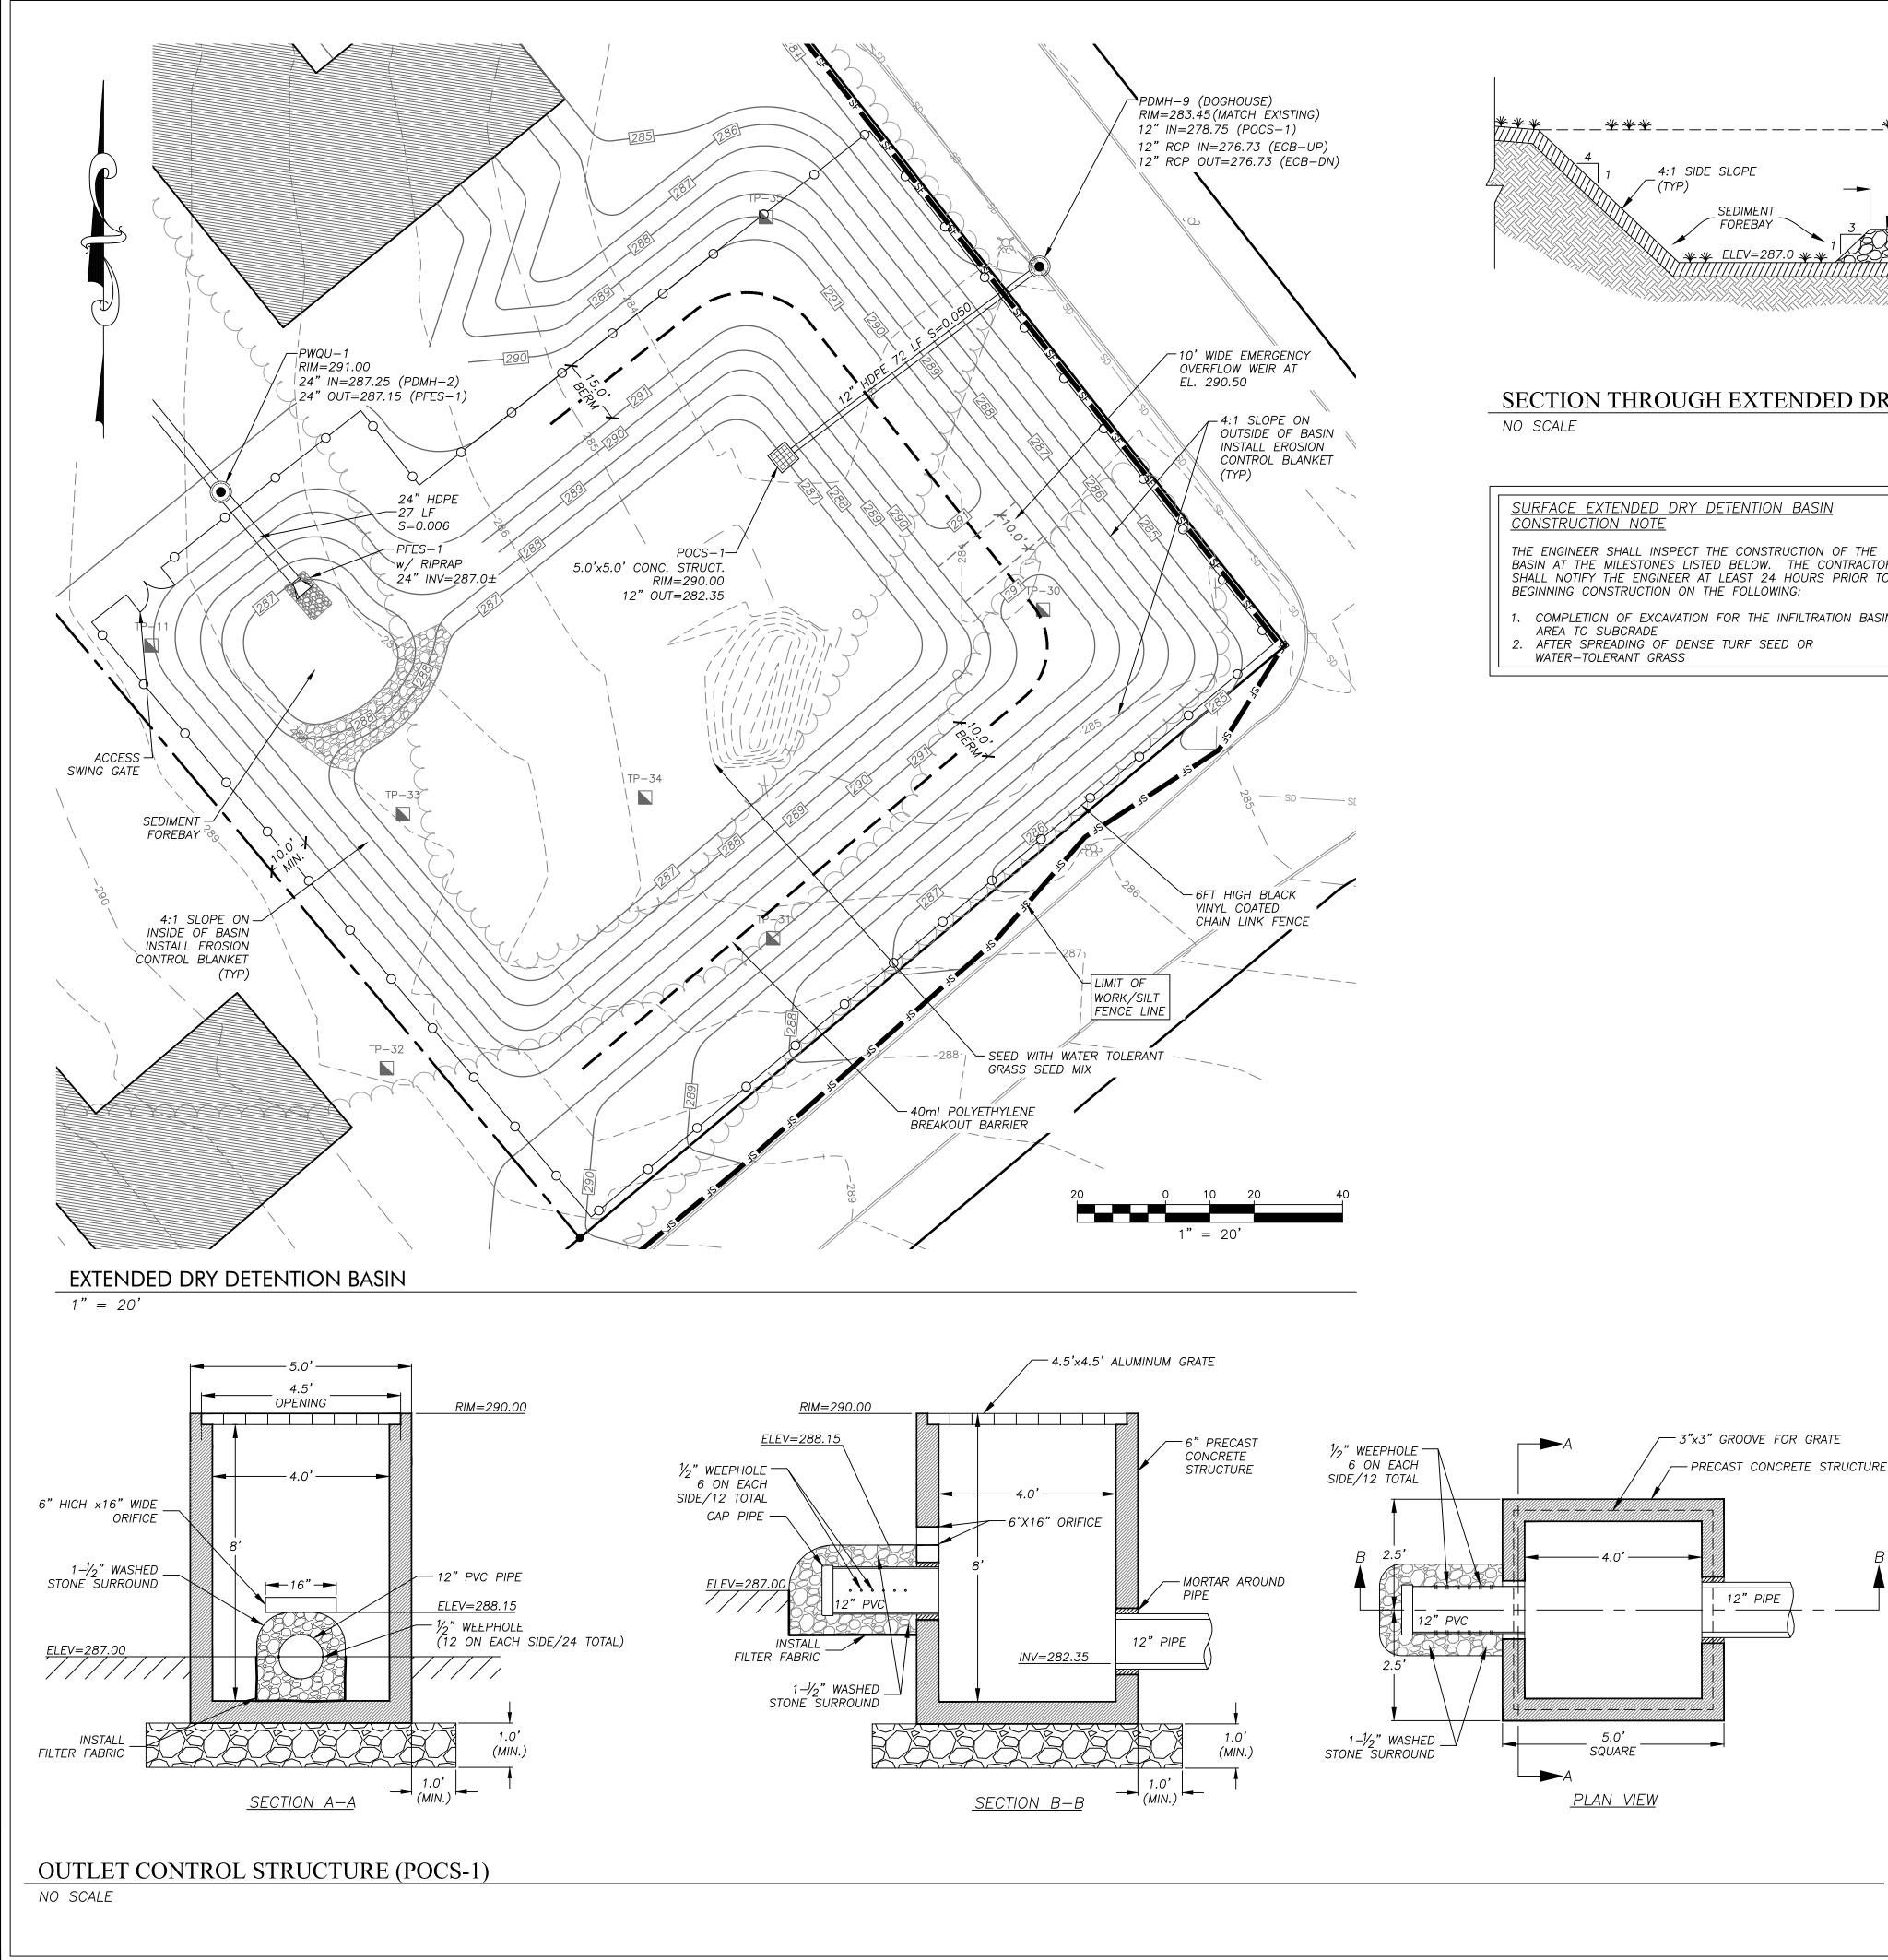

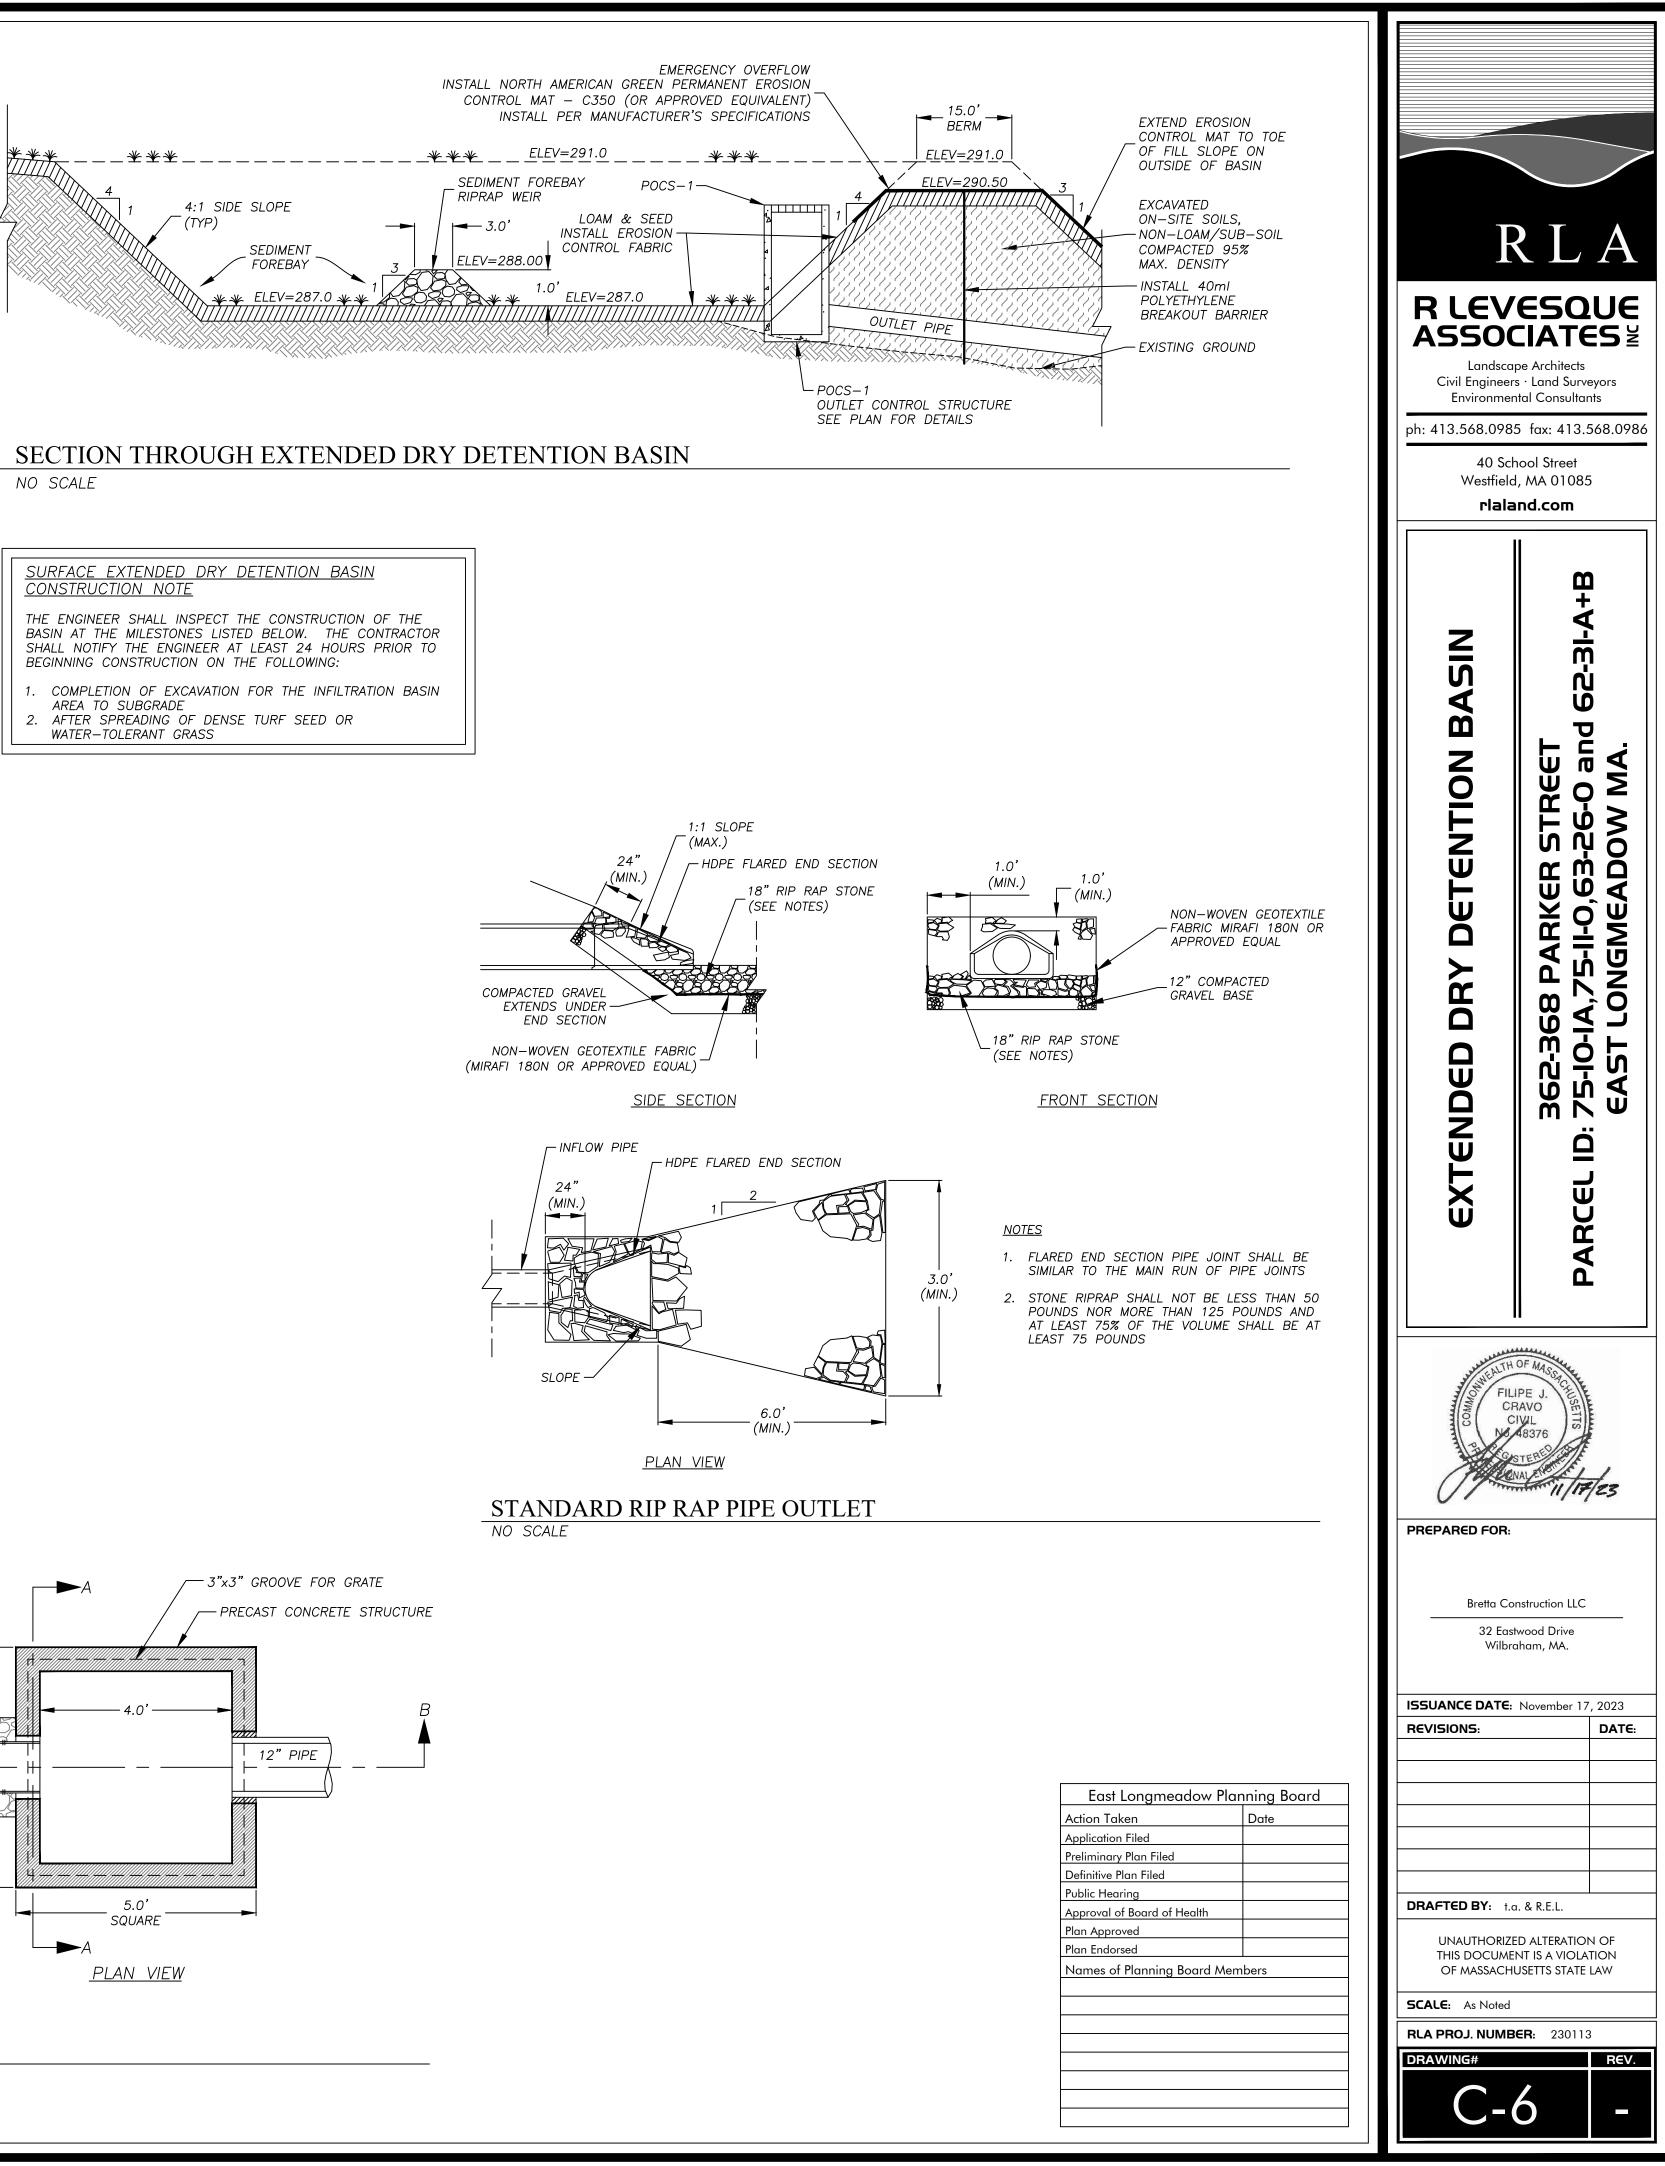


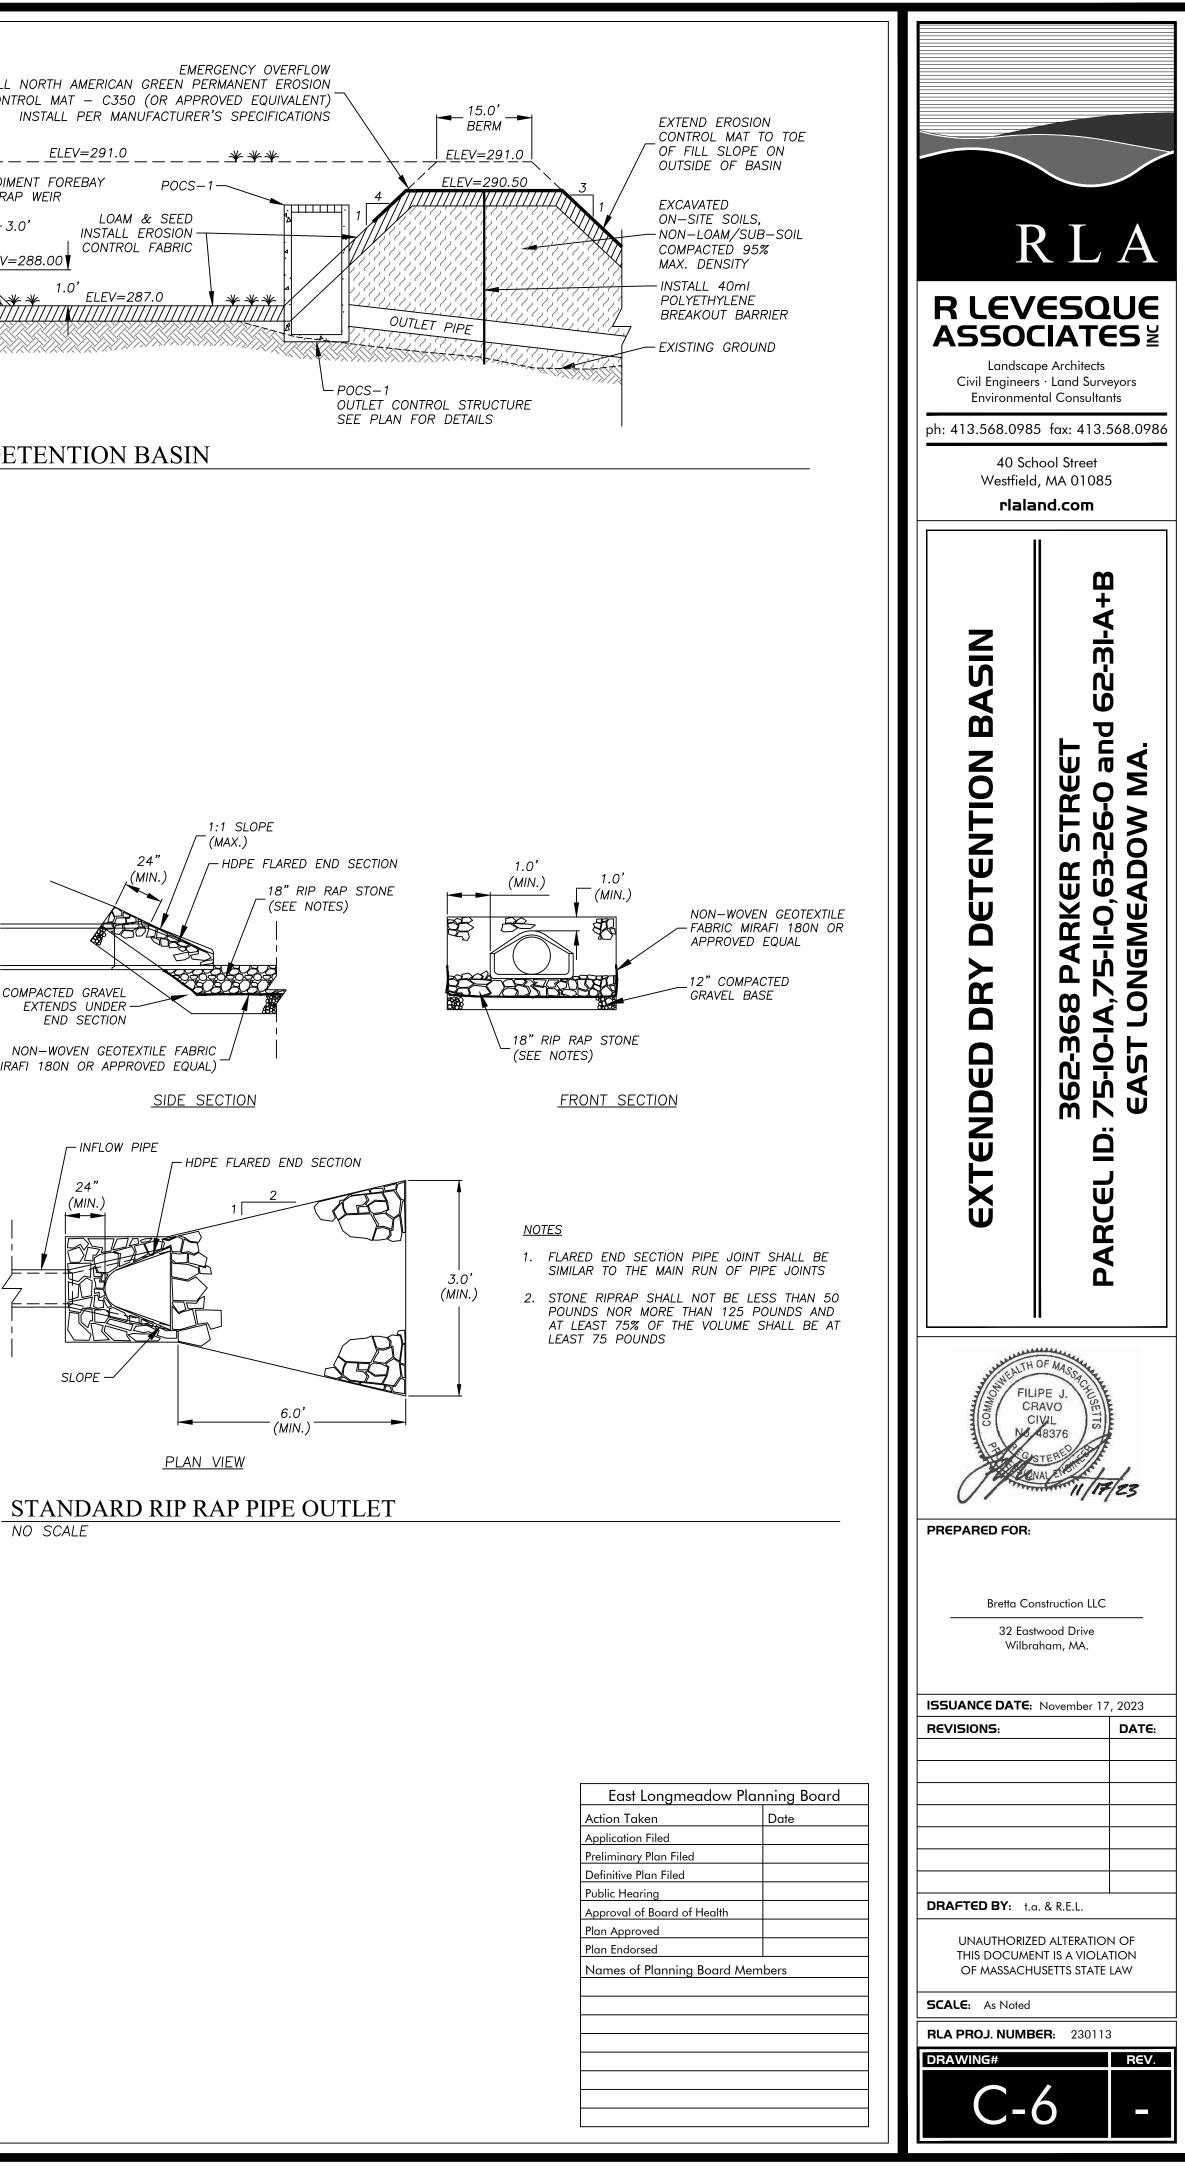

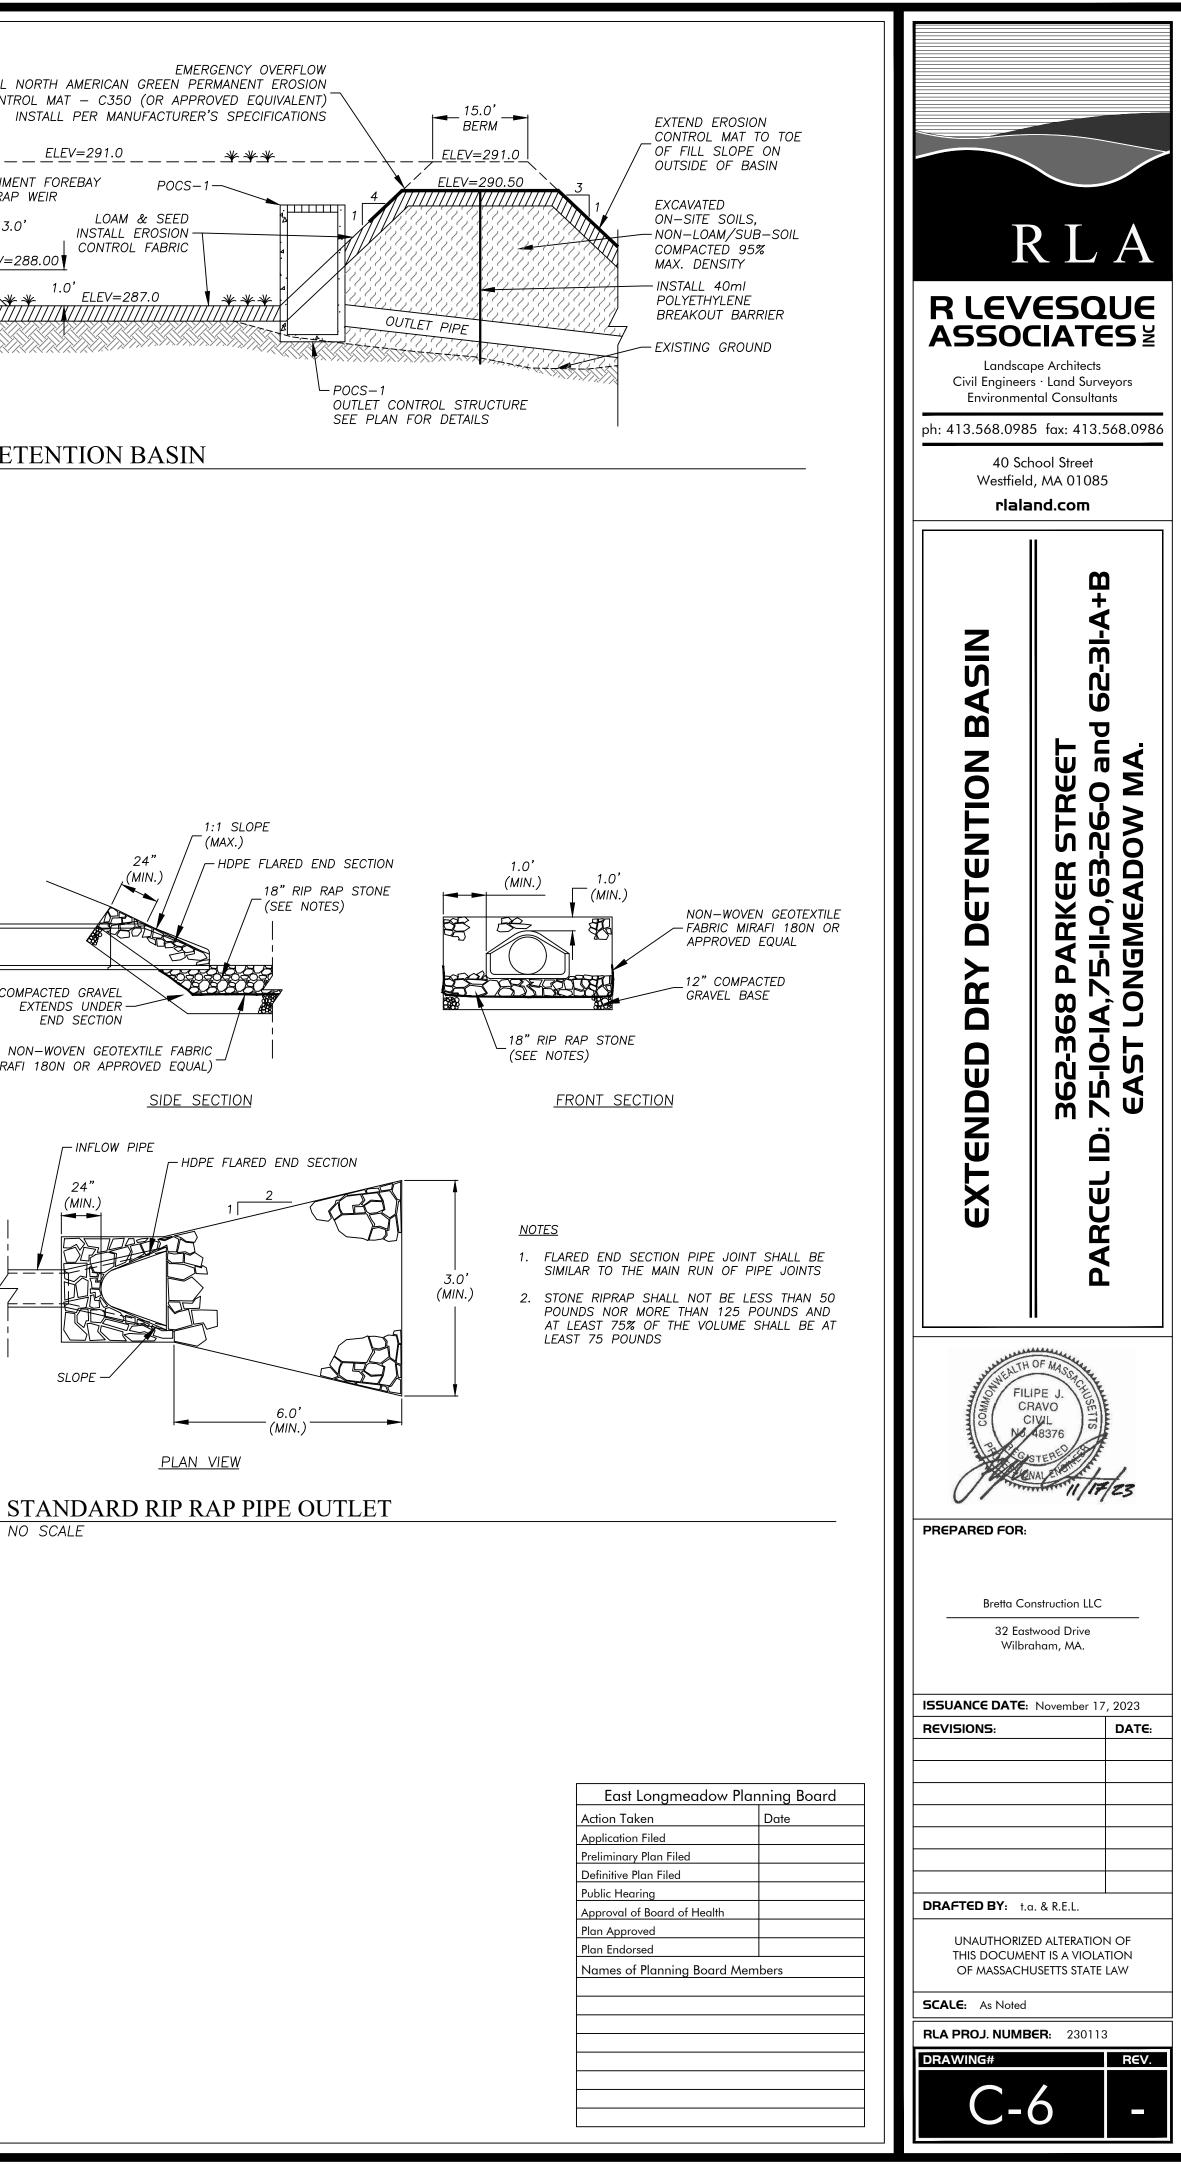

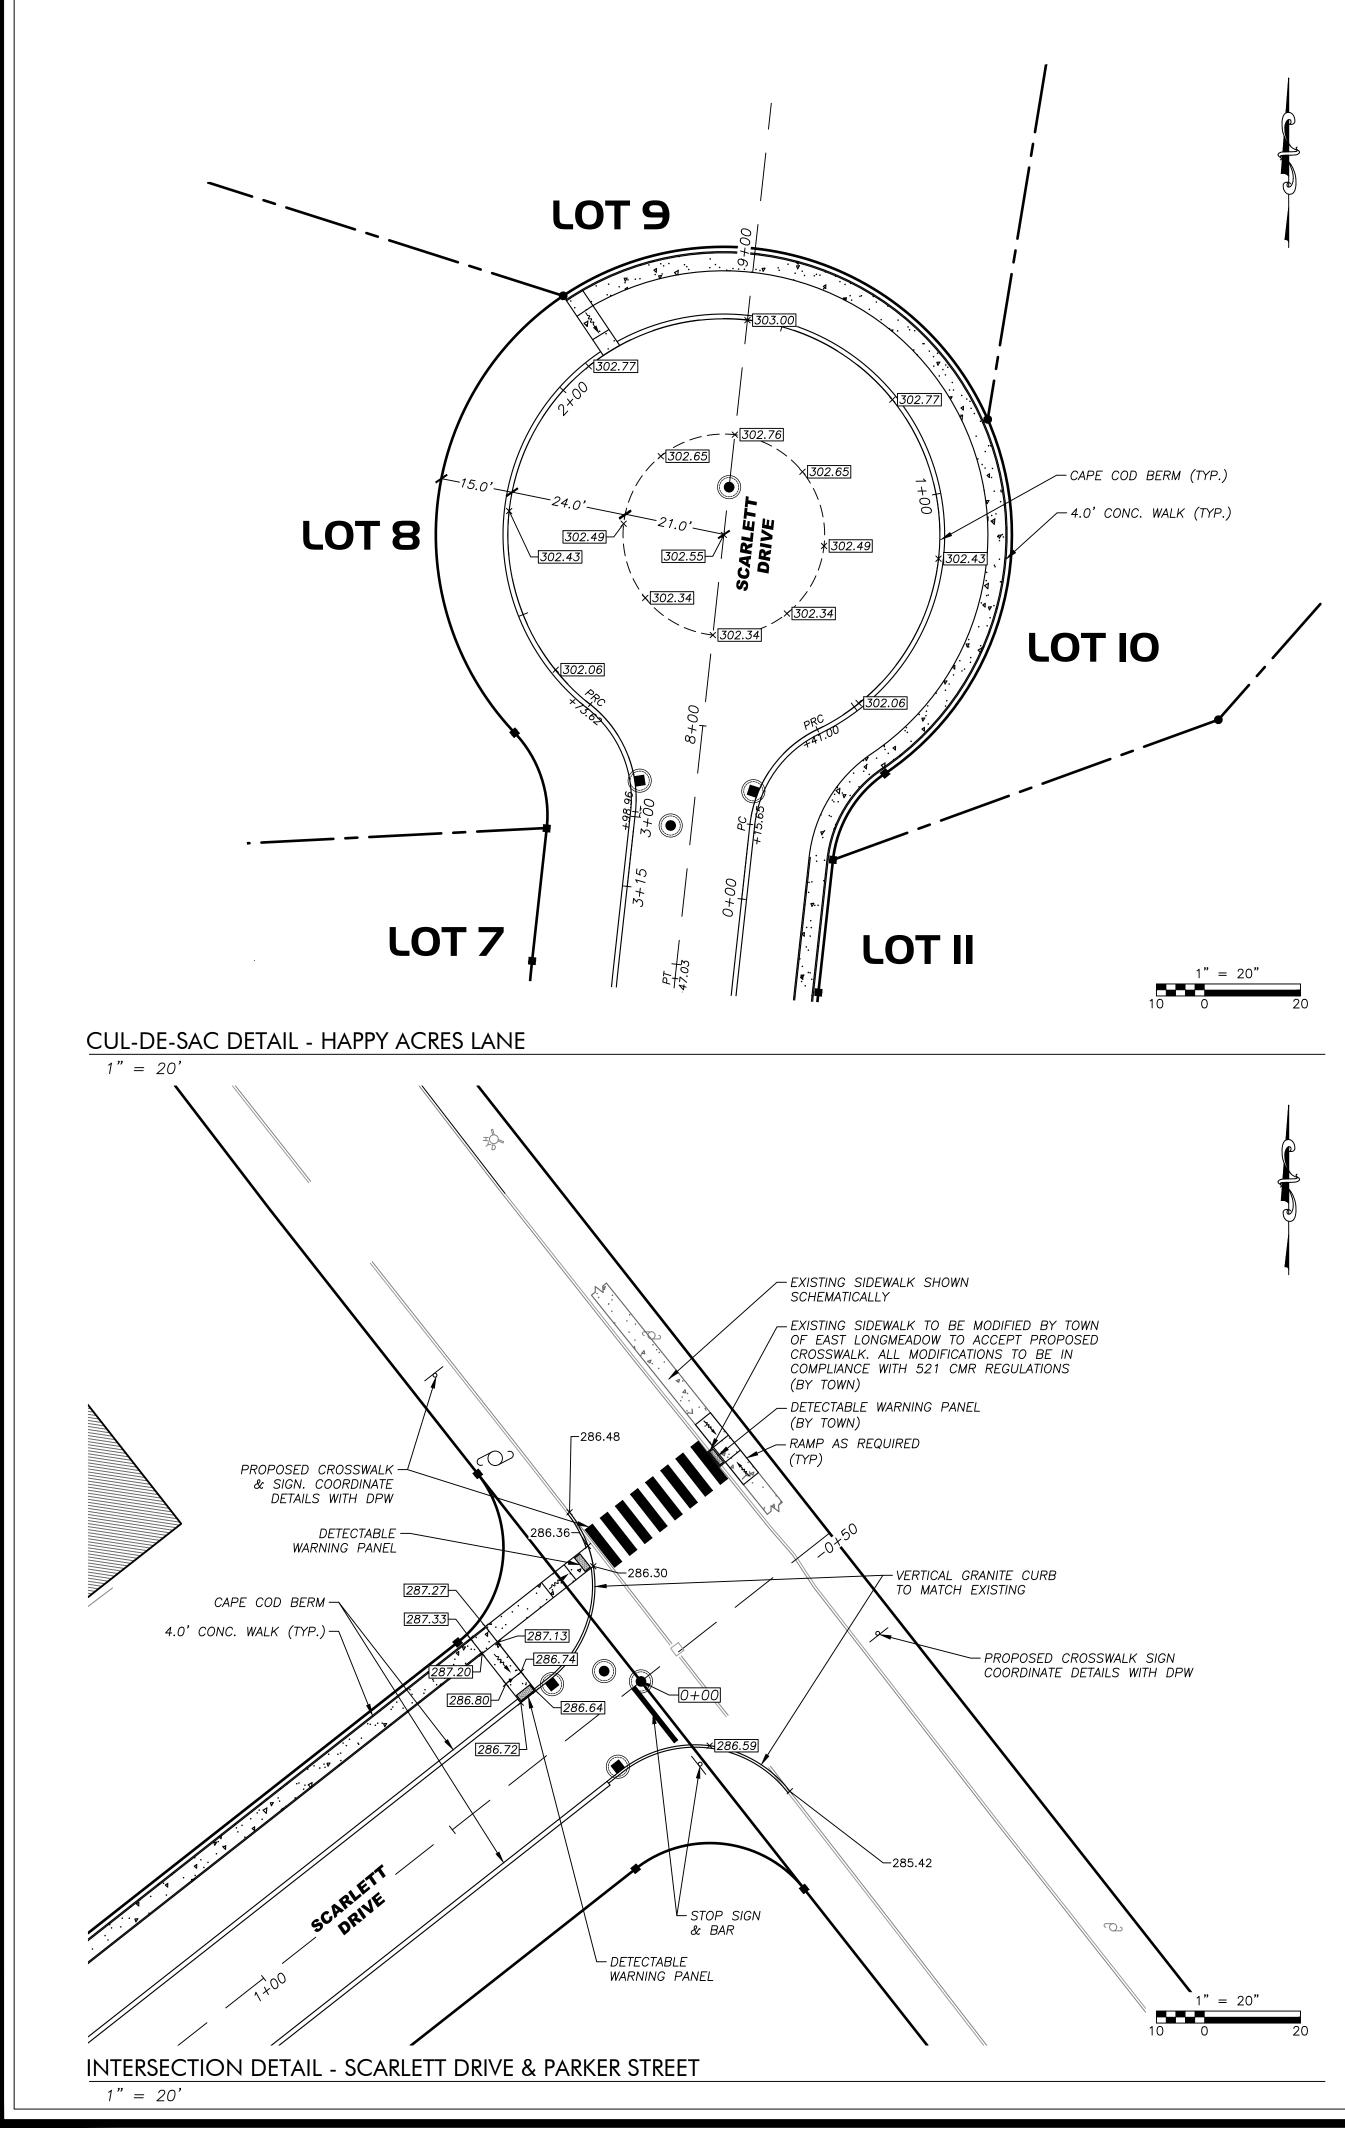



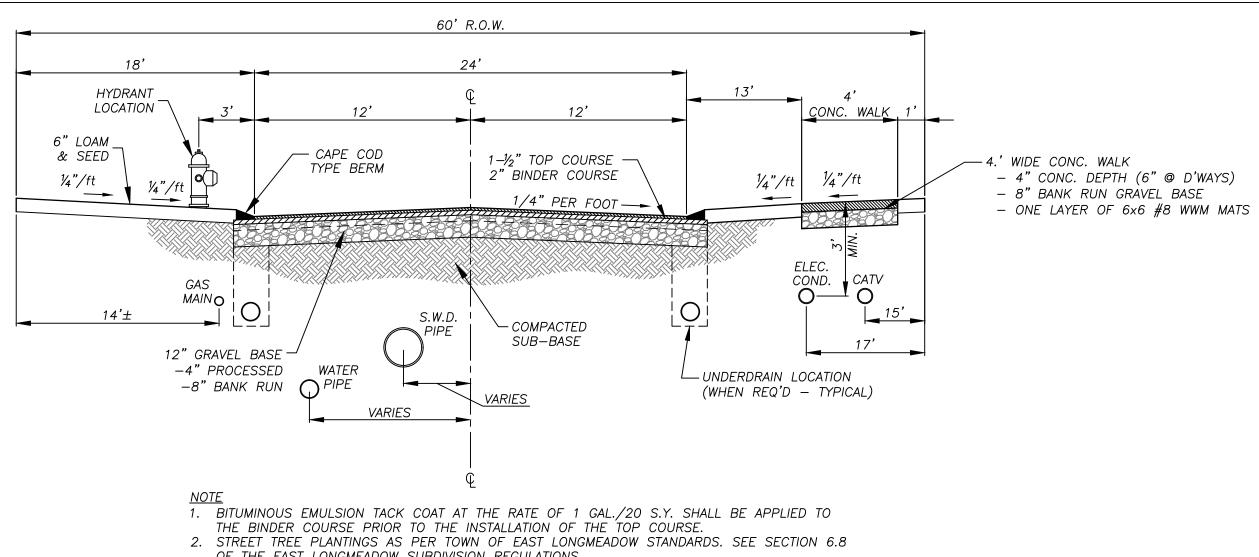


TYPICAL ROADWAY CROSS-SECTION

NO SCALE

NOTES: 1. ALL SIDEWALK SLOPES ARE MAXIMUMS. 2. ALL SIDEWALKS ARE TO BE CONSTRUCTED TO THE SAME SPECIFICATION FOUND IN MHD SUPPLEMENTAL SPECIFICATIONS TO THE 1988 STANDARD SPECIFICATIONS FOR HIGHWAYS AND BRIDGES. ENGLISH UNITS, JUNE 6, 2006 SECTIONS 701.00 TO 701.61 INCLUSIVE, AS AMENDED - UNLESS OTHERWISE SPECIFIED. AS AMENDED - UNLESS OTHERWISE SPECIFIED. 3. ALL SIDEWALK RAMPS ARE TO BE 400 PSI (28 DAY) PORTLAND CEMENT CONCRETE, 6%±1% AIR ENTRAINED.

TOOL ALL JOINTS AND EDGES. BROOM FINISH SIDEWALK OPPOSITE TO THE DIRECTION OF TRAVEL. SIDEWALK IS REQUIRED TO BE COVERED WITH PLASTIC AND KEPT MOIST FOR MINIMUM

OF 72 HOURS AFTER IT HAS SET-UP. DETECTABLE WARNING PANEL ARE TO COMPLY WITH ADA 4.29.2 8. DETECTABLE WARNING PANEL TO BE CAST IN PLACE DETECTABLE WARNING PANEL.

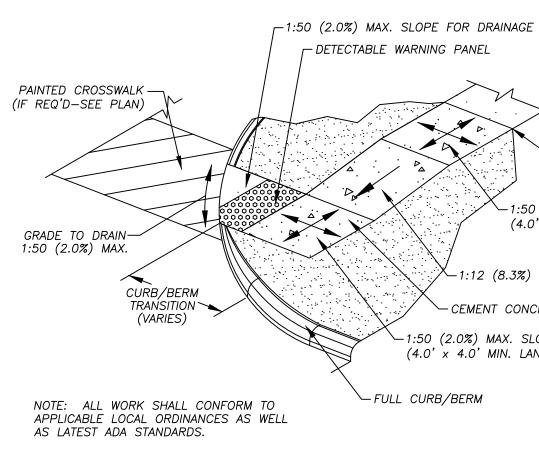

ACCESSIBLE RAMP DETAIL NO SCALE

OF THE EAST LONGMEADOW SUBDIVISION REGULATIONS.


- TRANSITION TO BITUMINOUS CONCRETE SIDEWALK -1:50 (2.0%) MAX. SLOPE (4.0' × 4.0' MIN. LANDING)


^X-1:12 (8.3%) MAX. RAMP SLOPE


- CEMENT CONCRETE

-1:50 (2.0%) MAX. SLOPE (4.0' × 4.0' MIN. LANDING)

East Longmeadow Planning Board				
Action Taken	Date			
Application Filed				
Preliminary Plan Filed				
Definitive Plan Filed				
Public Hearing				
Approval of Board of Health				
Plan Approved				
Plan Endorsed				
Names of Planning Board Mem	bers			

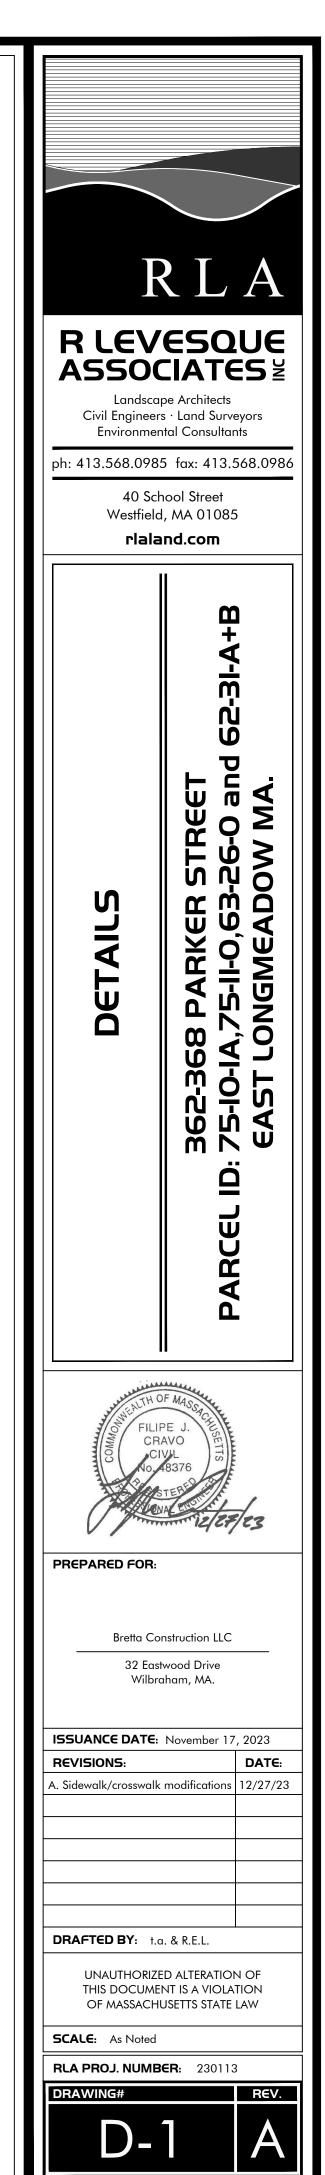

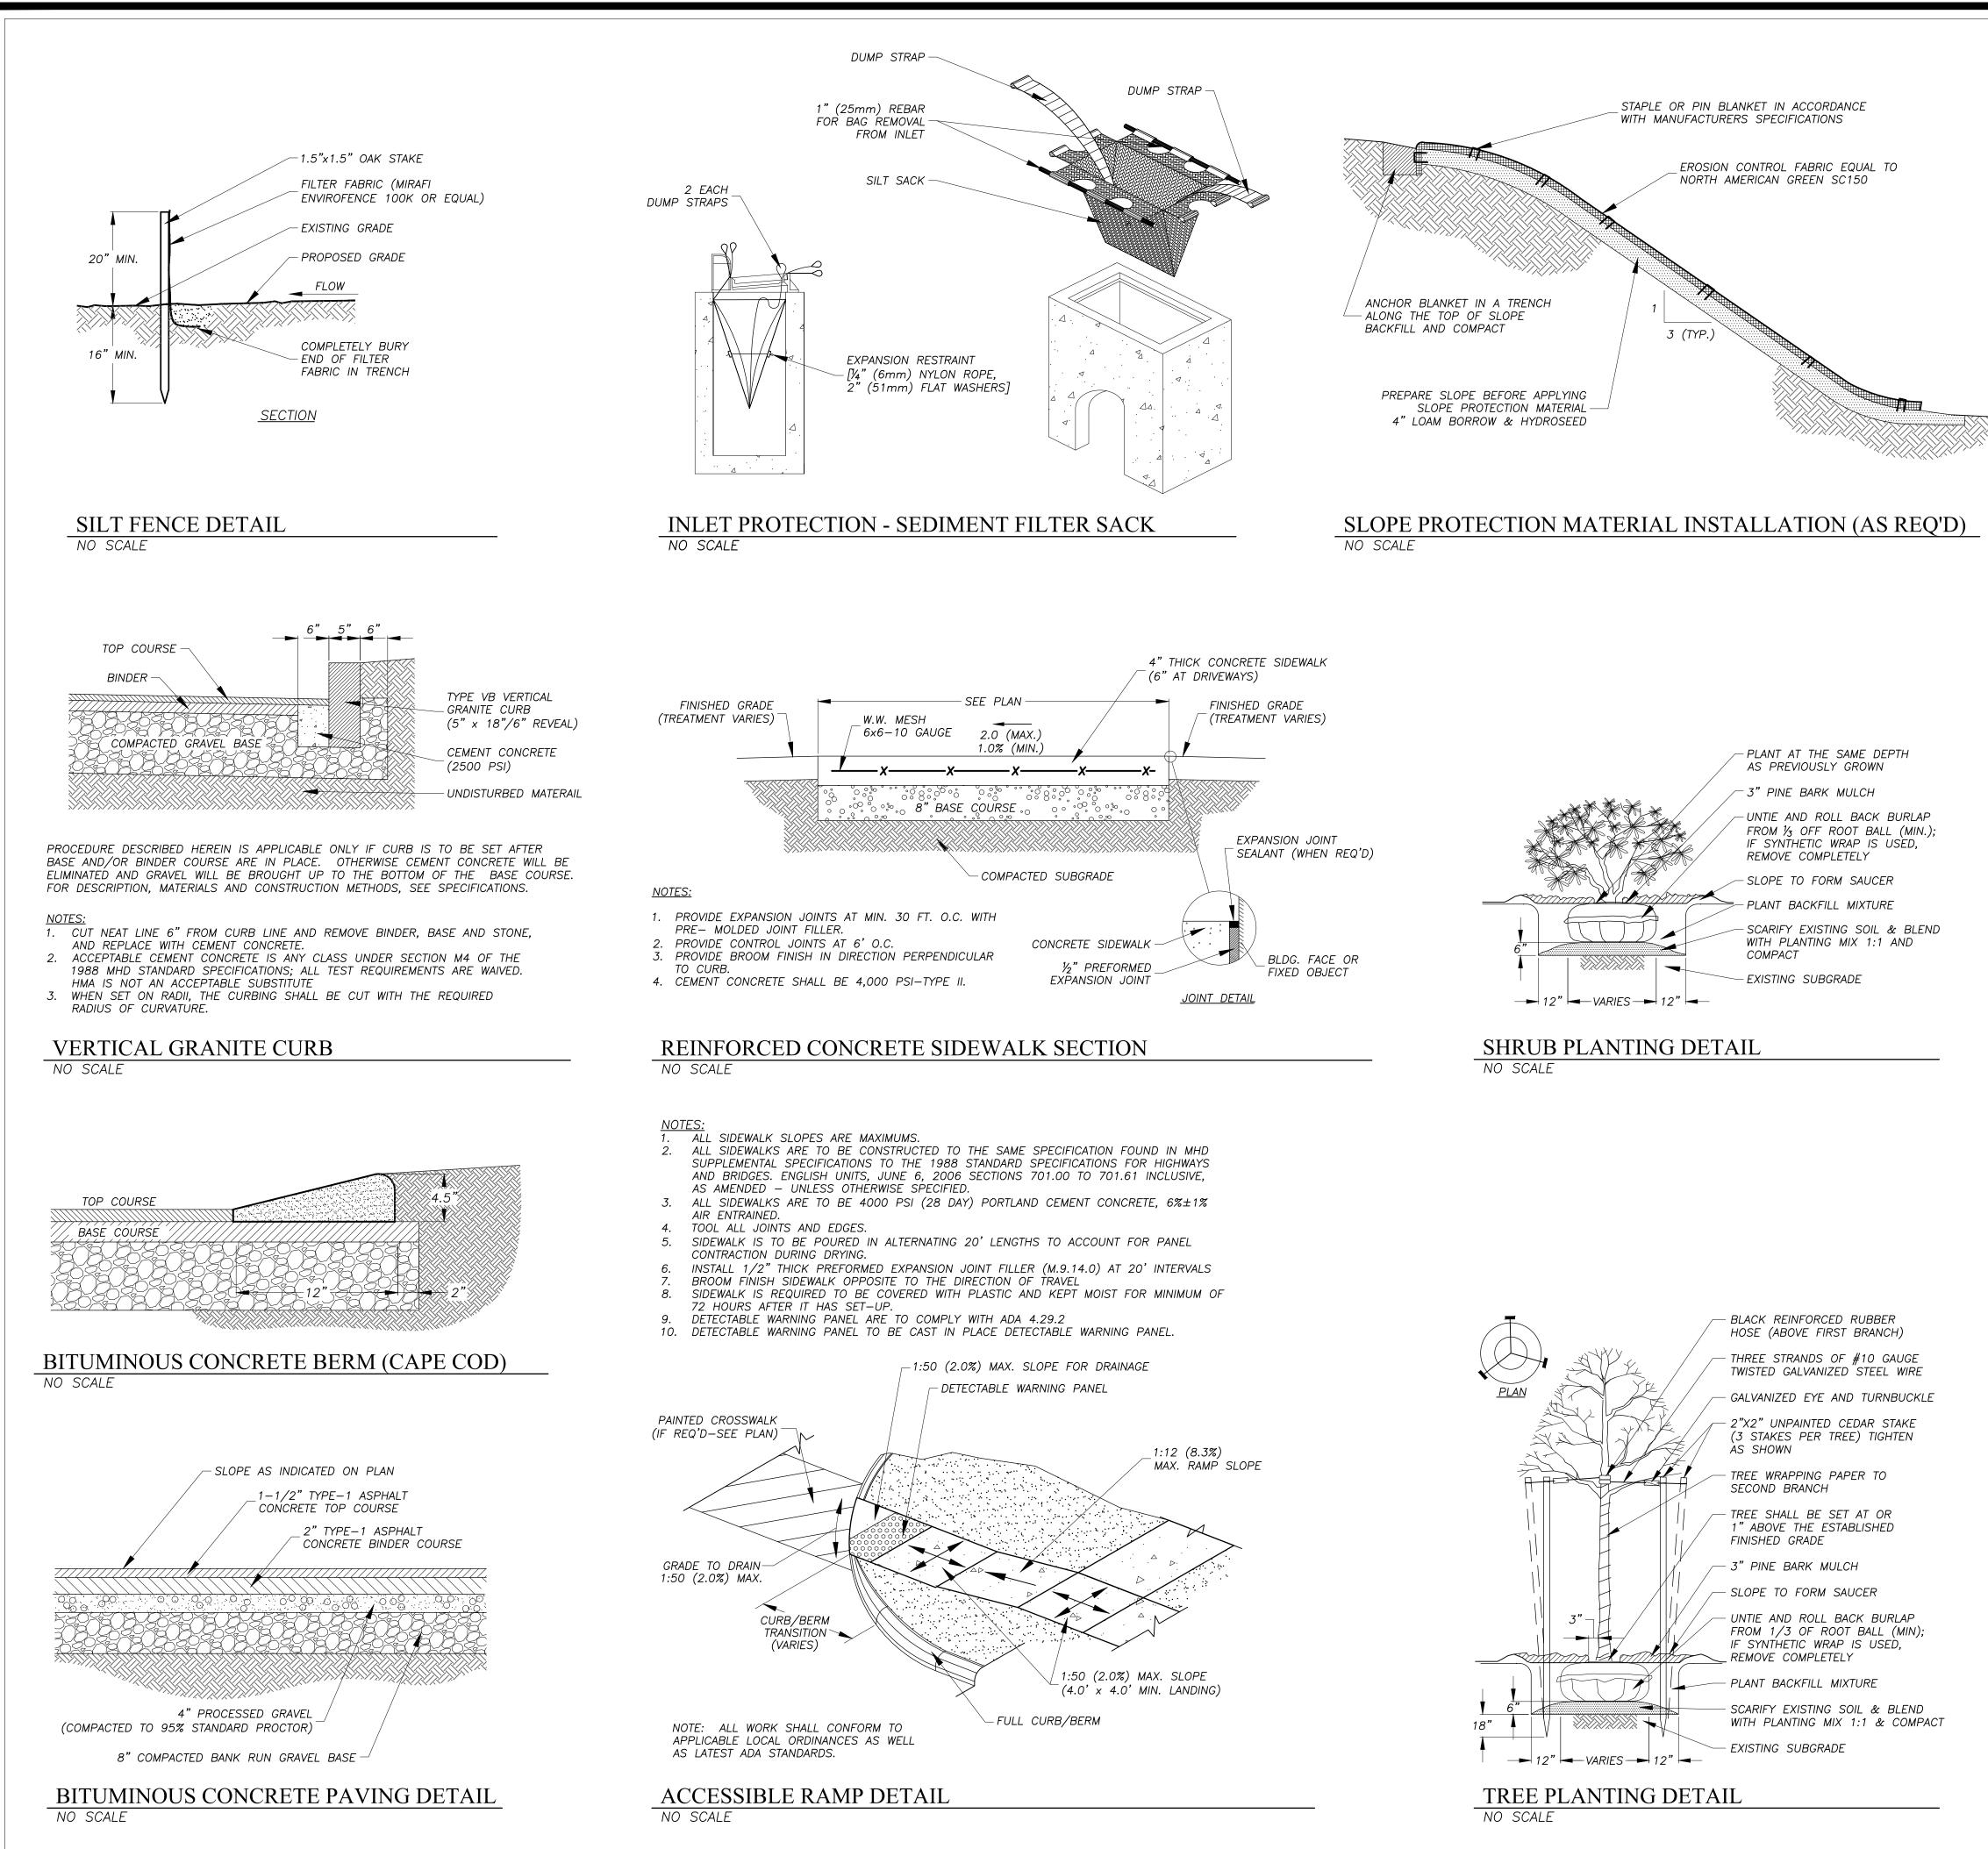


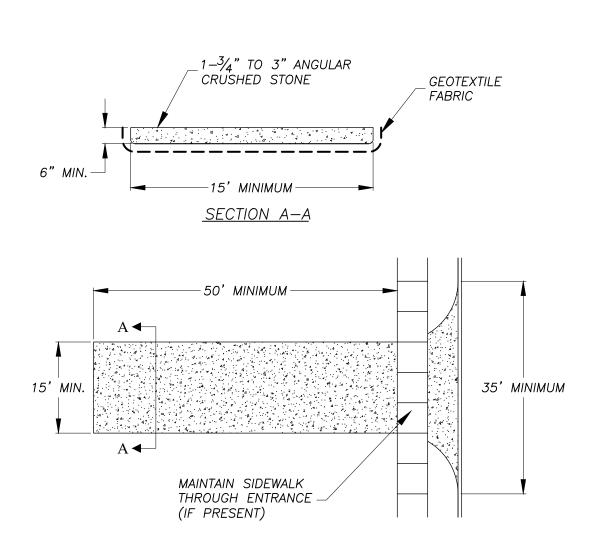

- EACH SITE ENTRANCE IS TO HAVE A TEMPORARY CONSTRUCTION ENTRANCE. STONE IS TO BE 1-3/4" TO 3" ANGULAR CRUSHED STONE.
- 3. PLACE GEOTEXTILE OVER THE ENTIRE AREA PRIOR TO PLACING OF STONE
- 4. ANY SEDIMENT TRACKED INTO THE ROADWAY NEEDS TO BE CLEANED IMMEDIATELY. 5. ADDITIONAL STONE IS TO BE ADDED TO THE PAD AS NEEDED TO MAINTAIN THE
- ORIGINAL DEPTH.
- 6. ANY SIDEWALK DAMAGED DURING CONSTRUCTION MUST BE REPLACED AT THE CONTRACTORS/DEVELOPERS EXPENSE.
- 7. SIDEWALK MUST REMAIN PASSABLE, IF THE SIDEWALK BECOMES UNSAFE OR IMPASSABLE, A TEMPORARY SIDEWALK / SIDEWALK DETOUR MUST BE PROVIDED.

ANTI-TRACKING APRON (AS REQ'D) NO SCALE

East Longmeadow Planning Board					
Action Taken	Date				
Application Filed					
Preliminary Plan Filed					
Definitive Plan Filed					
Public Hearing					
Approval of Board of Health					
Plan Approved					
Plan Endorsed					
Names of Planning Board Members					

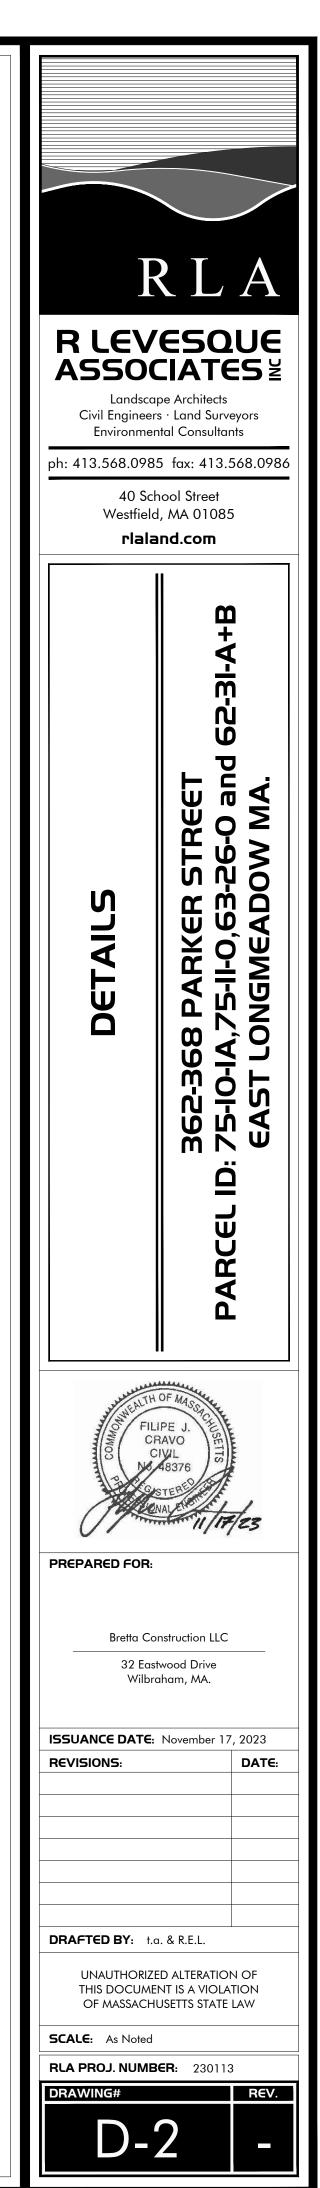




 \supset

PLACE AROUND VALVE BOX PRIOR TO FINISH PAVING. SEE CONCRETE COLLAR DETAILS.


6" VALVE MECHANICAL JOINT



NO SCALE

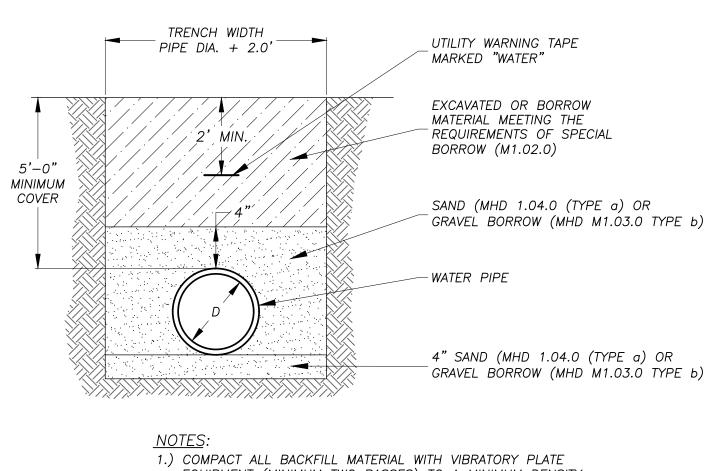



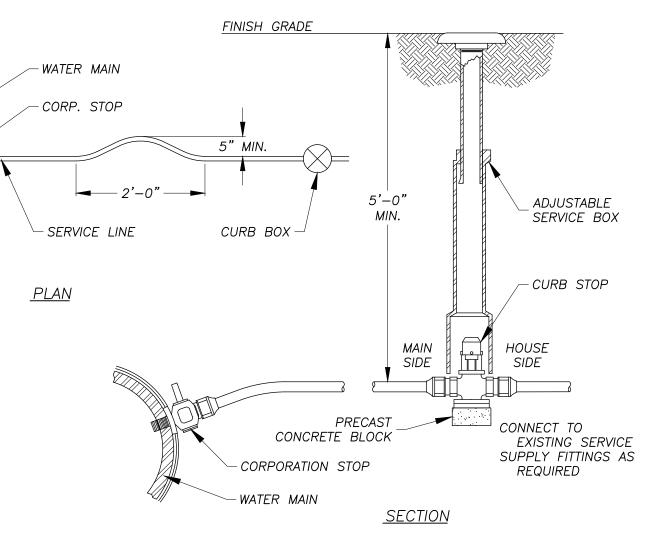


TYPICAL WATER SERVICE CONNECTION

PIPE RESTRAINT SCHEDULE FOR GROUND BURIED PRESSURE PIPES								
LENGTH OF RESTRAINT REQD (FEET)						DESIGN FO ON RESTR REQ'D (KI		
.E 221/2*	<i>33</i> ¾°	45°	5 <i>6</i> 1⁄4°	6 <i>7</i> ½°	78¾°	90° OR TEE	45°	
3	6	11	16	23	29	37	2.0	5
4	8	15	22	31	41	50	3	9
5	11	18	28	38	49	61	4.0	
6	13	22	33	45	59	73	6.0	2
7	14	25	37	52	68	84	8.0	2
8	16	28	42	59	77	95	11.0	
8	18	31	47	66	86	107	14.0	4
9	20	35	53	73	95	118	17.0	5
11	23	40	61	85	111	138	24.0	8
13	29	50	75	105	136	170	37.0	
15	34	59	88	123	160	199	54.0	
17	39	67	101	141	184	223	73.0	2
19	43	75	113	157	206	255	96.0	
	IGTH OF E 22½° 3 4 5 6 7 8 8 9 11 13 15 17	GROUN IGTH OF RESTR 221/2° 3334° 3 6 4 8 5 11 6 13 7 14 8 16 8 18 9 20 11 23 13 29 15 34 17 39	GROUND BUR IGTH OF RESTRAINT F Z 2½ 33¾ 45° 3 6 11 4 8 15 5 11 18 6 13 22 7 14 25 8 16 28 8 16 28 9 20 35 11 23 40 13 29 50 15 34 59 17 39 67	GROUND BURIED PR IGTH OF RESTRAINT REQD E 22½ 33¾ 45° 56¼ 3 6 11 16 4 8 15 22 5 11 18 28 6 13 22 33 7 14 25 37 8 16 28 42 8 16 28 42 9 20 35 53 11 23 40 61 13 29 50 75 15 34 59 88 17 39 67 101	GROUND BURIED PRESSURGROUND BURIED PRESSURIGTH OF RESTRAINT REQD(FEET) E 22% 33% 45° 56% 67% 361116234815223151118283861322334571425375281628425981831476692035537311234061851329507510515345988123173967101141	GROUND BURIED PRESSURE PIPE IGTH OF RESTRAINT REQD (FEET) E 22½' 33¾' 45° 56¼' 67½' 78¾' J 3 6 11 16 23 29 4 8 15 22 31 41 5 11 18 28 38 49 6 13 22 33 45 59 7 14 25 37 52 68 8 16 28 42 59 77 8 18 31 47 66 86 9 20 35 53 73 95 11 23 40 61 85 111 13 29 50 75 105 136 11 23 40 61 85 111 13 29 50 75 105 136 15 34 59 88 123 160 17 39 67 101	GROUND BURIED PRESSURE PIPES IGTH OF RESTRAINT REQD (FEET) E 22½' 33¾' 45' 56¼' 67½' 78¾' 90° OR TEE 3 6 11 16 23 29 37 4 8 15 22 31 41 50 5 11 18 28 38 49 61 6 13 22 33 45 59 73 7 14 25 37 52 68 84 8 16 28 42 59 77 95 8 18 31 47 66 86 107 9 20 35 53 73 95 118 11 23 40 61 85 111 138 13 29 50 75 105 136 170 13 29 50 75 105 136 170 15 34 59 88 123 160 19	GROUND BURIED PRESSURE PIPES IGTH OF RESTRAINT REQD (FEET) DESIGN ON RES REQ'D E 22½ 33¾ 45° 56¼ 67½ 78¾ 90° OR TEE 45° Z 2½ 33¾ 45° 56¼ 67½ 78¾ 90° OR TEE 45° Z 33 6 11 16 23 29 37 2.0 4 8 15 22 31 41 50 3 5 11 18 28 38 49 61 4.0 6 13 22 33 45 59 73 6.0 7 14 25 37 52 68 84 8.0 8 16 28 42 59 77 95 11.0 8 18 31 47 66 86 107 14.0 9 20 35 53 73 95 118 17.0 11 23 40 61 85 111 138 2

VALUES TO BE INCREASED OR DECREASED PROPORTIONALLY

(3) IF TIE RODS ARE USED, USE 4 RODS MINIMUM AND ADD 1/4" TO

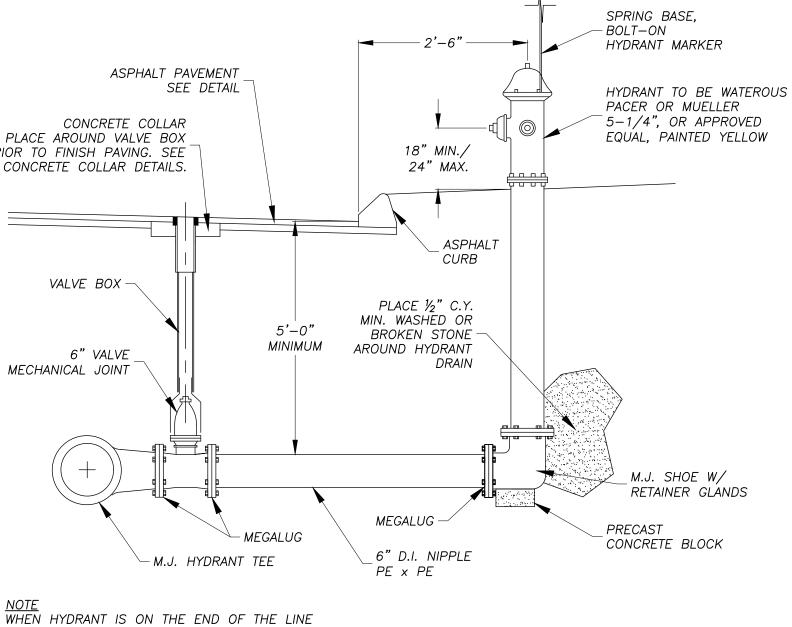

PROPER THRUST RESTRAINT IS REQUIRED AND IS TO BE SPECIFIED BY THE DESIGN ENGINEER AND THE PROPER RESTRAINT DISTANCE SHOWN ON THE PLANS

FIRE HYDRANT DETAIL

- EQUIPMENT (MINIMUM TWO PASSES) TO A MINIMUM DENSITY OF 95% OF THE STANDARD PROCTOR DENSITY AS DETERMINED
- BY ASTM D698 2.) PLACE BACKFILL MATERIALS IN MAXIMUM ONE FOOT LIFTS

TYPCAL WATER MAIN TRENCH SECTION

